

© 2024 CRESPO DESIGN GROUP.



ELEVATIONS
1-A

"MODEL"	"RH"
RESIDENCE: SPEC HOME	
LEGAL: UNIT: ,BLK: ,LOT:	
ADDRESS: 23 Tournament Road	
SUBDIVISION: ROTONDA WEST	
COUNTY: LEE	

SFH Development

CHECKED BY: H.L.C. DRAWN BY: H.C.

1	12/27/2024	00000000
---	------------	----------

[illegible]

© 2024 CRESPO DESIGN GROUP.



SCALE: 1/4" = 1'-0'

ELEVATIONS
1-B

"MODEL"	"RH"
RESIDENCE: SPEC HOME	
LEGAL: UNIT, BLK, LOT:	
ADDRESS: 23 Tournament Road	
SUBDIVISION: Rotonda WEST	
COUNTY: LEE	


SFH Development

CHECKED BY: H.L.C. DRAWN BY: H.C.

1	12/27/2024	000000000
---	------------	-----------

THE CONTRACTOR AND/OR OWNER SHALL, WITHIN 10 DAYS AFTER RECEIPT OF THE DRAWINGS AND/OR SPECIFICATIONS, NOTIFY THE ENGINEERING FIRM OF ANY CHANGES TO THE DRAWINGS AND/OR SPECIFICATIONS. THE ENGINEERING FIRM SHALL BE HELD FULLY RESPONSIBLE FOR THE RESULT AND/OR CONSEQUENCES OF ANY CHANGES TO THE DRAWINGS AND/OR SPECIFICATIONS OR OMISSIONS OR RECTIFYING THE SAME. ENGINEER OF RECORD AND CRESPO DESIGN AND/OR CONSTRUCTION FOR SUPERVISION OF CONTRACTING GROUP, DOES NOT ASSUME ANY RESPONSIBILITY FOR ANY CHANGES OR RECTIFYING OR REVIEW OF ANY DRAWINGS. THE CONTRACTOR AND/OR SUB-CONTRACTORS SHALL STRICTLY ADHERE TO ANY AND ALL STANDARD BUILDING CODES AND APPENDICES FOR LOCAL BUILDING DEPARTMENTS. THE CONTRACTOR AND/OR SUB-CONTRACTORS SHALL BE RESPONSIBLE FOR THE MAXIMUM LIABILITY TO ENGINEER-ARCHITECT OF RECORD AND CRESPO DESIGN AND/OR CONSTRUCTION FOR SUPERVISION OF CONTRACTING GROUP. THE MAXIMUM LIABILITY TO ENGINEER-ARCHITECT OF RECORD AND CRESPO DESIGN AND/OR CONSTRUCTION FOR SUPERVISION OF CONTRACTING GROUP SHALL NOT EXCEED THE FEE PAID TO ENGINEER-ARCHITECT OF RECORD AND CRESPO DESIGN AND/OR CONSTRUCTION FOR SUPERVISION OF CONTRACTING GROUP.








HOME DESIGNED FOR 160 MPH. W.P.

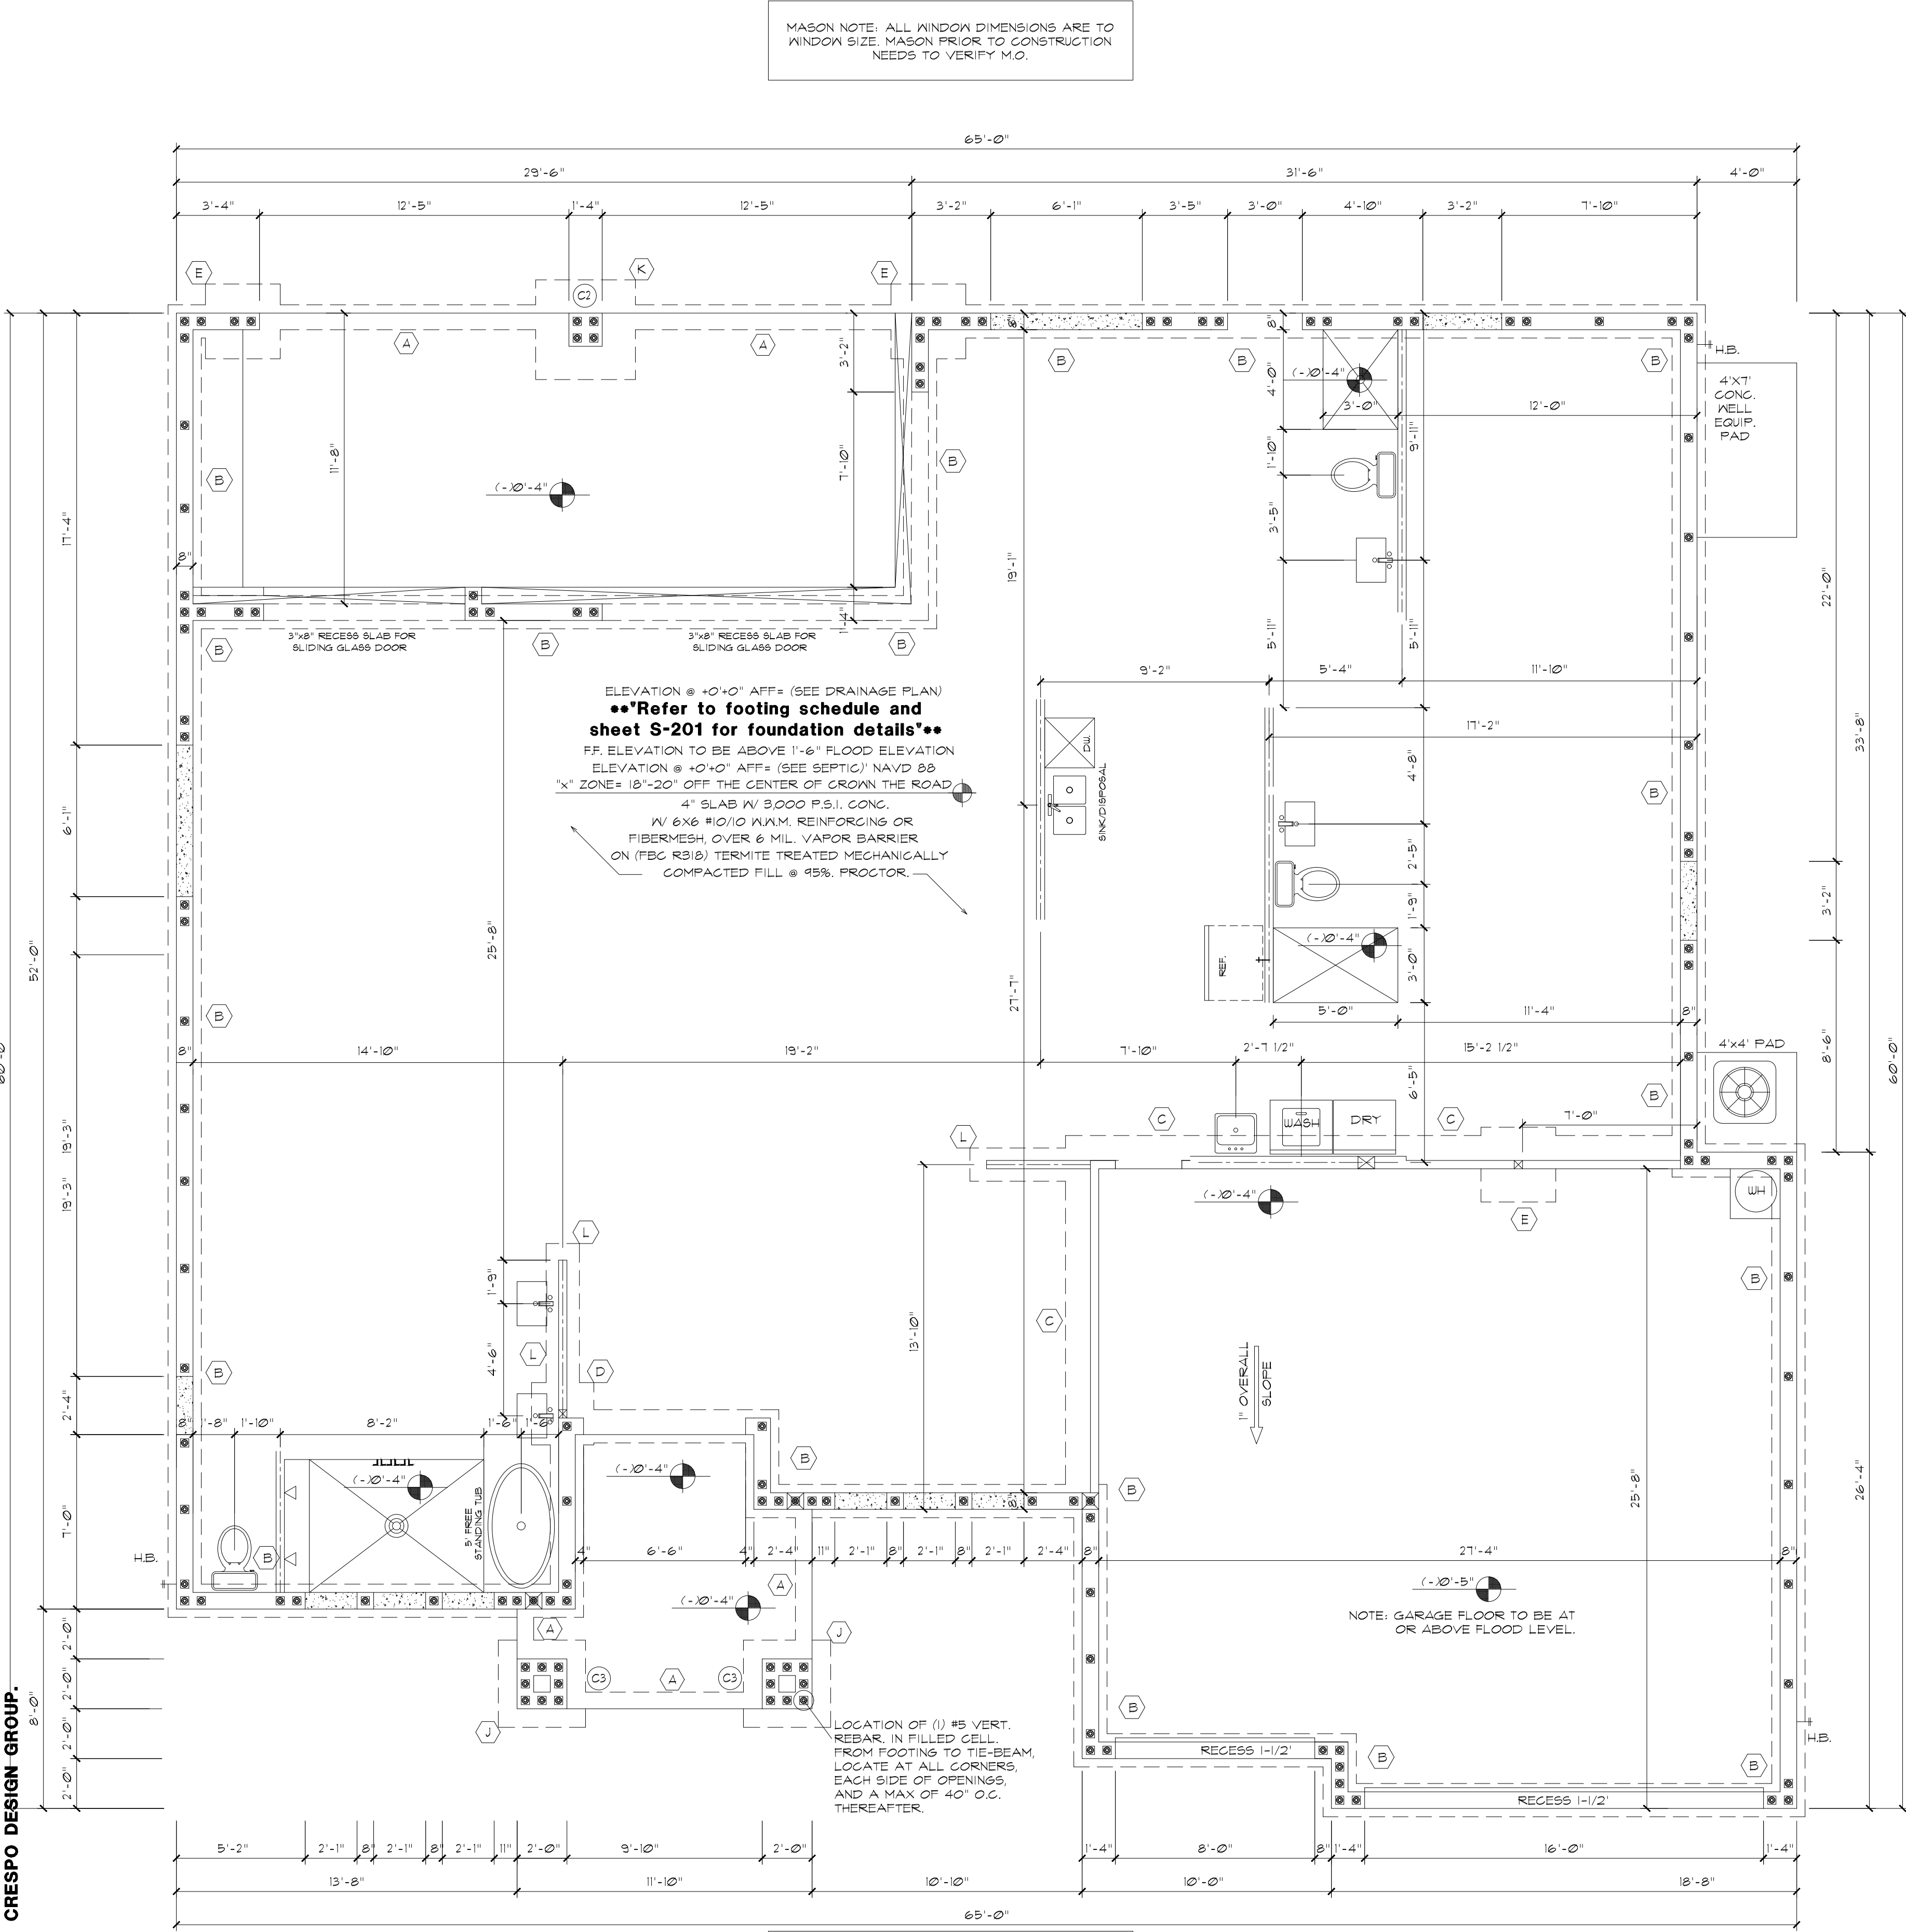

© 2024 CRESPO DESIGN GROUP.

MASON NOTE: ALL WINDOW DIMENSIONS ARE TO WINDOW SIZE. MASON PRIOR TO CONSTRUCTION NEEDS TO VERIFY M.O.

This item has been digitally signed and sealed by Matthew F. Giordano, P.E. on 05/29/2024.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

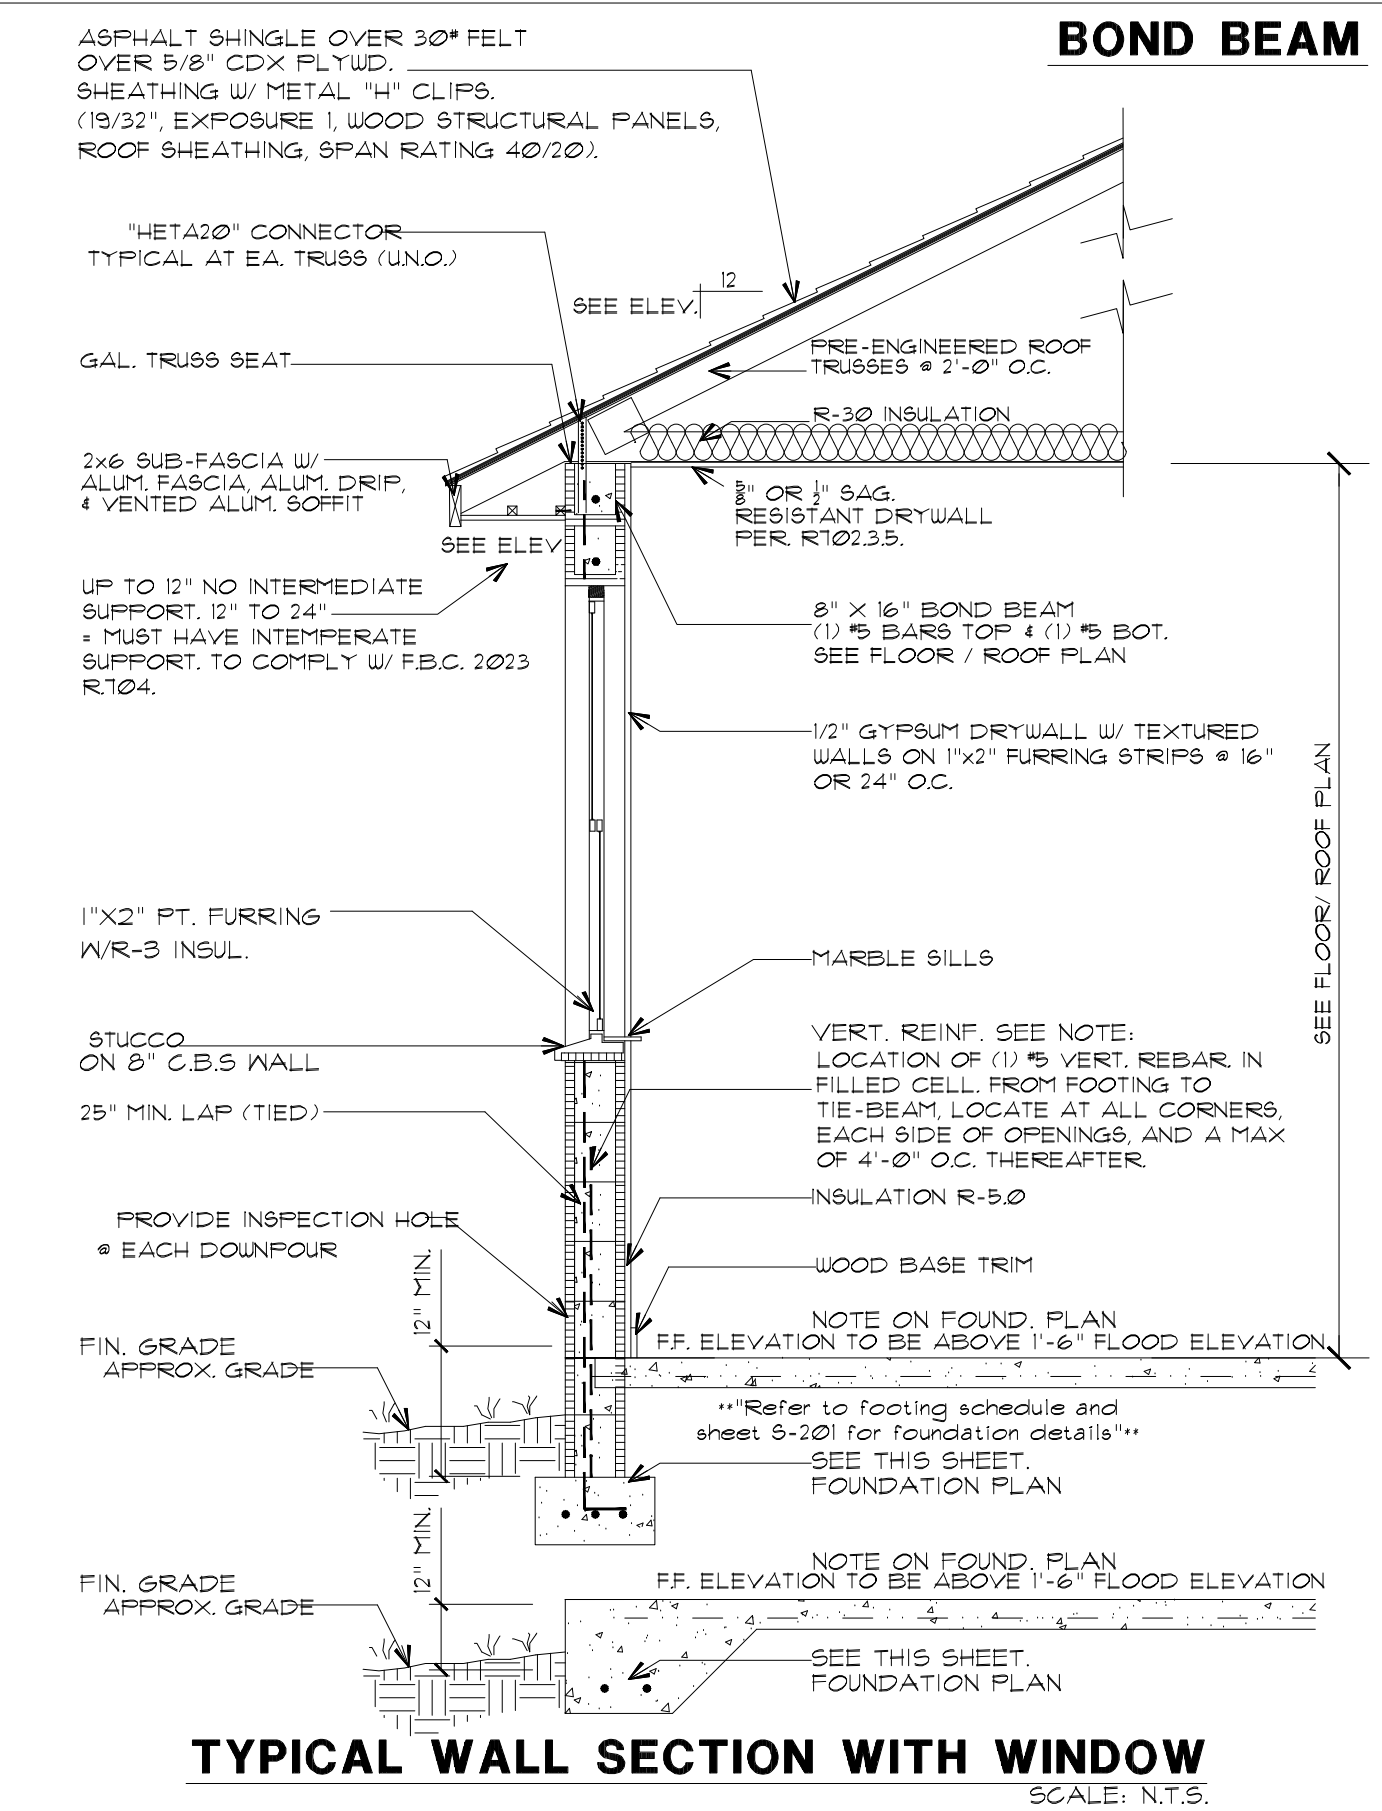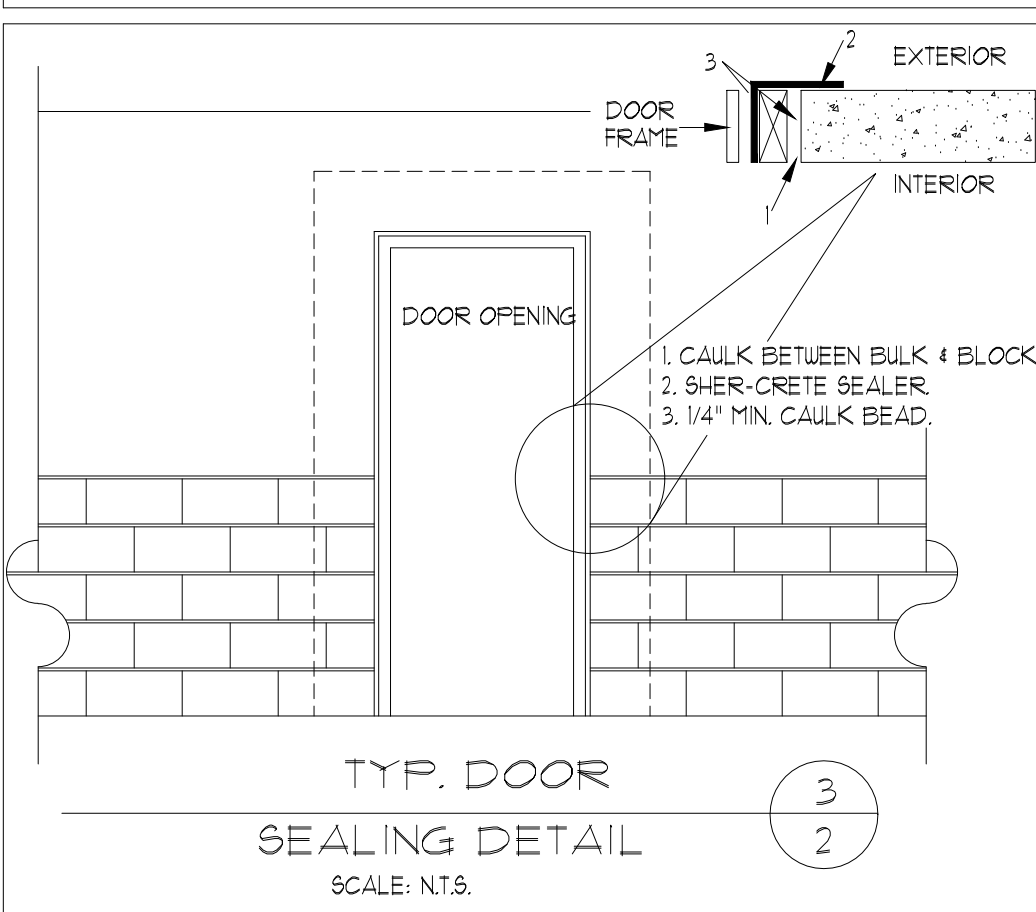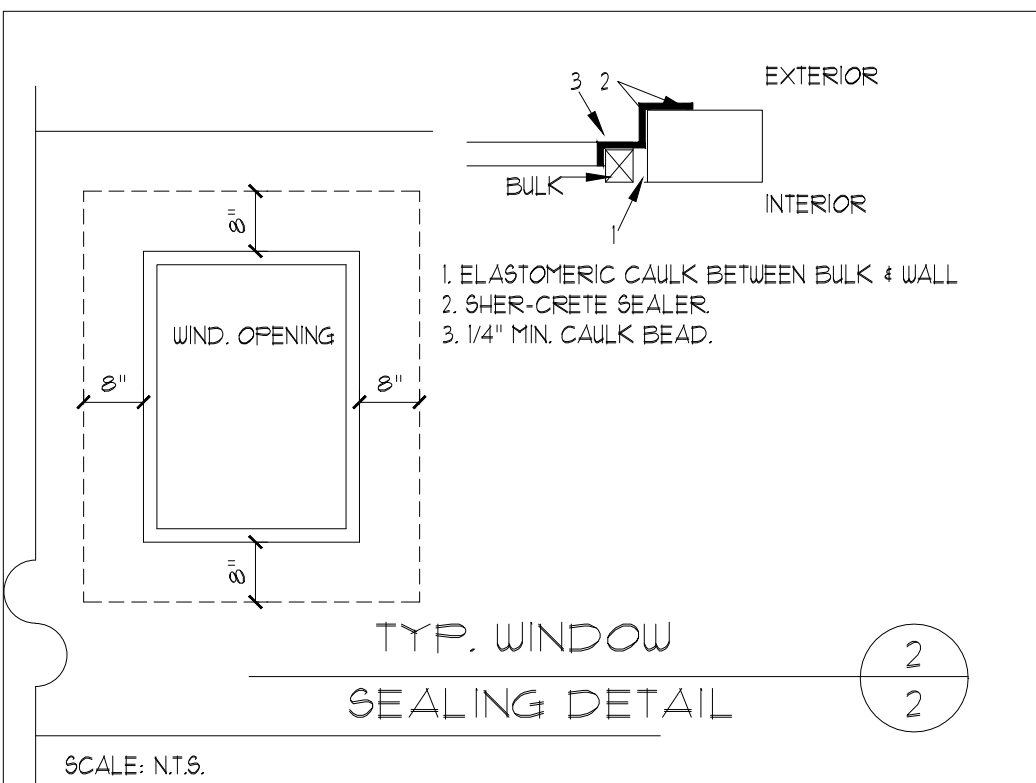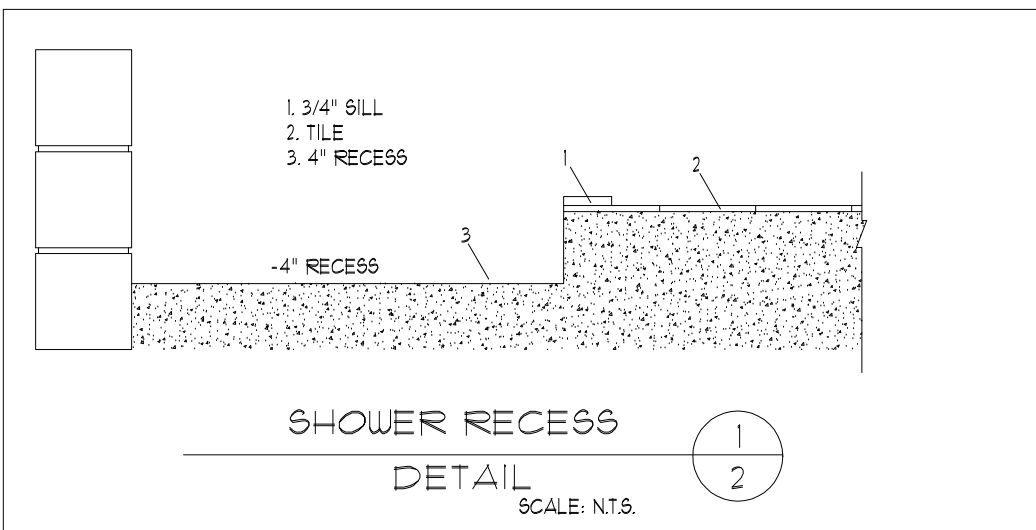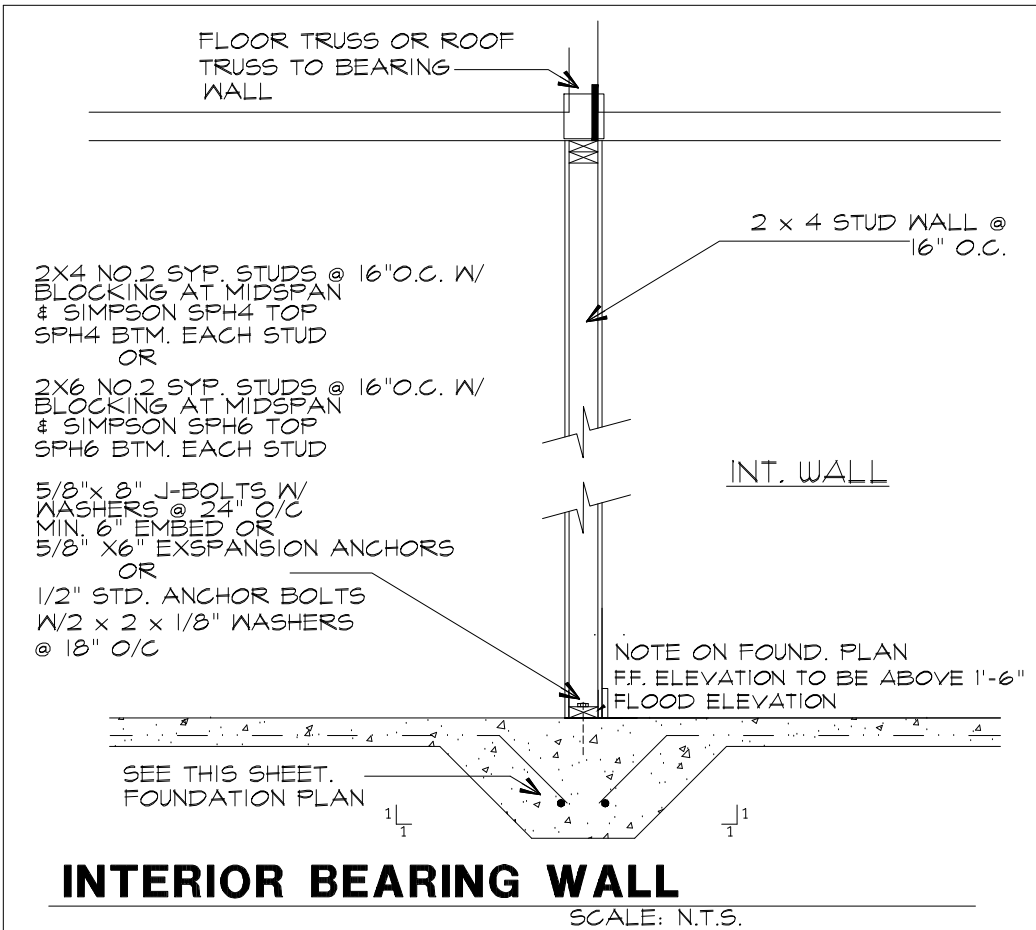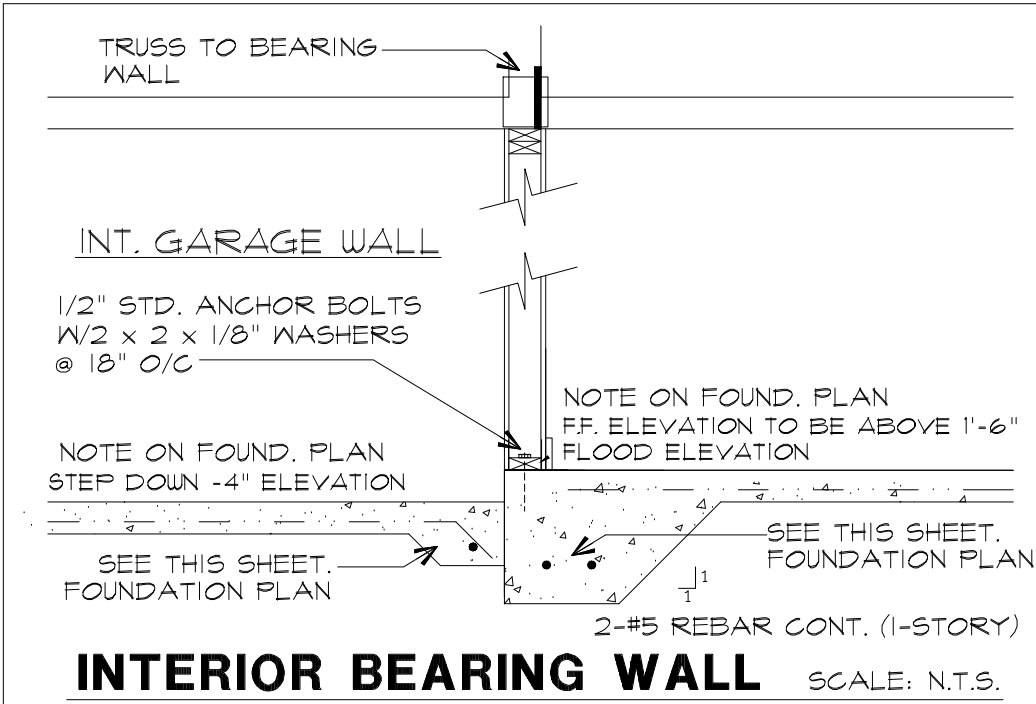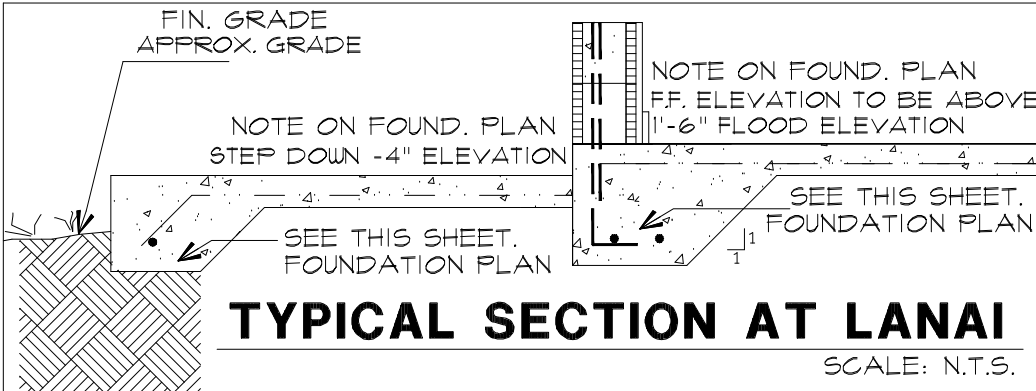

TERMITE PROTECTION FBC R318

TERMITE PROTECTION SHALL BE PROVIDED BY REGISTERED TERMITICIDES OR OTHER APPROVED METHODS OF TERMITE PROTECTION LABELED FOR USE AS A PREVENTATIVE TREATMENT TO NEW CONSTRUCTION.

CHEMICAL SOIL TREATMENT IS USED FOR SUBTERRANEAN TERMITE PREVENTION. IN INITIAL CHEMICAL SOIL TREATMENT INSIDE THE FOUNDATION PERIMETER SHALL BE DONE AFTER ALL EXCAVATION, BACKFILLING AND COMPACTION IS COMPLETE.

SOIL AREA DISTURBED AFTER INITIAL CHEMICAL SOIL TREATMENT SHALL BE RETREATED WITH CHEMICAL SOIL TREATMENT, INCLUDING SPACE BOXES OR FORMED.

SPACE IN CONCRETE FLOORS BOVED OUT OR FORMED FOR THE SUBSEQUENT INSTALLATION OF PLUMBING TRAPS, DRAINS OR ANY OTHER PURPOSE SHALL BE CREATED BY USING PLASTIC OR METAL PERMANENTLY PLACED FORMS OF SUFFICIENT DEPTH TO ELIMINATE ANY PLANNED SOIL DISTURBANCE AFTER INITIAL CHEMICAL SOIL TREATMENT.

CHEMICALLY TREATED SOIL SHALL BE PROTECTED WITH A MINIMUM 1 MIL VAPOR RETARDER TO PROTECT AGAINST RAINFALL. DILUTION, IF RAINFALL OCCURS BEFORE VAPOR RETARDER PLACEMENT, RETREATMENT IS REQUIRED. ANY WORK INCLUDING PLACEMENT OF REINFORCING STEEL, DONE AFTER CHEMICAL TREATMENT UNTIL THE CONCRETE FLOOR IS POURED, SHALL BE DONE IN SUCH MANNER AS TO AVOID PENETRATING OR DISTURBING TREATED SOIL.

CONCRETE OVERPOUR OR PORTLAND ACCUMULATED ALONG THE EXTERIOR FOUNDATION PERIMETER SHALL BE REMOVED PRIOR TO EXTERIOR CHEMICAL SOIL TREATMENT, TO ENHANCE VERTICAL PENETRATION OF THE CHEMICAL.

CHEMICAL SOIL TREATMENT SHALL ALSO BE APPLIED UNDER ALL EXTERIOR CONCRETE OR GRADE WITHIN 1 FOOT (305 MM) OF THE PRIMARY STRUCTURE SIDEWALLS. ALSO A VERTICAL CHEMICAL BARRIER SHALL BE APPLIED PROMPTLY AFTER CONSTRUCTION IS COMPLETED, INCLUDING INITIAL LANDSCAPE AND/OR PLANTING. ANY SOIL DISTURBED AFTER THE CHEMICAL VERTICAL BARRIER IS APPLIED SHALL BE PROMPTLY RETREATED.


ALL BUILDINGS SHALL HAVE PRECONSTRUCTION TREATMENT PROTECTION AGAINST SUBTERRANEAN TERMITES. THE RULES AND LAWS AS ESTABLISHED BY FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES SHALL BE DEEMED AS APPROVED WITH RESPECT TO PRE-CONSTRUCTION SOIL TREATMENT FOR PROTECTION AGAINST SUBTERRANEAN TERMITES. A CERTIFICATE OF COMPLIANCE SHALL BE ISSUED TO THE BUILDING DEPARTMENT BY THE LICENSED PEST CONTROL COMPANY THAT CONTAINS THE FOLLOWING STATEMENT:

THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES. TREATMENT IS IN ACCORDANCE WITH RULES AND LAWS ESTABLISHED BY FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES.

PROTECTIVE SLEEVES AROUND METALLIC PIPING PENETRATING CONCRETE SLAB-ON-GRADE FLOORS SHALL NOT BE OF CELLULOSE-CONTAINING MATERIALS AND SHALL RECEIVE APPLICATION OF A TERMITICIDE IN ANNULAR SPACE BETWEEN SLEEVE AND PIPE.

COLUMN SCHEDULE				
MARK	SIZE	VERTICAL REINFORCING OR BASE PLATE 4 ANCHOR BOLTS	COLUMN TIES OR CAP PLATE 4 BOLTS	REMARKS
(C1)	8"x8"	(1) #5 VERT		BEAM RISER
(C2)	16"x16"	(4) #5 VERT		
(C3)	24"x24"	(8) #5 VERT		

CONCRETE FOOTING SCHEDULE							
LABEL	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF. LONG WAY	TOP REINF. LONG WAY	REMARKS
(A)	MONOLITHIC CONT.	0'-8"	0'-8"	(1) #5	N/A		(1) 8" FOR PAVERS THICKENED EDGE
(B)	STEM WALL	CONT.	1'-8"	1'-0"	(3) #5	N/A	EXTERIOR FOOTING
(C)	MONOLITHIC CONT.	1'-4"	1'-8"	(2) #5	N/A		INTERIOR GARAGE FOOTING
(D)	PAD	2'-6"	2'-6"	1'-4"	(4) #5	(4) #5	COLUMN FOOTING
(E)	PAD	3'-0"	3'-0"	1'-4"	(4) #5	(4) #5	COLUMN FOOTING
(F)	PAD	4'-8"	4'-8"	1'-4"	(8) #5	(8) #5	COLUMN FOOTING
(G)	MONOLITHIC CONT.	1'-4"	1'-4"	(2) #5	N/A		EXTERIOR FOOTING
(H)	MONOLITHIC CONT.	1'-4"	1'-6"	(2) #5	N/A		INTERIOR FOOTING
(J)	PAD	42"	42"	16"	(5) #5	(5) #5	COLUMN FOOTING
(K)	PAD	48"	48"	16"	(5) #5	(5) #5	COLUMN FOOTING
(L)	MONOLITHIC CONT.	1'-4"	2'-0"	(2) #5	N/A		INTERIOR FOOTING "BELL"



M.F. GIORDANO
ENGINEERING, PLLC

CONTACT: MATTHEW GIORDANO, P.E.
PHONE: (347) 264-5891
FL P.E. #87672; STATE REGISTRY # 34011
ADDRESS: 1222 SE 47TH ST.
CAPE CORAL, FL. 33904

STAMPED FOR
STRUCTURAL ONLY

CHECKED BY: H.L.C. DRAWN BY: H.C.

1	12/27/2024	00000000
2		
3		
4		
5		
6		

DISCLOSURE: THESE DRAWINGS OR SPECIFICATIONS, INCLUDING ANY ADDENDUMS, SHALL BE THE PROPERTY OF CRESPO DESIGN GROUP, INC. AND SHALL BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. THE CONTRACTOR AND/OR OWNER SHALL WITHIN 10 DAYS AFTER RECEIPT OF THESE DRAWINGS AND PRIOR TO CONSTRUCTION NOTIFY THE ENGINEER/ARCHITECT OF ANY CHANGES OR MODIFICATIONS TO THE DRAWINGS. THE CONTRACTOR AND/OR OWNER SHALL BE RESPONSIBLE FOR THE REALITY AND ACCURACY OF THE INFORMATION PROVIDED TO THE ENGINEER/ARCHITECT. THE CONTRACTOR AND/OR OWNER SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE APPROPRIATE AGENCIES. THE CONTRACTOR AND/OR OWNER SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING UTILITIES AND STRUCTURES. THE CONTRACTOR AND/OR OWNER SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING PLANTS AND TREES. THE CONTRACTOR AND/OR OWNER SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING ROADS AND HIGHWAYS. THE CONTRACTOR AND/OR OWNER SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING UTILITIES AND STRUCTURES. THE CONTRACTOR AND/OR OWNER SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING PLANTS AND TREES. THE CONTRACTOR AND/OR OWNER SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING ROADS AND HIGHWAYS.

CRESPO
DESIGN & DRAFTING
11644 STONECREEK CIR.
FORT MYERS, FL 33913
Call: 239.465.9530
design@crespodesign.net
WWW.CRESPODESIGN.NET

'MODEL'

RESIDENCE: SPEC HOME	LEGAL: UNLT. :BLK. :LOT.
ADDRESS: 23 Tournament Road	SUBDIVISION: Rotonda WEST
COUNTY: LEE	STAMP#

CDD #304

'RH'



SFH
Development

SCALE: 1/4" = 1'-0"

FOUNDATION

2

© 2024 CRESPO DESIGN GROUP.

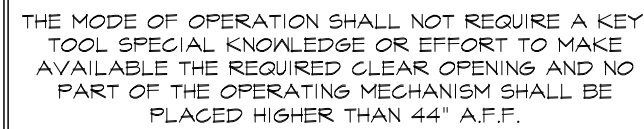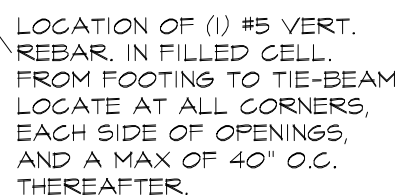

WOOD POST
(SEE PLAN OR ELEVATION
FOR SPEC.)

8x8 BEAM RISER
(SEE PLAN OR ELEVATION
FOR SPEC.)

- ALLOW 30" DEPTH FOR WASHER AND DRYER
- KITCHEN KNEE WALL 42 1/2" TO TOP USING 2"x4" AS TOP PLATE.
- PLANT SHELVES TO BE AT SEE PLAN.
- SCUTTLE HOLE DIMENSION 22 1/2"x36" 30" MINIMUM VERTICAL CLEARANCE.
- BLOCKING TO BE PUT IN ALL TRACKS
- GAUGING AT TOP OF WINDOWS AND SLIDERS TO BE EXTENDED 12" PAST EACH SIDE OF THE OPENING.
- "JOB MUST BE BROOMED & SWEEP WHEN FINISHED"

DOOR HEADERS

6'-8" BIFOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.
8'-0" BIFOLD	HEADER HEIGHT	98 1/2" A.F.F.

The exterior wall envelope design shall be considered to resist wind-driven rain where the results of testing indicate that water did not penetrate: control joints in the exterior wall envelope; joints at the perimeter of openings; penetration; or intersections or terminations with dissimilar materials.

RTCS.1.1 Load resistance. All exterior walls, wall covering and soffits shall capable of resisting the design pressures specified in Table R301.2(2) for walls.

SQ. FOOTAGE		
A/C SPACE	-----	2,298
COVERED LANAI	-----	344
3 CAR GARAGE	-----	710
ENTRY	-----	107
TOTAL	-----	3,459

- FIELD CEILING 5'4" X 22" ATTIC ACCESS W/UP/DN DOWN STAIRS
- ALL CEILING HEIGHTS ARE TO BE ABOVE FINISHED FLOOR OF LIVING AREA
- ALL BEAM / LINTEL HEIGHTS ARE ABOVE FINISHED FLOOR OF LIVING AREA
- ALL DOOR SILL'S SHALL NOT EXCEED 1/2" IN HEIGHT
- ALL EYES LESS THAN 1/2" SHALL HAVE RAIN SPUNTERS AND DROUPOUTS
- ALL WOSE SIBBS ARE TO BE EQUIPPED AN ANTI-GUINNING DEVICE PER COUNTY CODE
- PROVIDE BLOCKING FOR GRAB BARS @ TOILETS, TUB, AND SHOWER
- LEVER HANDLE W/ ANTI-SCALD DEVICE TO BE INSTALLED @ TUB AND SHOWER
- LOW FLOW SHOWER HEADS IN ALL SHOWERS (2.5 GPM MIN)
- DUEL FLUSH OR LOW FLOW TOILETS (1.6 GPM MIN)
- PROVIDE 1/4" X 6" FLOORING AT 4'-0" OC AT THE BOTTOM CHORD OF ALL TRUSSES IN LANAI AND ENTRY (AREAS EXPOSED TO WIND). CEILING SHEATHING IN THESE AREAS TO BE 5/8" EXTERIOR GRADE OSB OR 1/2" EXTERIOR GRADE PLYWOOD.
- PER SECTION 0201.02 OF THE 2020 CALIFORNIA INTERNATIONAL BUILDING CODE, EXTERIOR WALLS SEPARATED BY LESS THAN 6 FT, SHALL HAVE NOT LESS THAN 1 HR FIRE RESISTIVE RATING WITH EXPOSURE ON BOTH SIDES.
- PER TABLE R101.33 (FOOTNOTE D) ON CEILING APPLICATIONS TO RECEIVE A WATER-BASED TEXTURE MATERIAL, EITHER HAND OR SPRAY APPLIED, THE GYPSUM BOARD SHALL BE APPLIED PERPENDICULAR TO FRAMING. THE MINIMUM GYPSUM BOARD THICKNESS SHALL BE 5/8" INCH FOR 24-INCH ON CENTER FRAMING OR 1/2-INCH 54-G-RESISTANT GYPSUM CEILING BOARD.
- UNLESS NOTED OTHERWISE, ALL WOOD FRAME BEARING HEADERS ARE 2"1/2" X 12" PLYWOOD FLITCH PLATES
- UNLESS NOTED OTHERWISE, ALL WOOD FRAME BEARING HEADERS LESS THAN 6' IN LENGTH SHALL HAVE (2) FULL LENGTH JACKS @ (2) HEADER JACKS AT EACH END.
- UNLESS NOTED OTHERWISE, ALL WOOD FRAME BEARING HEADERS MORE THAN 6' IN LENGTH SHALL HAVE (3) FULL LENGTH JACKS @ (2) HEADER JACKS AT EACH END.
- ALL EXTERIOR AND INTERIOR WOOD FRAME BEARING WALLS TO BE NO. 2, SOUTHERN YELLOW PINE, INCLUDING, BUT NOT LIMITED TO: STUDS, JACKS, & HEADERS.
- ATTACHMENT TRUSSES TO WOOD FRAMED DOUBLE TOP PLATE W/ "SPINNO" OR CONNECTORS.
- HEADERS FOR 6'-8" HEIGHT / 8'-0" HEIGHT OPENINGS SHALL BE (2)"1/2" X 12" PLYWOOD FLITCH PLATE AND CONTINUOUS TOP PLATE ABOVE.
- PROVIDE TWO LAYERS OF WATER RESISTIVE BARRIER BEHIND EXTERIOR WALL COVERING PER 2023 CBC, R103.6.3.
- PROVIDE PAN FLASHING UNDER WINDOWS AND DOORS ON FRAME CONSTRUCTION. OPENINGS USING PAN FLASHING SHALL ALSO INCORPORATE FLASHING OR PROTECTION AT THE HEAD AND SIDES. ALL EXTERIOR U/D FRAME BEARING WALL ARE TO ARE: FUNCTION AS SHEAR WALLS.
- ALSO INCORPORATE FLASHING OR PROTECTION AT THE HEAD AND SIDES/SELF-ADHERED MEMBRANES USED AS FLASHING SHALL COMPLY WITH AASMA TIL

SEPARATION	MATERIAL
FROM THE RESIDENCE AND ATTICS	NOT LESS THAN 1/2-INCH GYPSUM BOARD OR EQUIVALENT APPLIED TO THE GARAGE SIDE
FROM HABITABLE ROOMS ABOVE THE GARAGE	NOT LESS THAN 5/8-INCH TYPE X GYPSUM BOARD OR EQUIVALENT
STRUCTURE(S) SUPPORTING FLOOR/CEILING ASSEMBLIES USED FOR SEPARATION REQUIRED BY THIS SECTION	NOT LESS THAN 1/2-INCH GYPSUM BOARD OR EQUIVALENT
GARAGE LOCATED LESS THAN 3 FEET FROM A DWELLING UNIT ON THE SAME LOT	NOT LESS THAN 1/2-INCH GYPSUM BOARD OR EQUIVALENT APPLIED TO THE INTERIOR SIDE OF EXTERIOR WALLS THAT ARE WITHIN THIS AREA

[illegible]

CRESPO
DESIGN & DRAFTING


11644 STONECREEK CIR.
FORT MYERS, FL. 33913
Cell: 239. 565. 9530
design.crespo@gmail.com
WWW.CRESPODESIGN.NET



"MODEL"	"RH"
EVIDENCE; SPEC HOME	
LEGAL; UNIT; BLK; LOT;	
ADDRESS: 23 Tournament Road	
SUBDIVISION; ROTONDA WEST	
COUNTY; LEE	
PARCEL #	CDP #2024-

SFH Development


FLOOR PLAN
3-A



M.F. GIORDANO
ENGINEERING, PLLC

CONTACT: MATTHEW GIORDANO, P.E.
PHONE: (347) 264-5891
FL P.E. #87672; STATE REGISTRY # 34011
ADDRESS: 1222 SE 47TH ST.
CAPE CORAL, FL. 33904

HOME DESIGNED FOR 160 MPH. W.P.

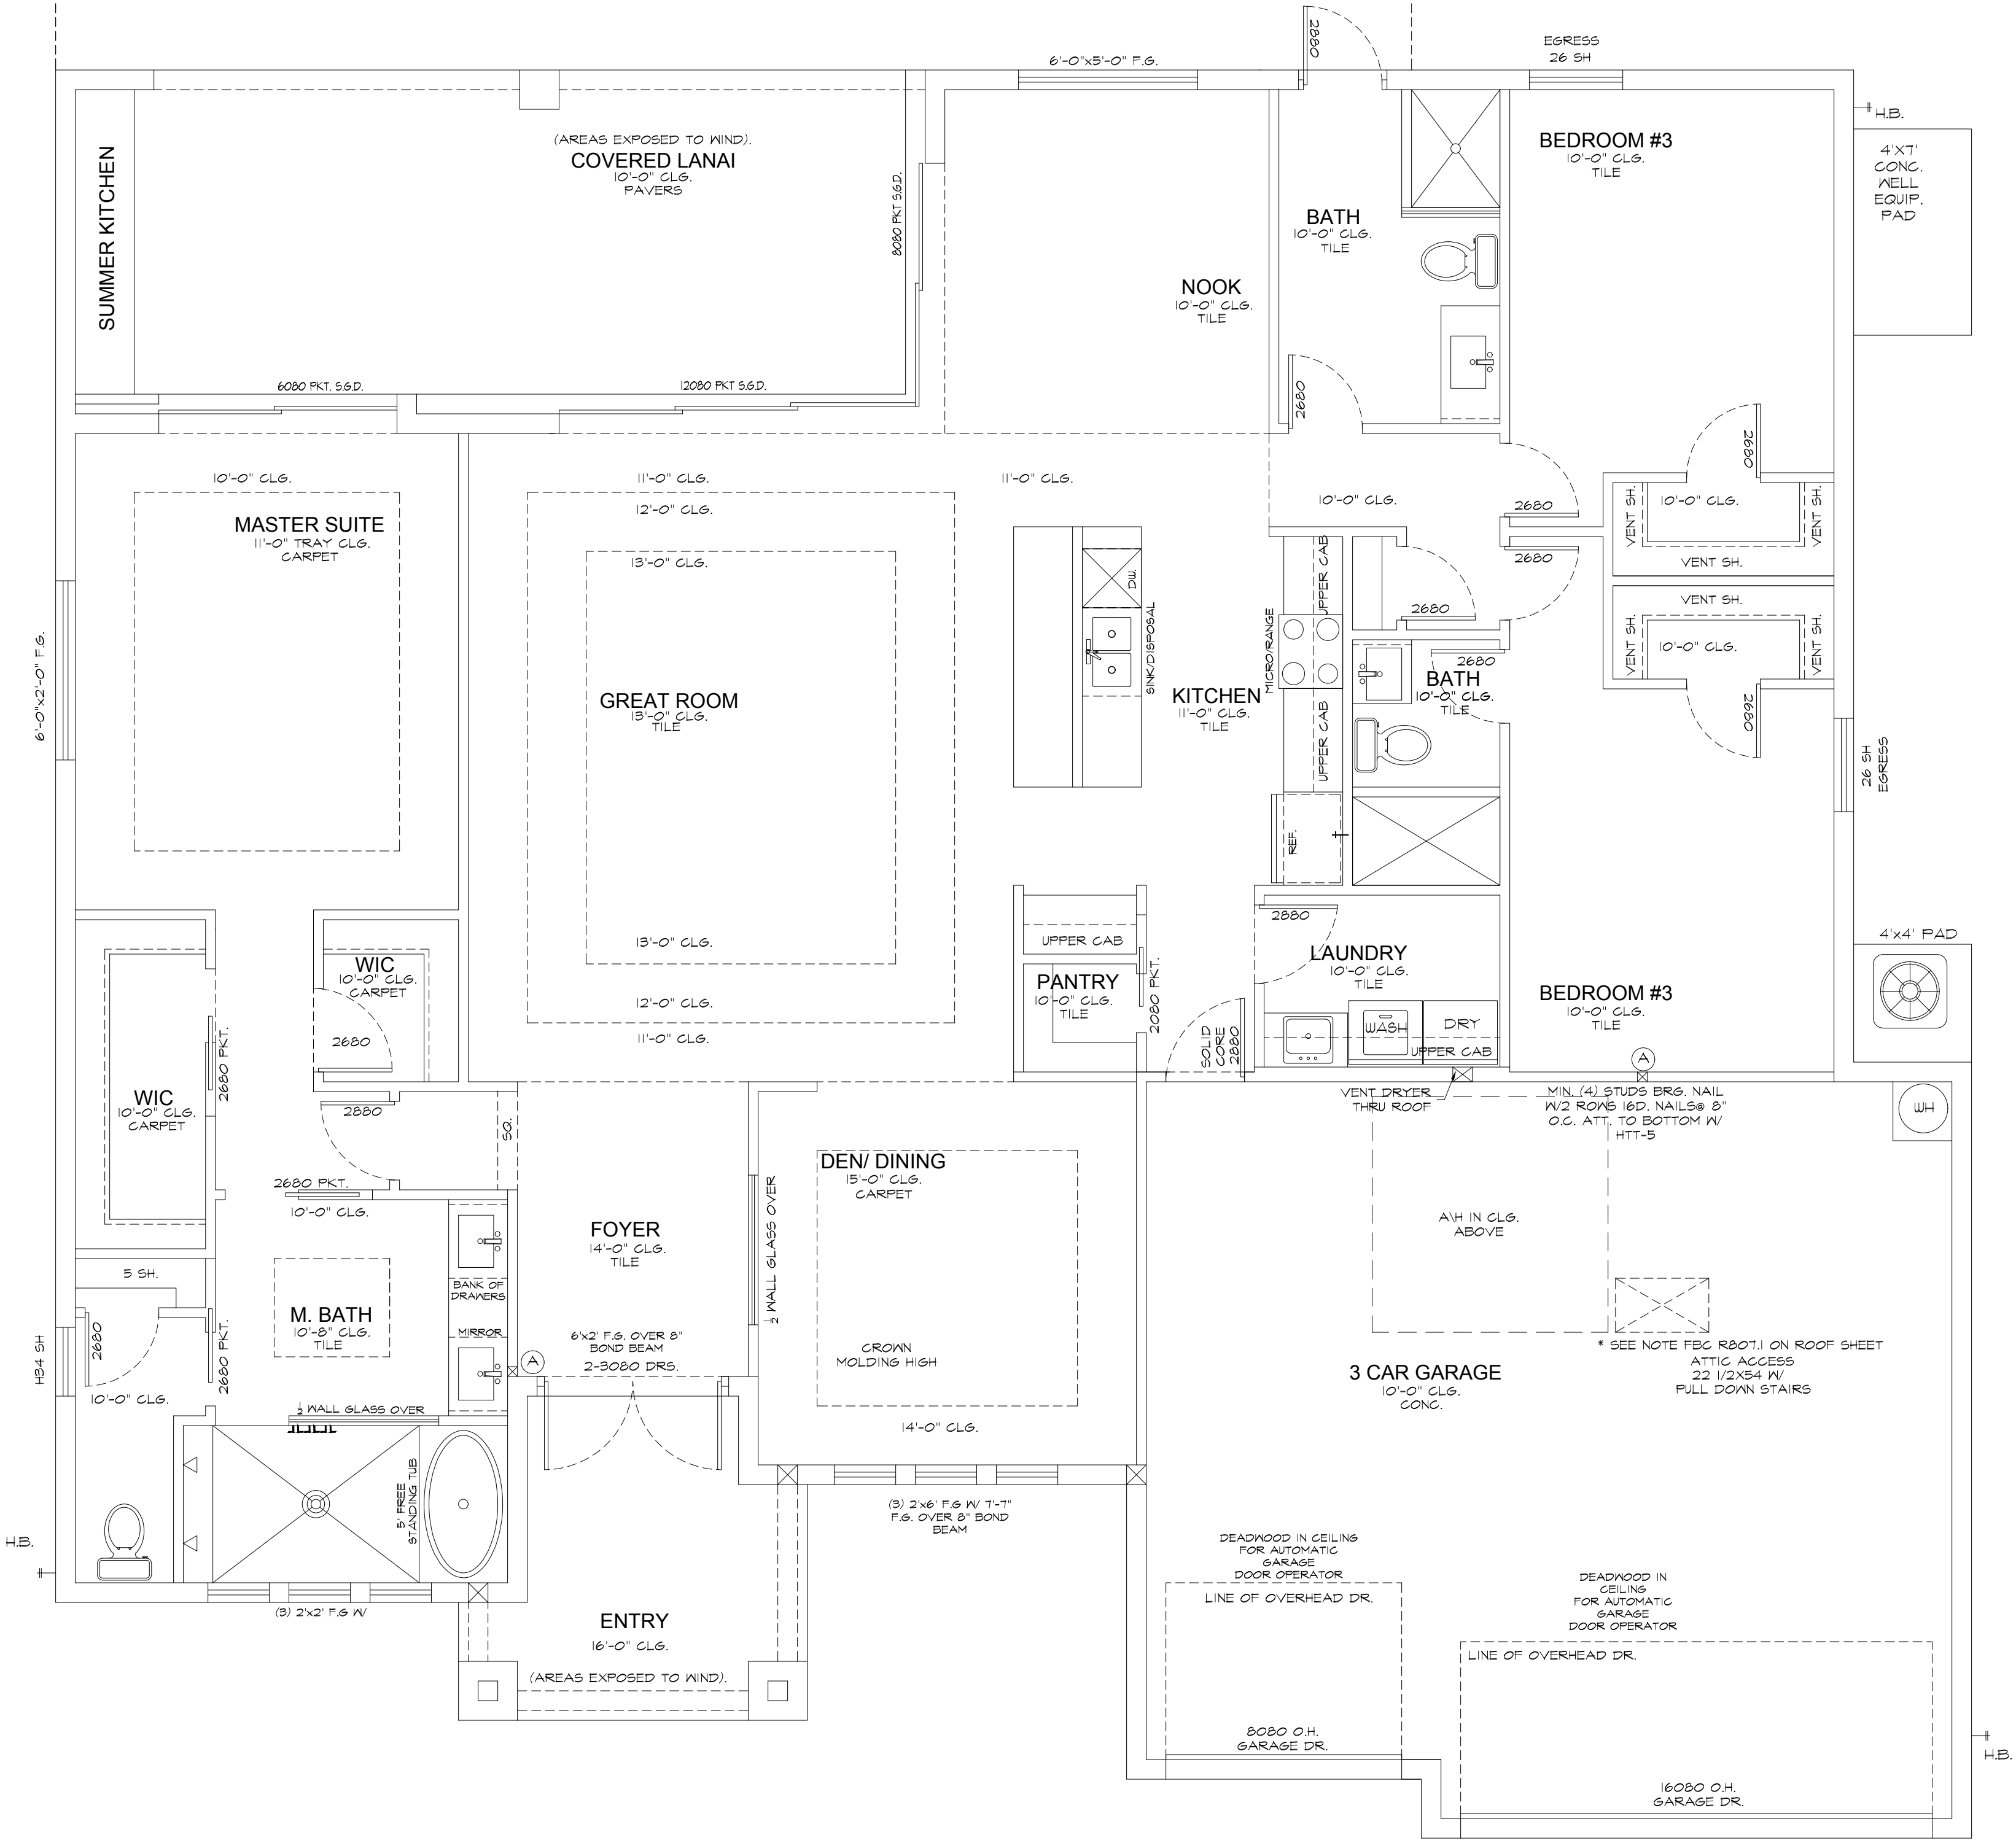

GENERAL PLAN NOTES

ALL CEILING HEIGHTS PER SECTION AND ELEVATION PLATE HEIGHTS, UNO.

ALL INTERIOR DOORS TO BE HOLLOW CORE 1 3/8" THICK, UNO. (REFER TO PLAN FOR SIZE)

ALL GARAGE SERVICE DOORS TO BE HOLLOW CORE 1 3/8" THICK EXTERIOR GRADE (REFER TO PLAN FOR SIZE)


ALL HOUSE TO GARAGE DOORS TO BE SOLID CORE 1 3/8" THICK W/SELF CLOSER AND TIGHT FITTINGS (REFER TO PLAN FOR SIZE)

ALL ENTRY DOORS AND EXTERIOR FRENCH DOORS TO BE SOLID CORE 1 3/4" THICK (REFER TO PLAN FOR SIZE)

ALL FLOOR MATERIAL CHANGES TO OCCUR AT CENTER OF DOOR JAMBS, UNO.

PROVIDE AS REQUIRED: GUARDRAILS PER FBC 1026.5 AND HANDRAIL PER FBC 10013.

ALL HALLWAYS TILE. UNO.

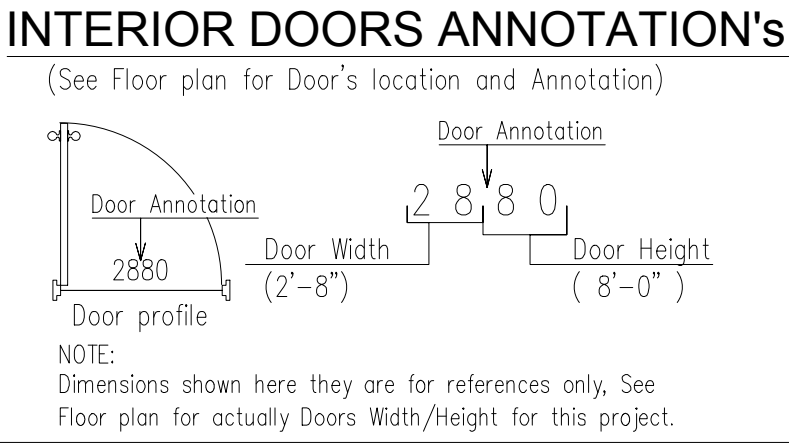

PRODUCT APPROVALS FBC 2020				
VERSION:7th Edition				
12/1/23				
FL#	PRODUCT	MANUFACTURER	CATEGORY	EXP.
FL#	26942-R4 (.2)	MR. GLASS DOOR & WINDOWS	EXTERIOR DR	08/27/2025
FL#	27000-R2 (.1)	MR. GLASS DOOR & WINDOWS	SHOREFRONT	08/27/2025
FL#	38057-R3 (.2)	MR. GLASS DOOR & WINDOWS	SLIDING GLASS DOOR	08/27/2025
FL#	20352-R3 (.2)	MR. GLASS DOOR & WINDOWS	SH WINDOWS	08/27/2025
FL#	37319-R1 (.1)	MR. GLASS DOOR & WINDOWS	FIXED WINDOWS	08/27/2025
FL#	20359-R4 (.2)	MR. GLASS DOOR & WINDOWS	HORIZONTAL SLIDER	08/27/2025
FL#	12194-R13 (.2)	AMERICAN COILS INC.	SOFFIT	06/19/2025
FL#	15012-R10 (.20)	CHI OVER HEAD	GARAGE DOOR	12/31/2038
SHINGLE ROOF:				
FL#	18355-R11	TAMKO BUILDING PRODUCTS	ASPHALT SHINGLES	06/01/2026
FL#	5259-R41	POLYGLASS USA.	ROOF UNDERLAYMENT	12/04/2026
FL#	16918-R3 (.1)	TAMCO / L.V. THOMPSON	OFF-RIDGE VENT W/ BAFFLE	09/09/2026
TOP ROOF HEIGHT:		18'-8"	FEET	APPLICABLE CODES: THE PROJECT MUST COMPLY WITH 2023 FLORIDA BUILDING CODE OCCUPANCY: <input checked="" type="checkbox"/> R3 CONSTRUCTION TYPE: <input type="checkbox"/> VI - UNPROTECTED <input checked="" type="checkbox"/> VI - PROTECTED
MEAN ROOF HEIGHT:		14'-8"	FEET	
DESIGN WIND VELOCITY:		160	MPH	
PROJECT DESCRIPTION: 1 STORY SINGLE FAMILY RESIDENTIAL PLAN W/ 1 ELEVATION TYPES.				

TABLE R 301.2.13 WIND SPEED CONVERSIONS											
V _{ULT}	100	110	120	130	140	150	160	170	180	190	200
V _{ASD}	78	85	93	101	108	116	124	132	139	147	155
FOR S1: 1 MILE PER HOUR = 0.447 M/S B= V _{ASD} = NOMINAL DESIGN WIND SPEED C= V _{ULT} = ULTIMATE DESIGN WIND SPEED DETERMINED FROM FIGURES 1609A, 1609B, 1609C											

WIND LOAD SCHEDULE				
SCHEDULE OF COMPONENTS AND CLADDING LOADS				
ZONE	ZONE DESCRIPTION	TRIBUTARY AREA (SF)	IN(PRESSURE) (+ PSF)	OUT(PRESSURE) (+ PSF)
1	ROOF INTERIOR ZONE	LESS THAN 20	28.6	31.2
		20 - 100	27.8	29.9
		MORE THAN 100	25.9	25.9
2	ROOF, EDGE ZONE	LESS THAN 20	28.6	36.5
		20 - 100	27.8	34.6
		MORE THAN 100	25.9	31.2
3	ROOF, CORNER ZONE	LESS THAN 20	28.6	57.6
		20 - 100	27.8	55.8
		MORE THAN 100	25.9	52.3
4	WALL, INTERIOR ZONE	LESS THAN 20	31.2	33.8
		20 - 100	29.9	32.5
		MORE THAN 100	26.4	29.6
5	WALL, EDGE ZONE	LESS THAN 20	31.2	41.8
		20 - 100	29.9	39.1
		MORE THAN 100	26.4	32.5

NOTE: WIND PRESSURES SHOWN ARE BASED ON V_{asd}

CODE =	ASCE 7-22
ULTIMATE WIND SPEED V _{ult} =	160 MPH
ALLOWABLE WIND SPEED V _{asd} =	124 MPH
RISK CATEGORY =	II
WIND SPEED MAP =	1609A
EXPOSURE =	C
ENCLOSURE CLASSIFICATION =	ENCLOSED
INTERNAL PRESSURE COEFFICIENT (C _{pi}) =	±0.18
α =	6.0 FT
2α =	12.0 FT

POSTS SCHEDULE :	
(A)	MIN. (4) STUDS BEARING NAIL W/ 2 ROWS 16d. NAILS @ 8" O.C. ATT. TO BOTTOM HTT-5
(B)	MIN. (3) STUDS BEARING NAIL W/ 2 ROWS 16d. NAILS @ 8" O.C. ATT. TO BOTTOM LTT-20B


This item has been digitally signed and sealed by Matthew F. Giordano, P.E. on 05/29/2024.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

M.F. GIORDANO
ENGINEERING, PLLC

CONTACT: MATTHEW GIORDANO, P.E.
PHONE: (347) 264-5891
FL P.E. #87672; STATE REGISTRY # 34011
ADDRESS: 1222 SE 47TH ST.
CAPE CORAL, FL. 33904


STAMPED FOR
STRUCTURAL ONLY

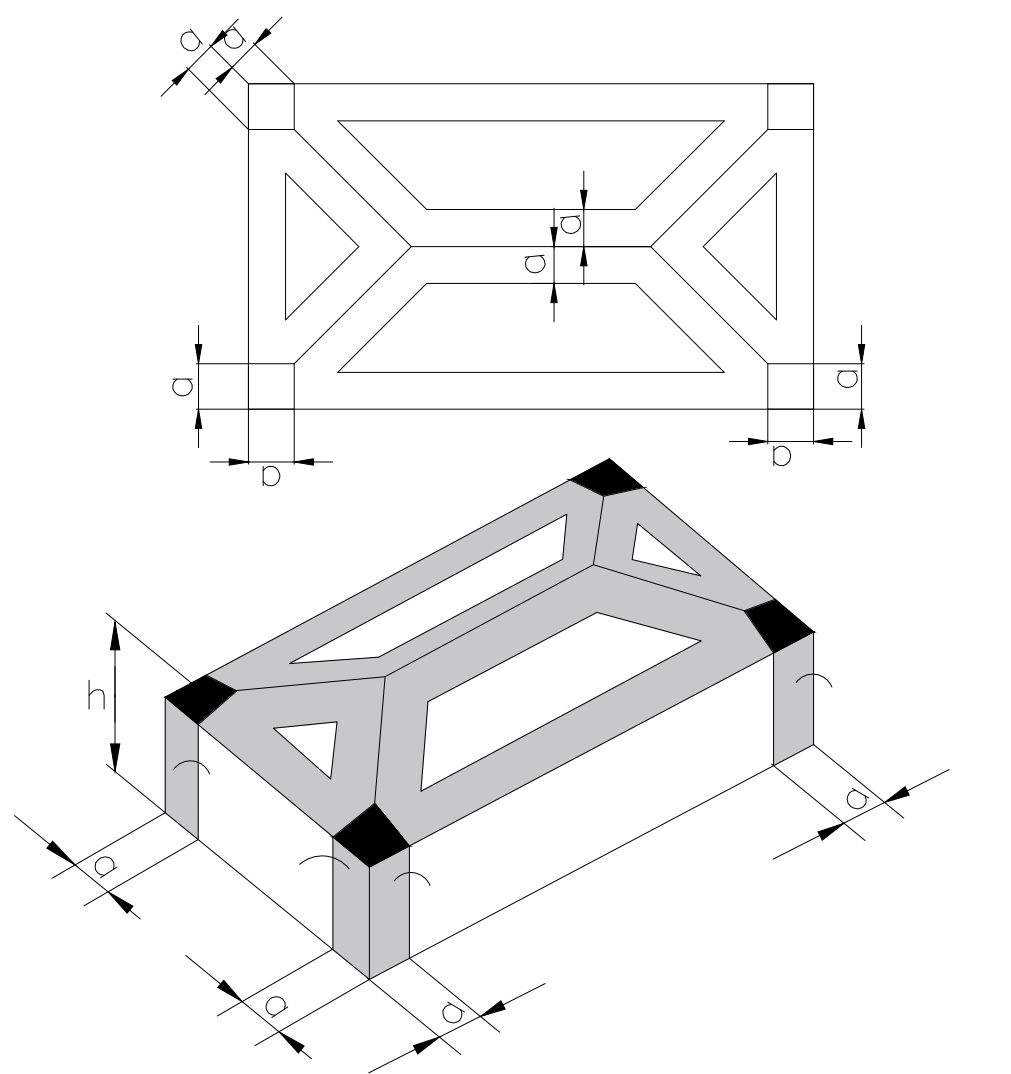

CHECKED BY: H.L.C. DRAWN BY: H.C.					
1	12/27/2024	00000000			
2					
3					
4					
5					
6					

DISCLOSURE: THESE DRAWINGS OR SPECIFICATIONS ARE THE PROPERTY OF CRESPO DESIGN GROUP, INC. THE CONTRACTOR AND/OR OWNER SHALL WITHIN 10 DAYS AFTER RECEIPT OF THESE DRAWINGS AND PRIOR TO CONSTRUCTION NOTIFY THE ENGINEER/ARCHITECT OF ANY CHANGES OR OMISSIONS OR BE HELD JOINTLY RESPONSIBLE FOR THE RESULT AND ERRORS OR RECTIFYING THE SAME. ENGINEER OF RECORD AND CRESPO DESIGN AND CONSTRUCTION OR REVIEW OF SHOP DRAWINGS. THE CONTRACTOR AND/OR SUBCONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND MAINTAIN LIABILITY TO ENGINEER/ARCHITECT OF RECORD AND CRESPO DESIGN AND CONSTRUCTION FOR THESE PLANS.

CRESPO
DESIGN & DRAFTING
11644 STONECREEK CIR.
FORT MYERS, FL 33913
Cell: 239.465.9530
design.crespo@gmail.com
WWW.CRESPODESIGN.NET

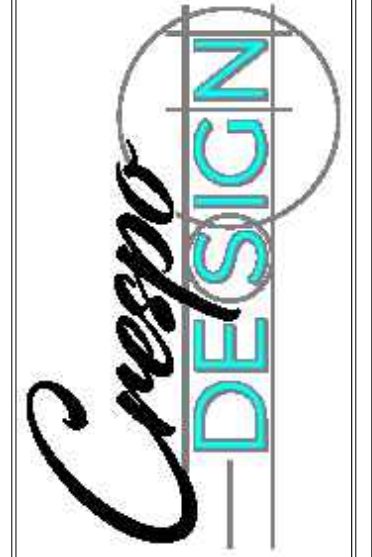





















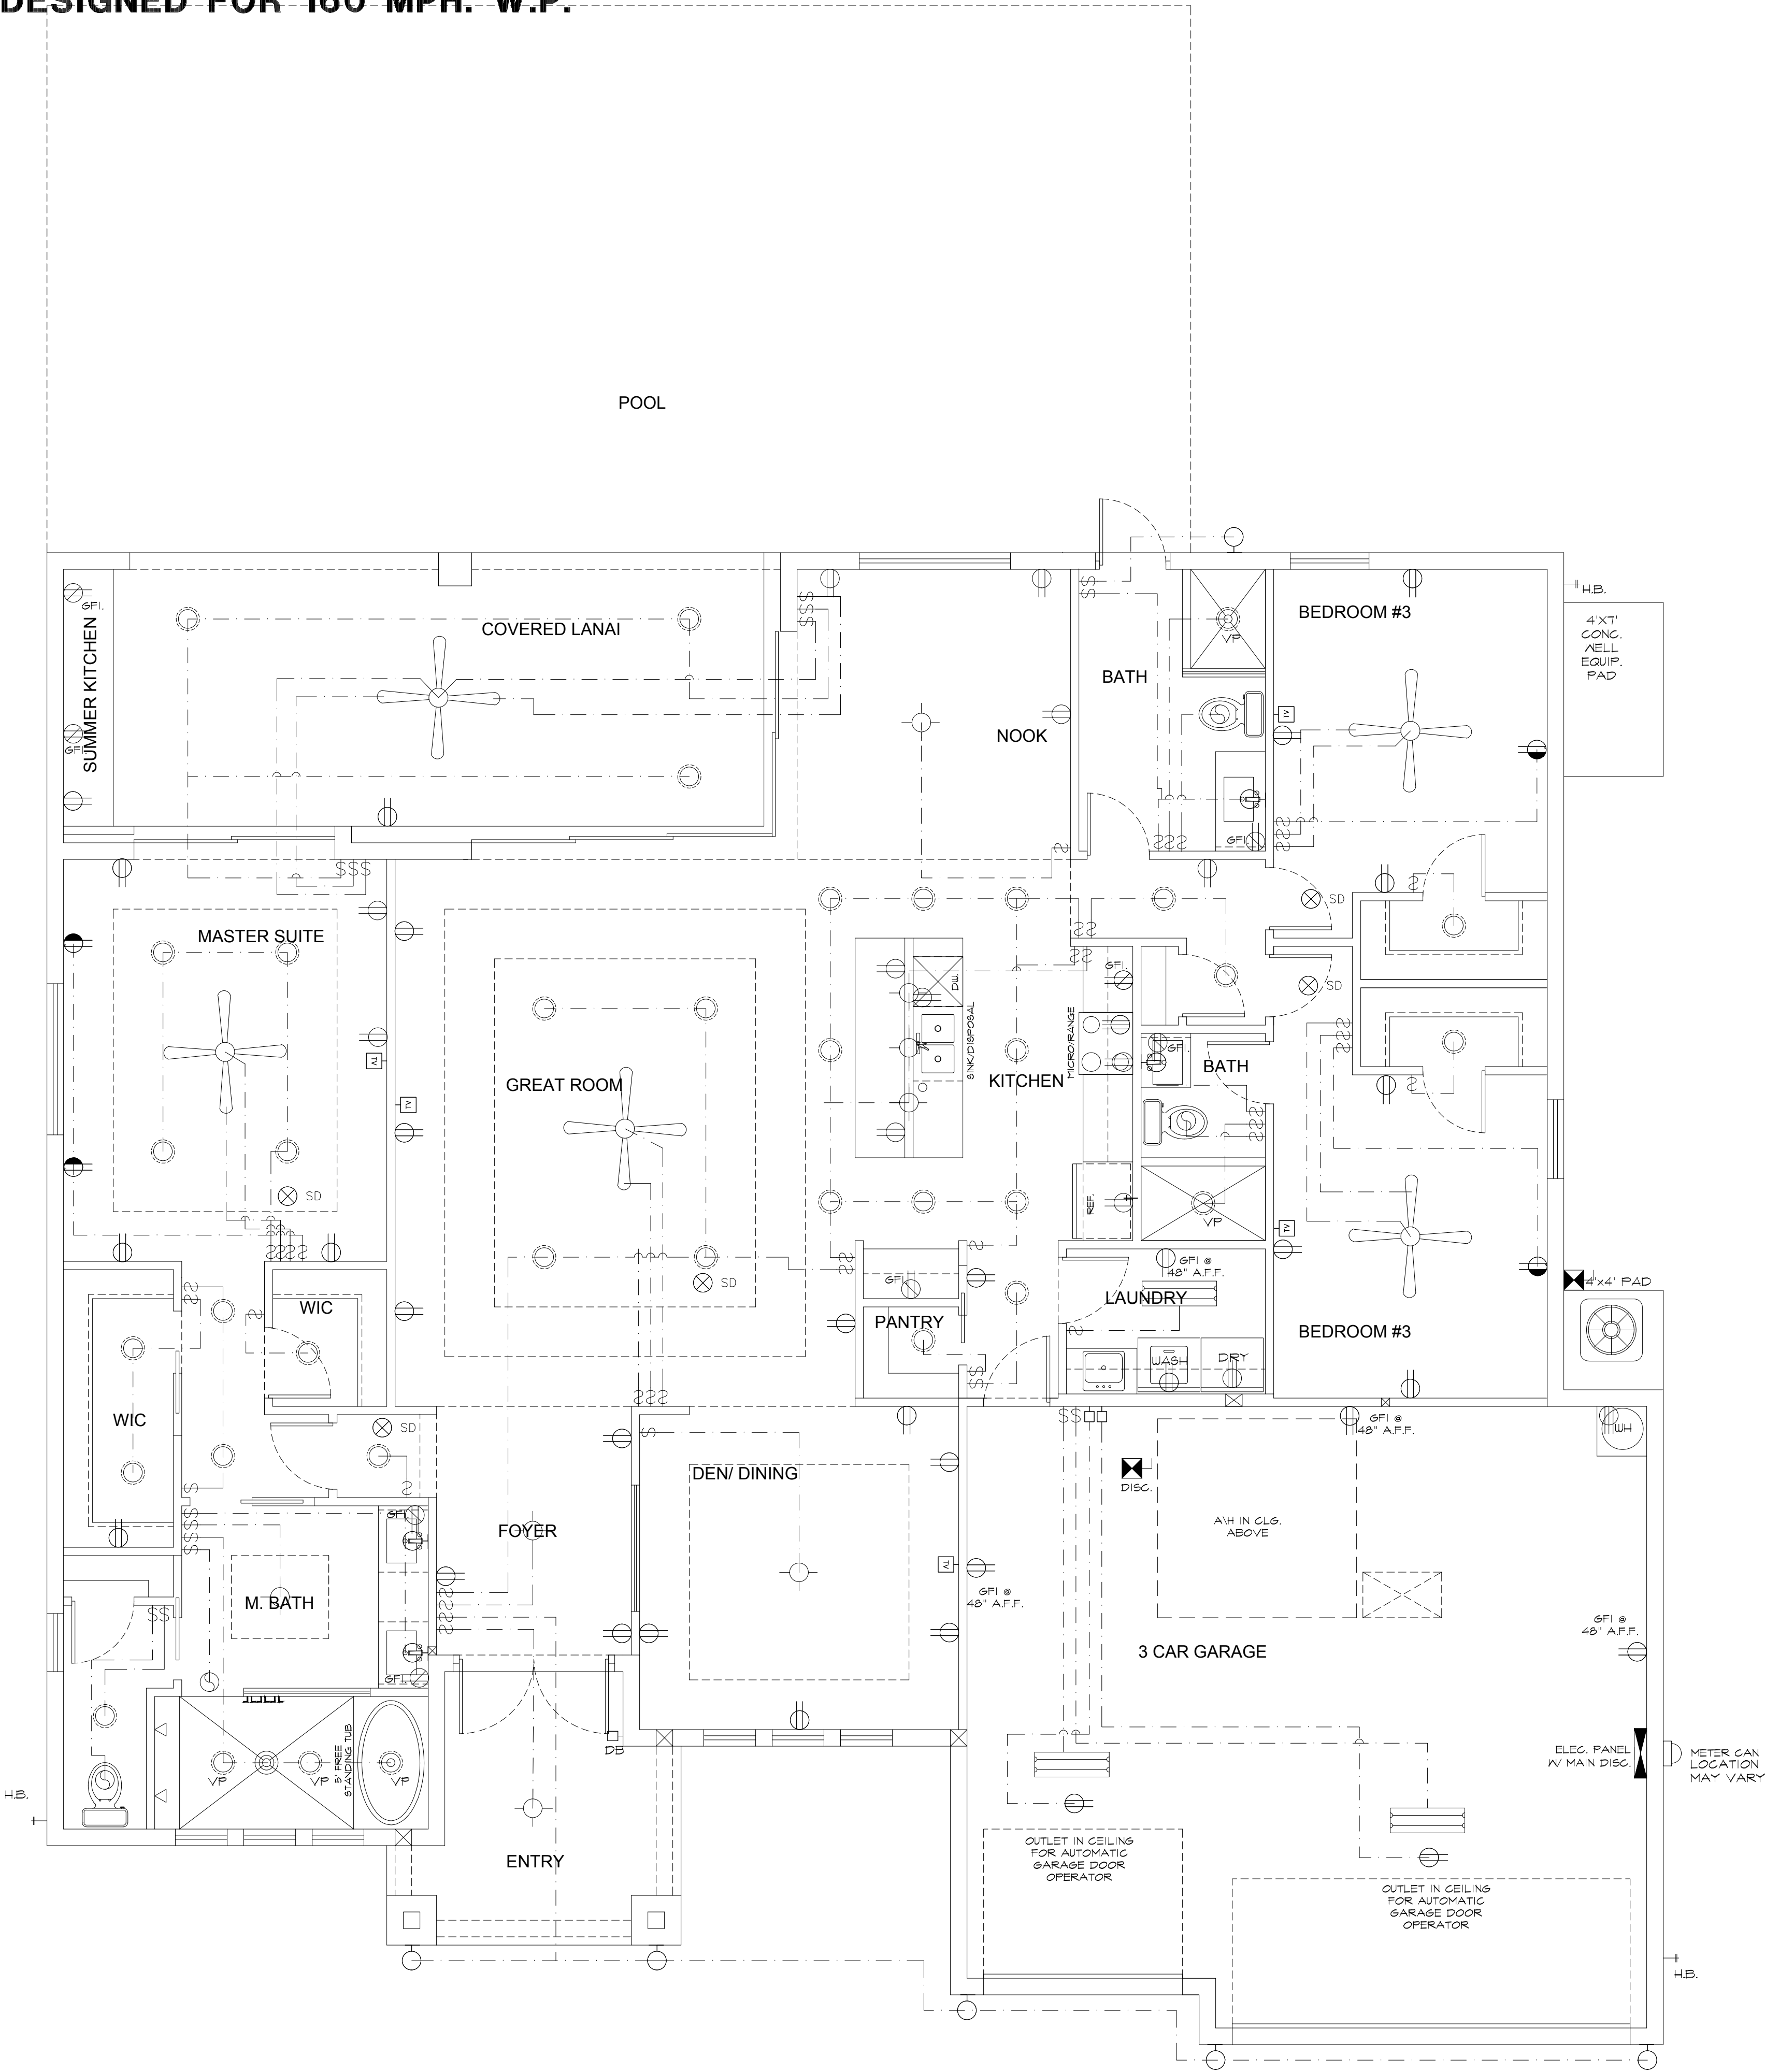

















'MODEL'
'RH'
RESIDENCE: SPEC HOME
LEGAL: UNIT: .BLK. .LOT:
ADDRESS: 23 Tournament Road
SUBDIVISION: Rotonda WEST
COUNTY: LEE
STAMP#

SFH
Development

SCALE: 1/4" = 1'-0"

FLOOR PLAN
3-B





ELECTRICAL LEGEND			
	4-PLEX RECEPTACLE OUTLET		ELECTRICAL METER
	DUPLEX RECEPTACLE OUTLET		ELECTRICAL PANEL
	1/2 SWITCHED DUPLEX OUTLET		SURFACE MOUNTED CEILING LIGHT
	DUPLEX RECEPTACLE OUTLET ABOVE COUNTER TOP & F.I.		RECESSED LIGHT
	220 V RECEPTACLE OUTLET		SMOKE/CARBON MONOXIDE DETECTOR
	DUPLEX RECEPTACLE @ ELEV. A.F.F.		TELEVISION SIGNAL OUTLET
	SINGLE RECEPTACLE OUTLET		EXHAUST FAN
	120 V JUNCTION BOX		TELEPHONE OUTLET
	WALL MTD. BRACKET LIGHT		INTERCOM
	TRACK MTD. LIGHTS		SPEAKER PRE-WIRE
	A/C DISCONNECT		KEY PAD
	DUPLEX FLOOD LIGHT		PUSH BUTTON
	TIMER SWITCH		PLANT SHELF OUTLET-LIGHT
	6FI SWITCH		EYEBALL LIGHT
	DIMMER SWITCH		MOTION DETECTOR
	3 WAY SWITCH		POOL SECURITY EXIT BUTTON
	SINGLE POLE SWITCH		FLUORESCENT 2 BULB LIGHT
	JB FOR ALARM		CEILING FAN
	DOOR BELL CHIME		
			1/1/24

ELECTRICAL NOTES: 1/1/24

- ALL CIRCUITS OTHER THAN GFI THAT SUPPLY 125-VOLT SINGLE PHASE 15 AND 20 AMPERE RECEPTACLE OUTLETS SHALL BE PROTECTED BY AN ARC-FAULT CIRCUIT INTERRUPTER. ALL 125-VOLT SINGLE PHASE 15 AND 20 AMPERE RECEPTACLE OUTLETS SHALL BE TAMPER RESISTANT.
- A LIGHTING FIXTURE WITH RECEPTACLE OUTLET, CONTROLLED BY A SWITCH LOCATED AT THE PASSAGEWAY OPENING SHALL BE PROVIDED SO AS TO LIGHT THE PASSAGEWAY AND SERVICE AREA AND INSTALLED IN ACCORDANCE WITH CHAPTER 33 OF THE 2020 FLORIDA MECHANICAL CODE.
- SMOKE DETECTORS SHALL BE INSTALLED AS PER FBC, RUM AND NFPA TO CHAPTER 2 2111. SMOKE DETECTORS SHALL BE LINE VOLTAGE W/ BATTERY BACK-UP TO BE INSTALLED INSIDE EACH SLEEPING ROOM AND IN THE IMMEDIATE OUTSIDE AREA OF EACH SLEEPING ROOM.
- AIR-HANDLING UNITS SHALL BE ALLOWED IN ATTICS IF THE FOLLOWING CONDITIONS ARE MET:
 - THE SERVICE PANEL OF THE EQUIPMENT IS LOCATED WITHIN 6 FEET (1829 MM) OF AN ATTIC ACCESS.
 - A DEVICE IS INSTALLED TO ALERT THE OWNER OR SHUT THE UNIT DOWN WHEN THE CONDENSATION DRAIN IS NOT WORKING PROPERLY.
 - THE ATTIC ACCESS OPENING IS OF SUFFICIENT SIZE TO REPLACE THE AIR HANDLER.
 - A NOTICE IS POSTED ON THE ELECTRIC SERVICE PANEL INDICATING TO THE HOMEOWNER THAT THE AIR HANDLER IS LOCATED IN THE ATTIC. SAID NOTICE SHALL BE IN ALL CAPITALS, IN 1/8 POINT TYPE WITH THE TITLE AND FIRST PARAGRAPH IN BOLD.

NOTICE TO HOMEOWNER: A PART OF YOUR AIR CONDITIONING SYSTEM, THE AIR HANDLER, IS LOCATED IN THE ATTIC. FOR PROPER, EFFICIENT AND ECONOMIC OPERATION OF THE AIR CONDITIONING SYSTEM YOU MUST ENSURE THAT REGULAR MAINTENANCE IS PERFORMED. YOUR AIR CONDITIONING SYSTEM IS EQUIPPED WITH ONE OR BOTH OF THE FOLLOWING:

- A DEVICE THAT WILL ALERT YOU WHEN THE CONDENSATION DRAIN IS NOT WORKING PROPERLY OR
- A DEVICE THAT WILL SHUT THE SYSTEM DOWN WHEN THE CONDENSATION DRAIN IS NOT WORKING TO LIMIT POTENTIAL DAMAGE TO YOUR HOME AND TO AVOID DISRUPTION OF SERVICE. IT IS RECOMMENDED THAT YOU ENSURE PROPER WORKING ORDER OF THESE DEVICES BEFORE EACH SEASON OF PEAK OPERATION.

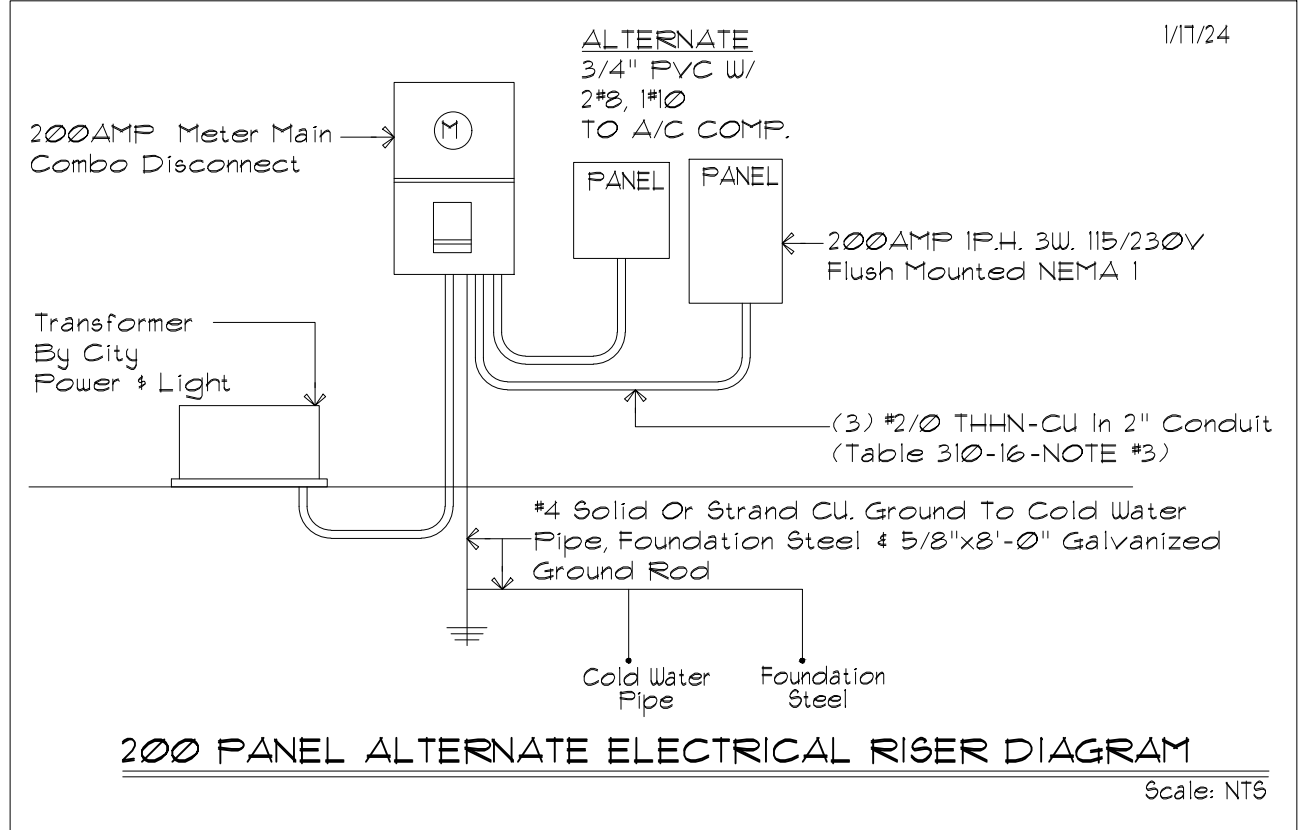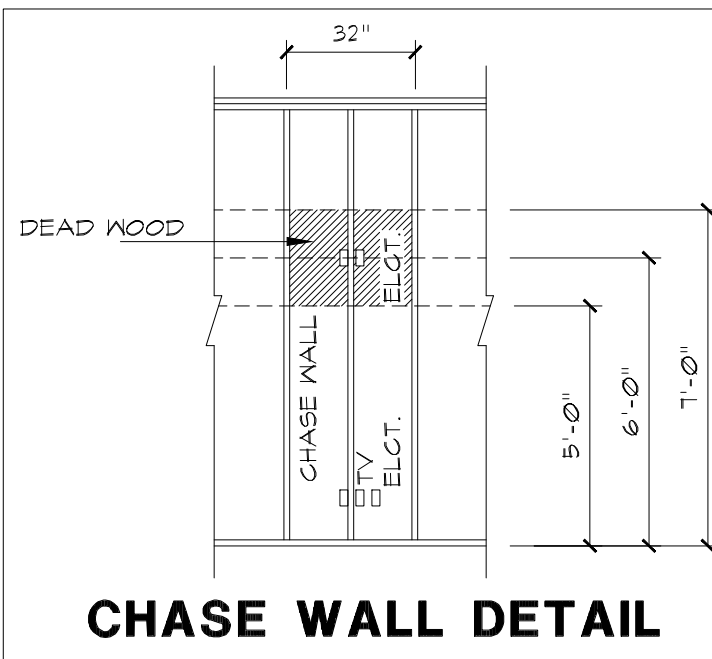

M.F. GIORDANO
ENGINEERING, PLLC

CONTACT: MATTHEW GIORDANO, P.E.
PHONE: (347) 264-5891
FL P.E. #87672; STATE REGISTRY # 34011
ADDRESS: 1222 SE 47TH ST.
CAPE CORAL, FL. 33904

STAMPED FOR
STRUCTURAL ONLY

MATTHEW F. GIORDANO, P.E.
REG. NO. 87672

CHECKED BY: H.L.C. DRAWN BY: H.C.

1	12/27/2024	00000000
2		
3		
4		
5		
6		

CRESPO
DESIGN & DRAFTING
11644 STONECREEK CIR.
FORT MYERS, FL 33913
Cell: 239.465.9530
design@crespodesign.net
www.crespodesign.net

Crespo
DESIGN

'MODEL' 'RH'


RESIDENCE: SPEC HOME
LEGAL UNIT: .BLK. .LOT.
ADDRESS: 23 Tournament Road
SUBDIVISION: Rotonda WEST
COUNTY: LEE
STAR# 4
CDD #304

SFH
Development

SCALE: 1/4" = 1'-0"



ELECTRICAL PLAN

4

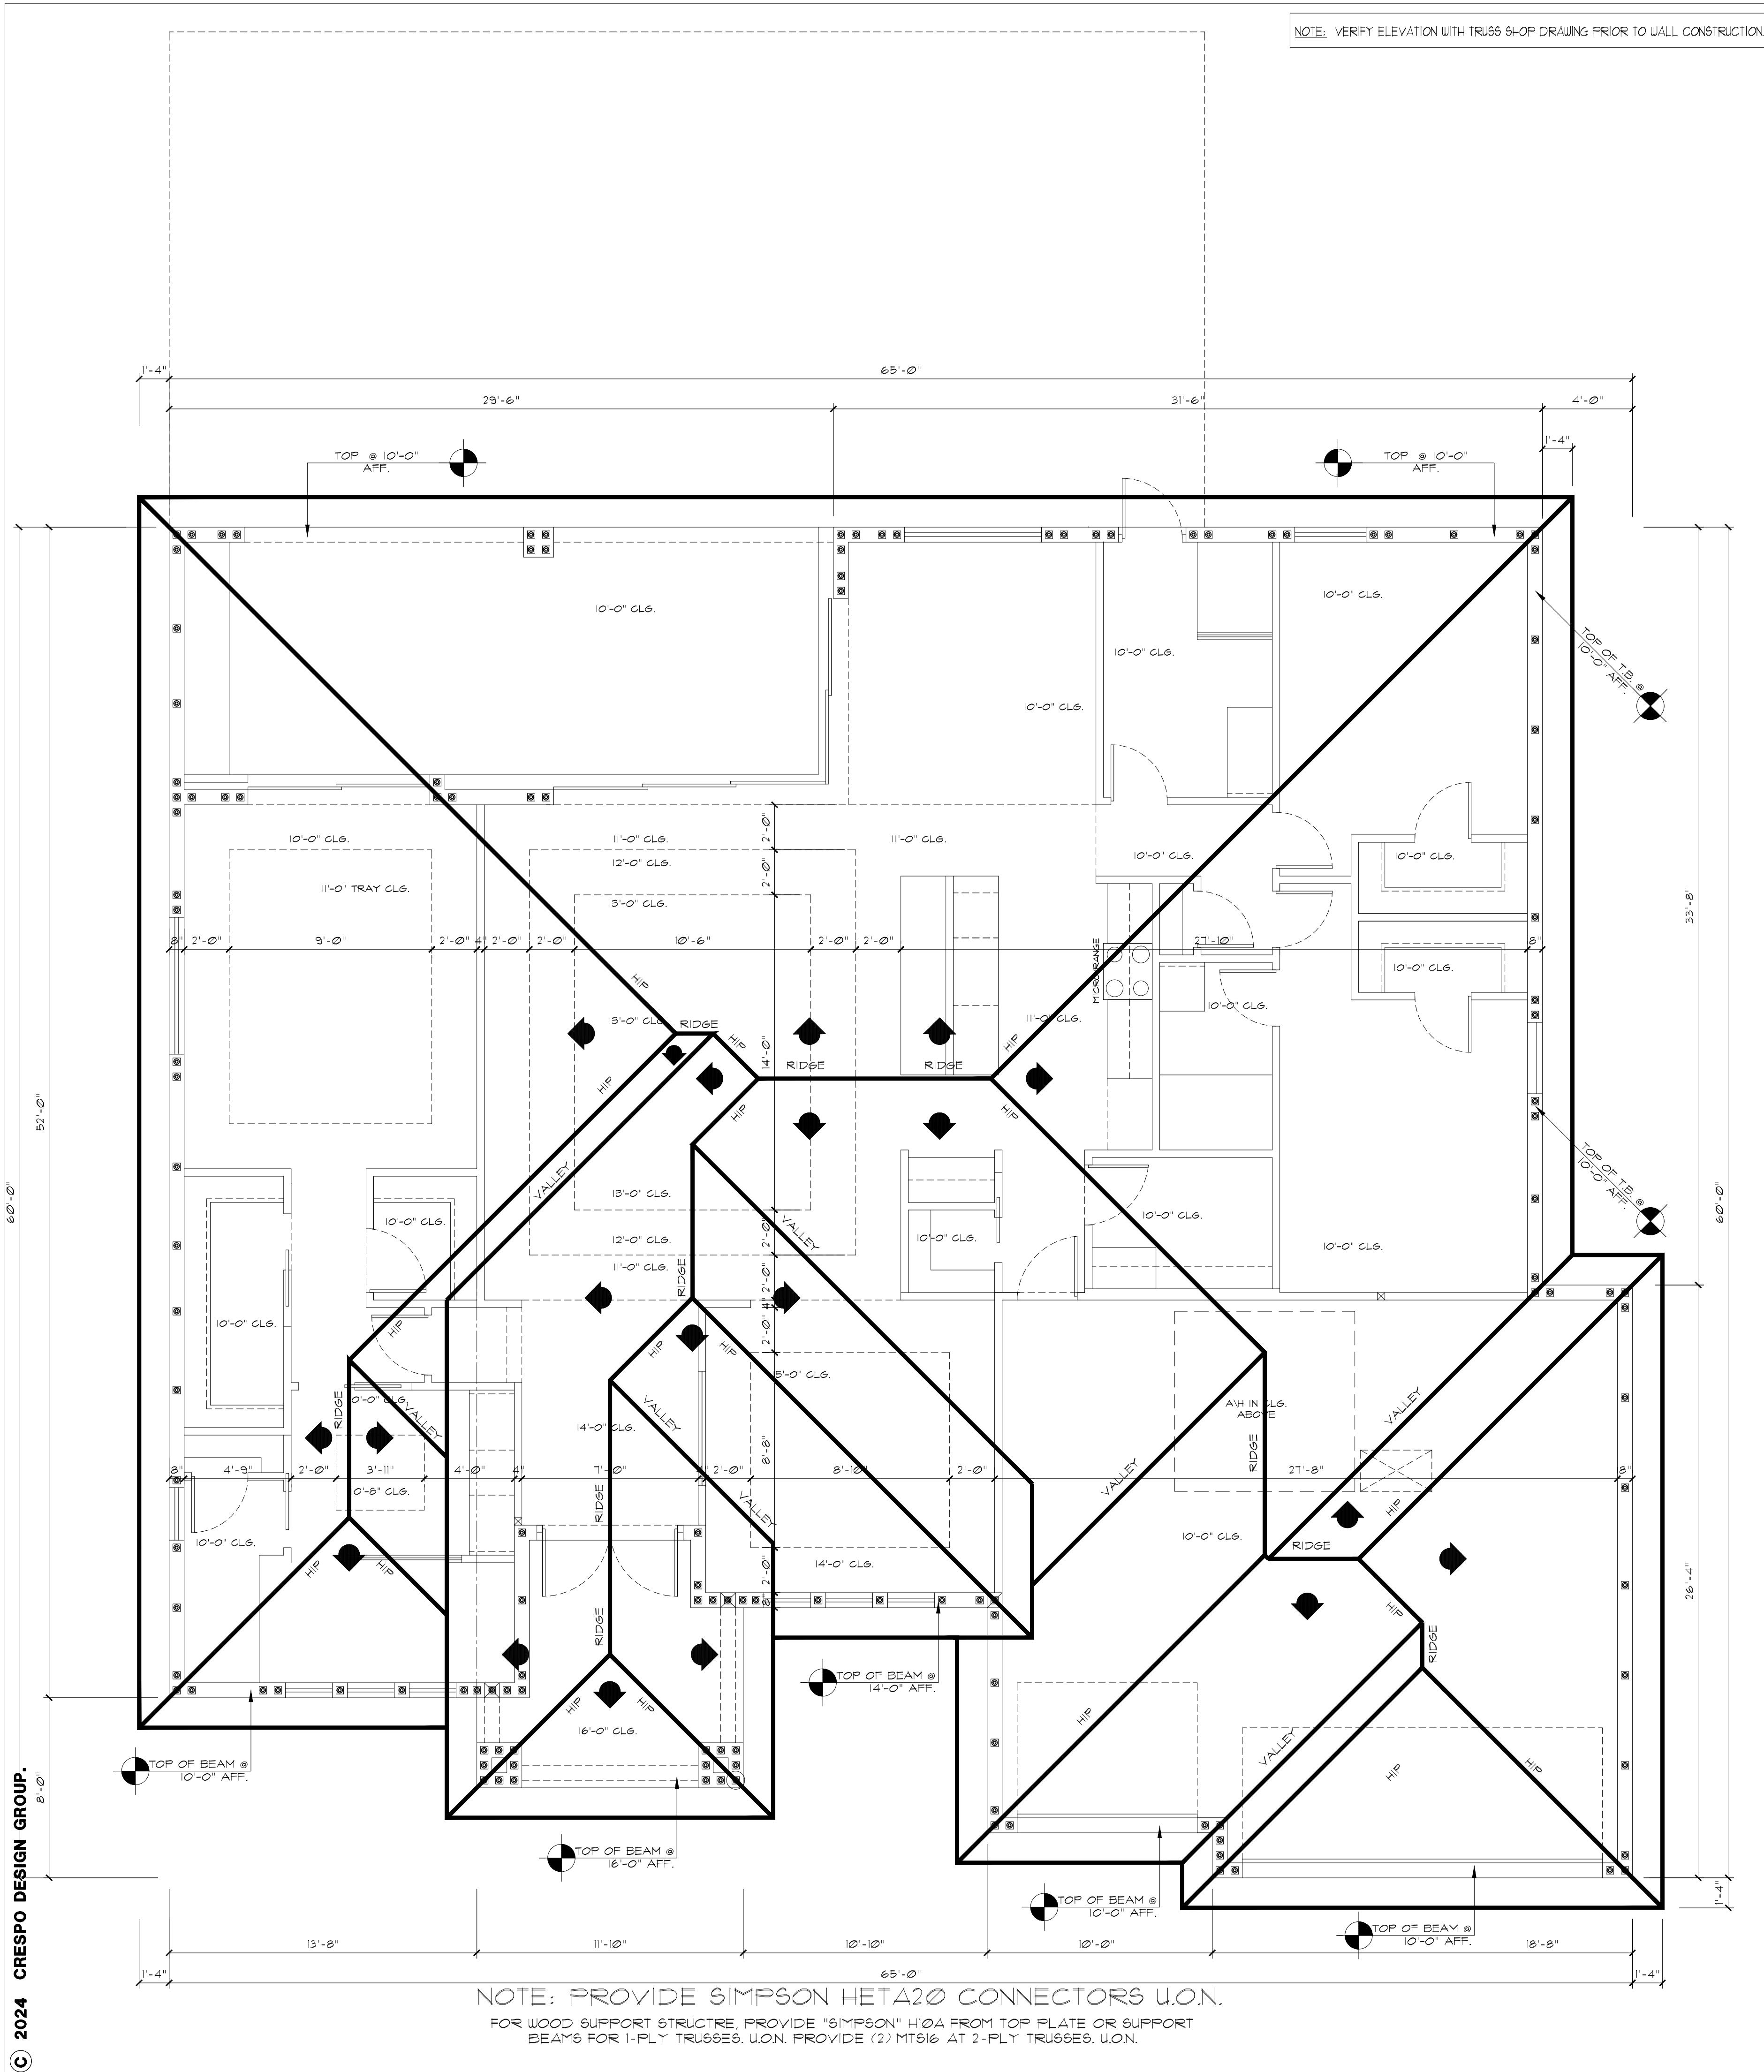

UPLIFT CONNECTOR SCHEDULE			
UPLIFT (LBS)	CONNECTOR	TRUSS PLY	CONNECTION TYPE
0-1412	HETA 20	1,2,3	GIRDER / TRUSS TO MASONRY
1412-1800	DTT2Z	1,2	GIRDER / TRUSS TO MASONRY
1800-3330	MG1	2	GIRDER / TRUSS TO MASONRY
3966-5175	2-VGT	2	GIRDER / TRUSS TO MASONRY
5175-8080	2-FGTR	2	GIRDER / TRUSS TO MASONRY
1412-2365	LG13-SDS2.5	3	GIRDER / TRUSS TO MASONRY
2365-6400	2-VGT	3	GIRDER / TRUSS TO MASONRY
6400-9035	HGT-3	3	GIRDER / TRUSS TO MASONRY
0-1015	H10A	1	GIRDER / TRUSS TO WOOD FRAMING
1015-1560	2-MTS12	1	GIRDER / TRUSS TO WOOD FRAMING
1560-1800	DTT2Z	1	GIRDER / TRUSS TO WOOD FRAMING
0-2315	HTT4	2,3	GIRDER / TRUSS TO WOOD FRAMING
2315-3330	MG1	2,3	GIRDER / TRUSS TO WOOD FRAMING
3330-4375	HTT5	2,3	GIRDER / TRUSS TO WOOD FRAMING
4375-7480	2-HTT5	2,3	GIRDER / TRUSS TO WOOD FRAMING
7480-9035	HGT-3	3	GIRDER / TRUSS TO WOOD FRAMING

NOTE: ALL CONNECTORS LISTED ARE SIMPSON STRONG MODEL NUMBERS. REFER TO MANUFACTURER SPECIFICATIONS FOR VERIFYING LOADS AND PROPER INSTALLATION.

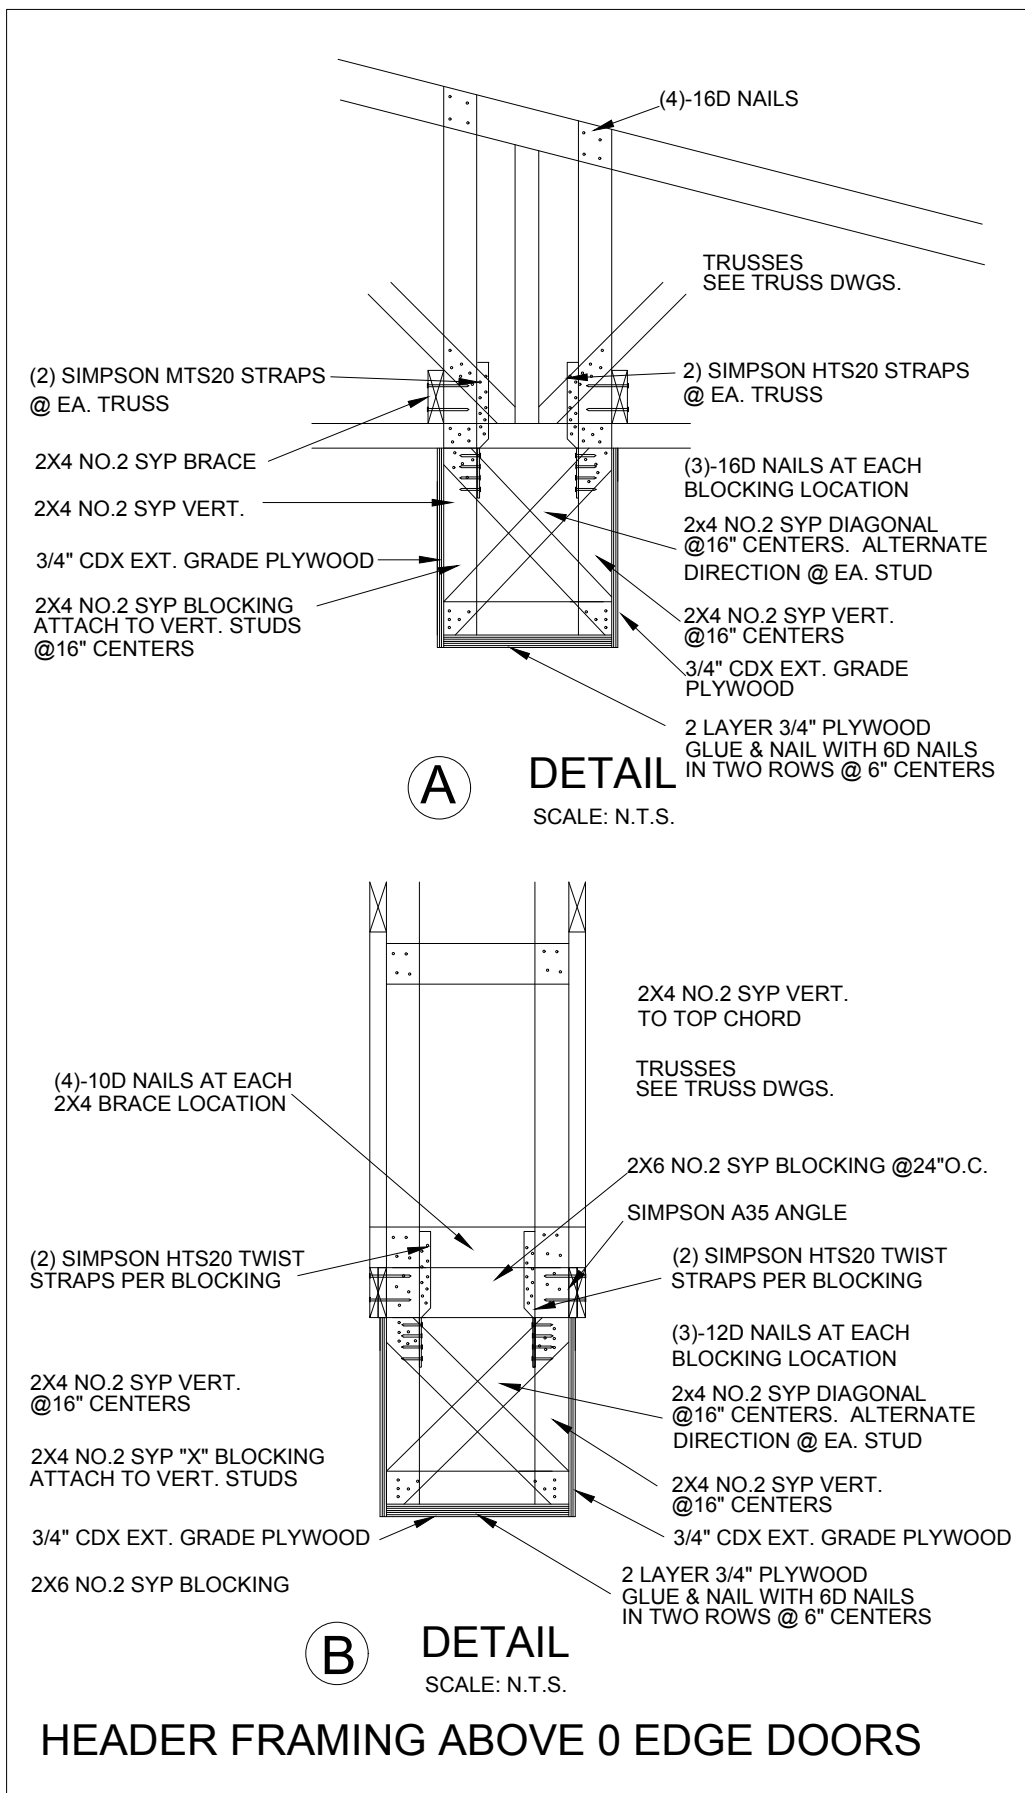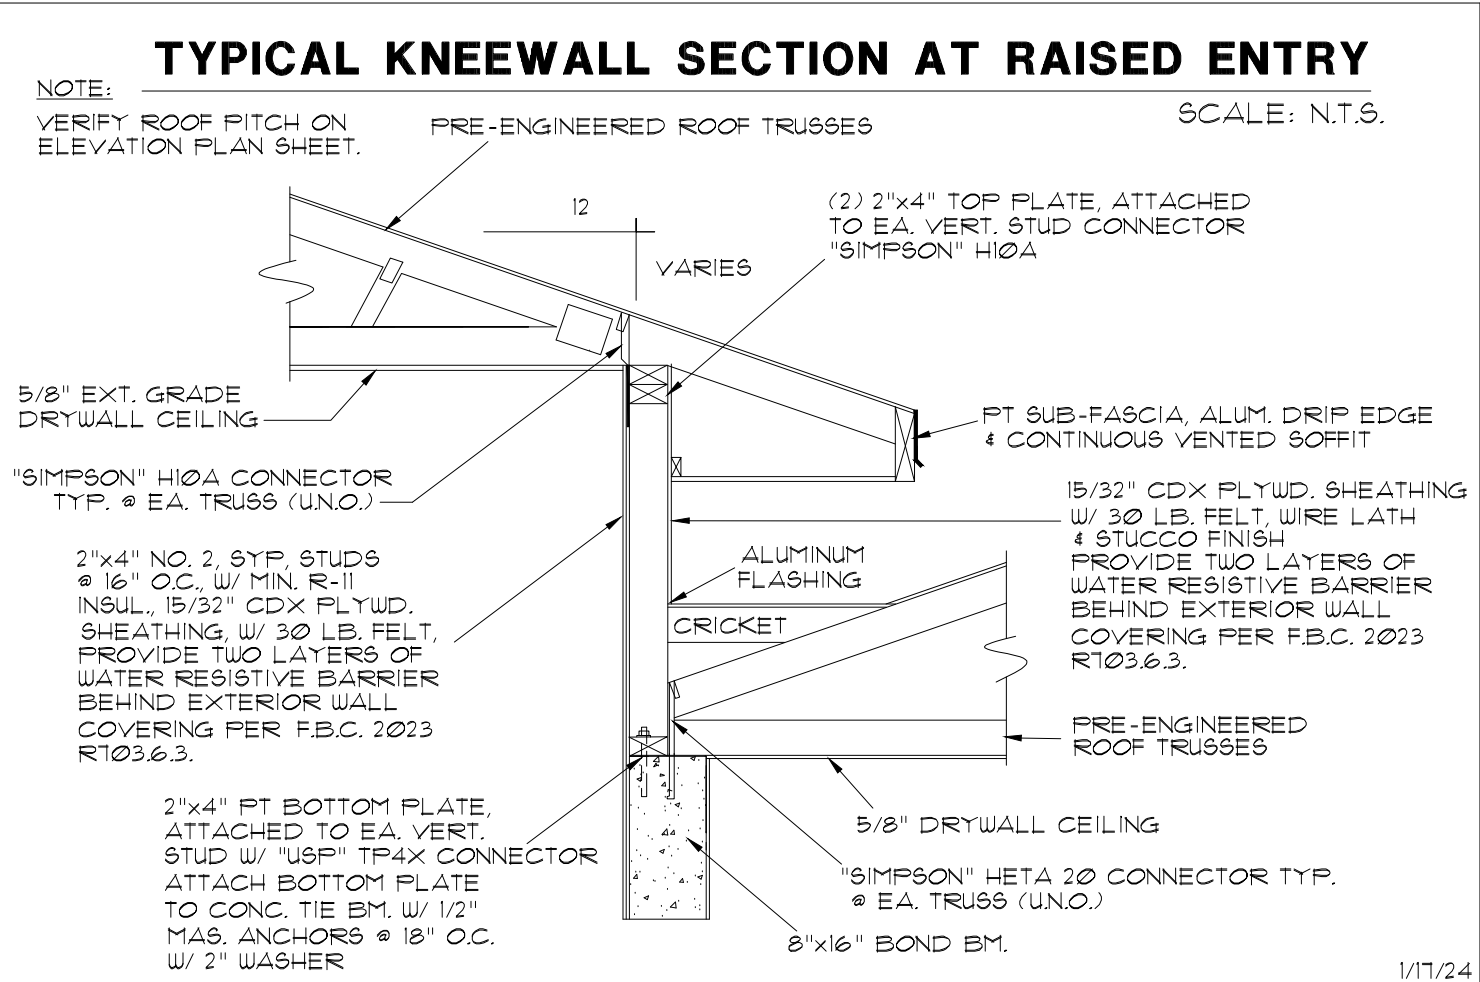

UNDERLAYMENT FOR ASPHALT, METAL, MINERAL SURFACED, SLATE AND SLATE-TYPE ROOF COVERINGS.
UNDERLAYMENT FOR ASPHALT SHINGLES, METAL ROOF SHINGLES, MINERAL SURFACED ROLL ROOFING, SLATE AND SLATE-TYPE SHINGLES, AND METAL ROOF PANELS SHALL COMPLY WITH ONE OF THE FOLLOWING METHODS:

THE ENTIRE ROOF DECK SHALL BE COVERED WITH AN APPROVED SELF-ADHERING POLYMER-MODIFIED BITUMEN UNDERLAYMENT COMPLYING WITH ASTM D910 INSTALLED IN ACCORDANCE WITH BOTH THE UNDERLAYMENT MANUFACTURER'S AND ROOF COVERING MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR THE DECK MATERIAL, ROOF VENTILATION CONFIGURATION AND CLIMATE EXPOSURE FOR THE ROOF COVERING TO BE INSTALLED.


EXCEPTION: AN EXISTING SELF-ADHERING MODIFIED BITUMEN UNDERLAYMENT THAT HAS BEEN PREVIOUSLY INSTALLED OVER THE ROOF DECKING AND WHERE IT IS REQUIRED, RENEAVING OFF THE ROOF SHEATHING IN ACCORDANCE WITH SECTION R902.1) CAN BE CONFIRMED OR VERIFIED. AN APPROVED UNDERLAYMENT IN ACCORDANCE WITH TABLE R903.1(1) FOR THE APPLICABLE ROOF COVERING SHALL BE APPLIED OVER THE ENTIRE ROOF OVER THE EXISTING SELF-ADHERED MODIFIED BITUMEN UNDERLAYMENT.

2.4 MINIMUM 4-INCH-WIDE (102 MM) STRIP OF SELF-ADHERING POLYMER-MODIFIED BITUMEN MEMBRANE COMPLYING WITH ASTM D1970, INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS FOR THE DECK MATERIAL, SHALL BE APPLIED OVER ALL JOINTS IN THE ROOF DECKING. AN APPROVED UNDERLAYMENT IN ACCORDANCE WITH TABLE R905.1.11 FOR THE APPLICABLE ROOF COVERING SHALL BE APPLIED OVER THE ENTIRE ROOF OVER THE 4-INCH-WIDE (102 MM) MEMBRANE STRIPS.

EXCEPTION: A SYNTHETIC UNDERLAYMENT THAT IS APPROVED AS AN ALTERNATIVE TO UNDERLAYMENT COMPLYING WITH ASTM D2326 TYPE II AND HAVING A MINIMUM TEAR STRENGTH OF 5 LBF IN ACCORDANCE WITH ASTM D4533 AND A MINIMUM TENSILE STRENGTH OF 20 LBF/INCH IN ACCORDANCE WITH ASTM D5035 SHALL BE PERMITTED TO BE APPLIED OVER THE ENTIRE ROOF OVER THE 4-INCH-WIDE (102 MM) MEMBRANE STRIPS. THIS UNDERLAYMENT SHALL BE INSTALLED AND ATTACHED IN ACCORDANCE WITH THE UNDERLAYMENT ATTACHMENT METHODS OF TABLE 903.1.1 FOR THE APPLICABLE ROOF COVERING AND SLOPE AND THE UNDERLAYMENT MANUFACTURER'S INSTALLATION INSTRUCTIONS.

3A MINIMUM 3/4-INCH WIDE (19 MM) STRIP OF SELF-ADHERING FLEXIBLE FLASHING TAPE COMPLYING WITH AAMA 711, LEVEL 3 ^{3/4} FOR EXPOSURE UP TO 116°F (80°C), INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS FOR THE DECK MATERIAL, SHALL BE APPLIED OVER ALL JOINTS IN THE ROOF DECKING. AN APPROVED UNDERLAYMENT IN ACCORDANCE WITH TABLE R905.111 FOR THE APPLICABLE ROOF COVERING SHALL BE APPLIED OVER THE ENTIRE ROOF OVER THE 4-INCH-WIDE (102 MM) FLASHING STRIPS.

EXCEPTION: A SYNTHETIC UNDERLAYMENT THAT IS APPROVED AS AN ALTERNATIVE TO UNDERLAYMENT COMPLYING WITH ASTM D218 TYPE II AND HAVING A MINIMUM TEAR STRENGTH OF 5 LBF IN ACCORDANCE WITH ASTM D4533 AND A MINIMUM TENSILE STRENGTH OF 20 LBF/INCH IN ACCORDANCE WITH ASTM D5693 SHALL BE PERMITTED TO BE APPLIED OVER THE ENTIRE ROOF OVER THE 4-INCH-WIDE (101 MM) FLASHING STRIPS. THIS UNDERLAYMENT SHALL BE INSTALLED AND ATTACHED IN ACCORDANCE WITH THE UNDERLAYMENT ATTACHMENT METHODS OF TABLE R905.1 FOR THE APPLICABLE ROOF COVERING AND SLOPE AND THE UNDERLAYMENT MANUFACTURER'S INSTALLATION INSTRUCTIONS.

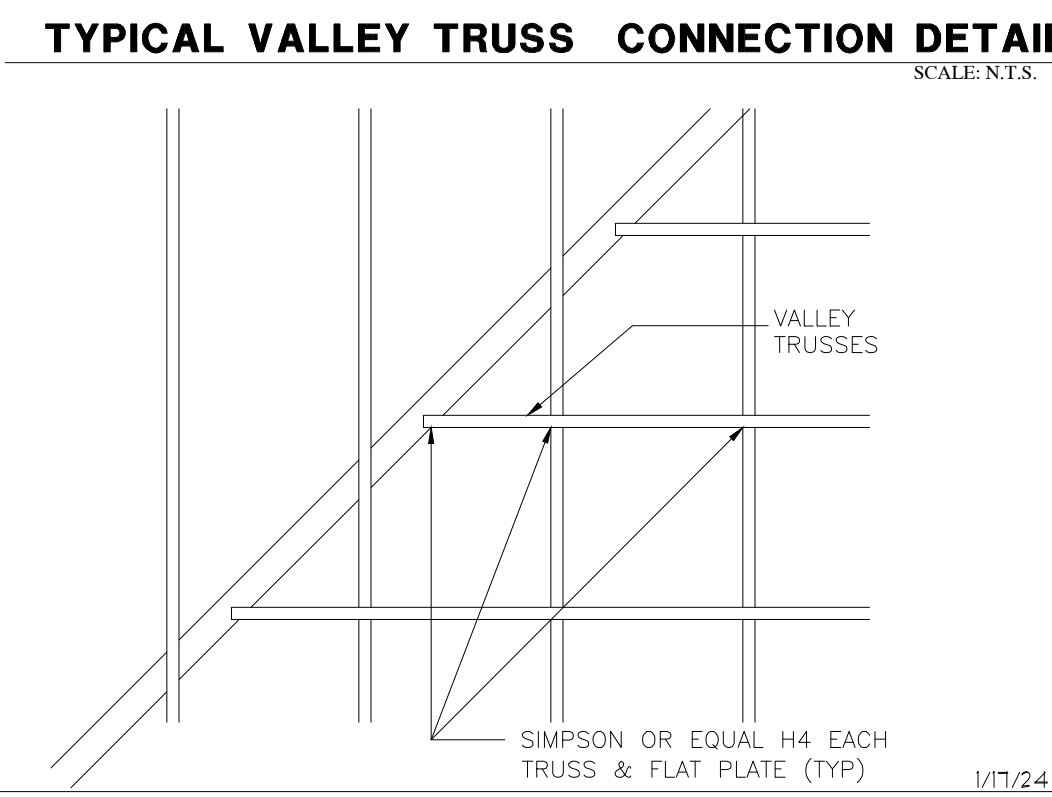[illegible][illegible]

R602.2 Minimum Vent Area. The minimum net free ventilating area shall be $1/50$ of the area of the vented space.

Exception: The minimum net free ventilation area shall be $1/300$ of the vented space provided one or more of the following conditions are met:

- In Climate Zones 6, 7 and 8, a Class I or II vapor retarder is installed on the warm-inward side of the ceiling.
- Not less than 5 percent, and not more than 50 percent of the required ventilating area is provided by ventilators located in the upper portion of the attic or rafter space. Upper ventilators shall be located not more than 3 feet (0.91 m) below the ridge or highest point of the space, measured vertically, with the balance of the required ventilation provided by eave or cornice vents, where the location of wall or roof framing members conflicts with the installation of upper ventilators.
- Not less than 10 percent, and not more than 50 percent of the required ventilation shall be provided by eave or cornice vents, where the location of wall or roof framing members conflicts with the installation of upper ventilators.

ROOF VENT CALCULATIONS:

3820 SQ. FT. OF ROOF AREA


$\frac{3820}{150} = 25.46$ SQ. FT. OF N.F.A. REQUIRED


277 LINEAR FEET OF 16" SOFFIT VENT

277 L.F. x 17.16 S.I. = 5,440 S.I.

$\frac{4753}{144} = 33.00$ SQ. FT. OF N.F.A. PROVIDED

*ALUMINUM SOFFIT = 13.68 PERCENT OF SQ. FT. OF ROOF AREA
* 16" ALUM SOFFIT = 27.29 SQ. IN PER L.F.
* N.F.A. = NET FREE AREA

	<h2 style="text-align: center;">ROOF PLAN NOTES</h2>
	<p>INDICATES ROOF SLOPE AND DIRECTION. U.N.O.</p> <p>ROOF MATERIAL: SHINGLE ROOF</p> <p>16" (INCHES) TYPICAL ROOF OVERHANG AT RAKE, EAVE UNLESS NOTED OTHERWISE</p>

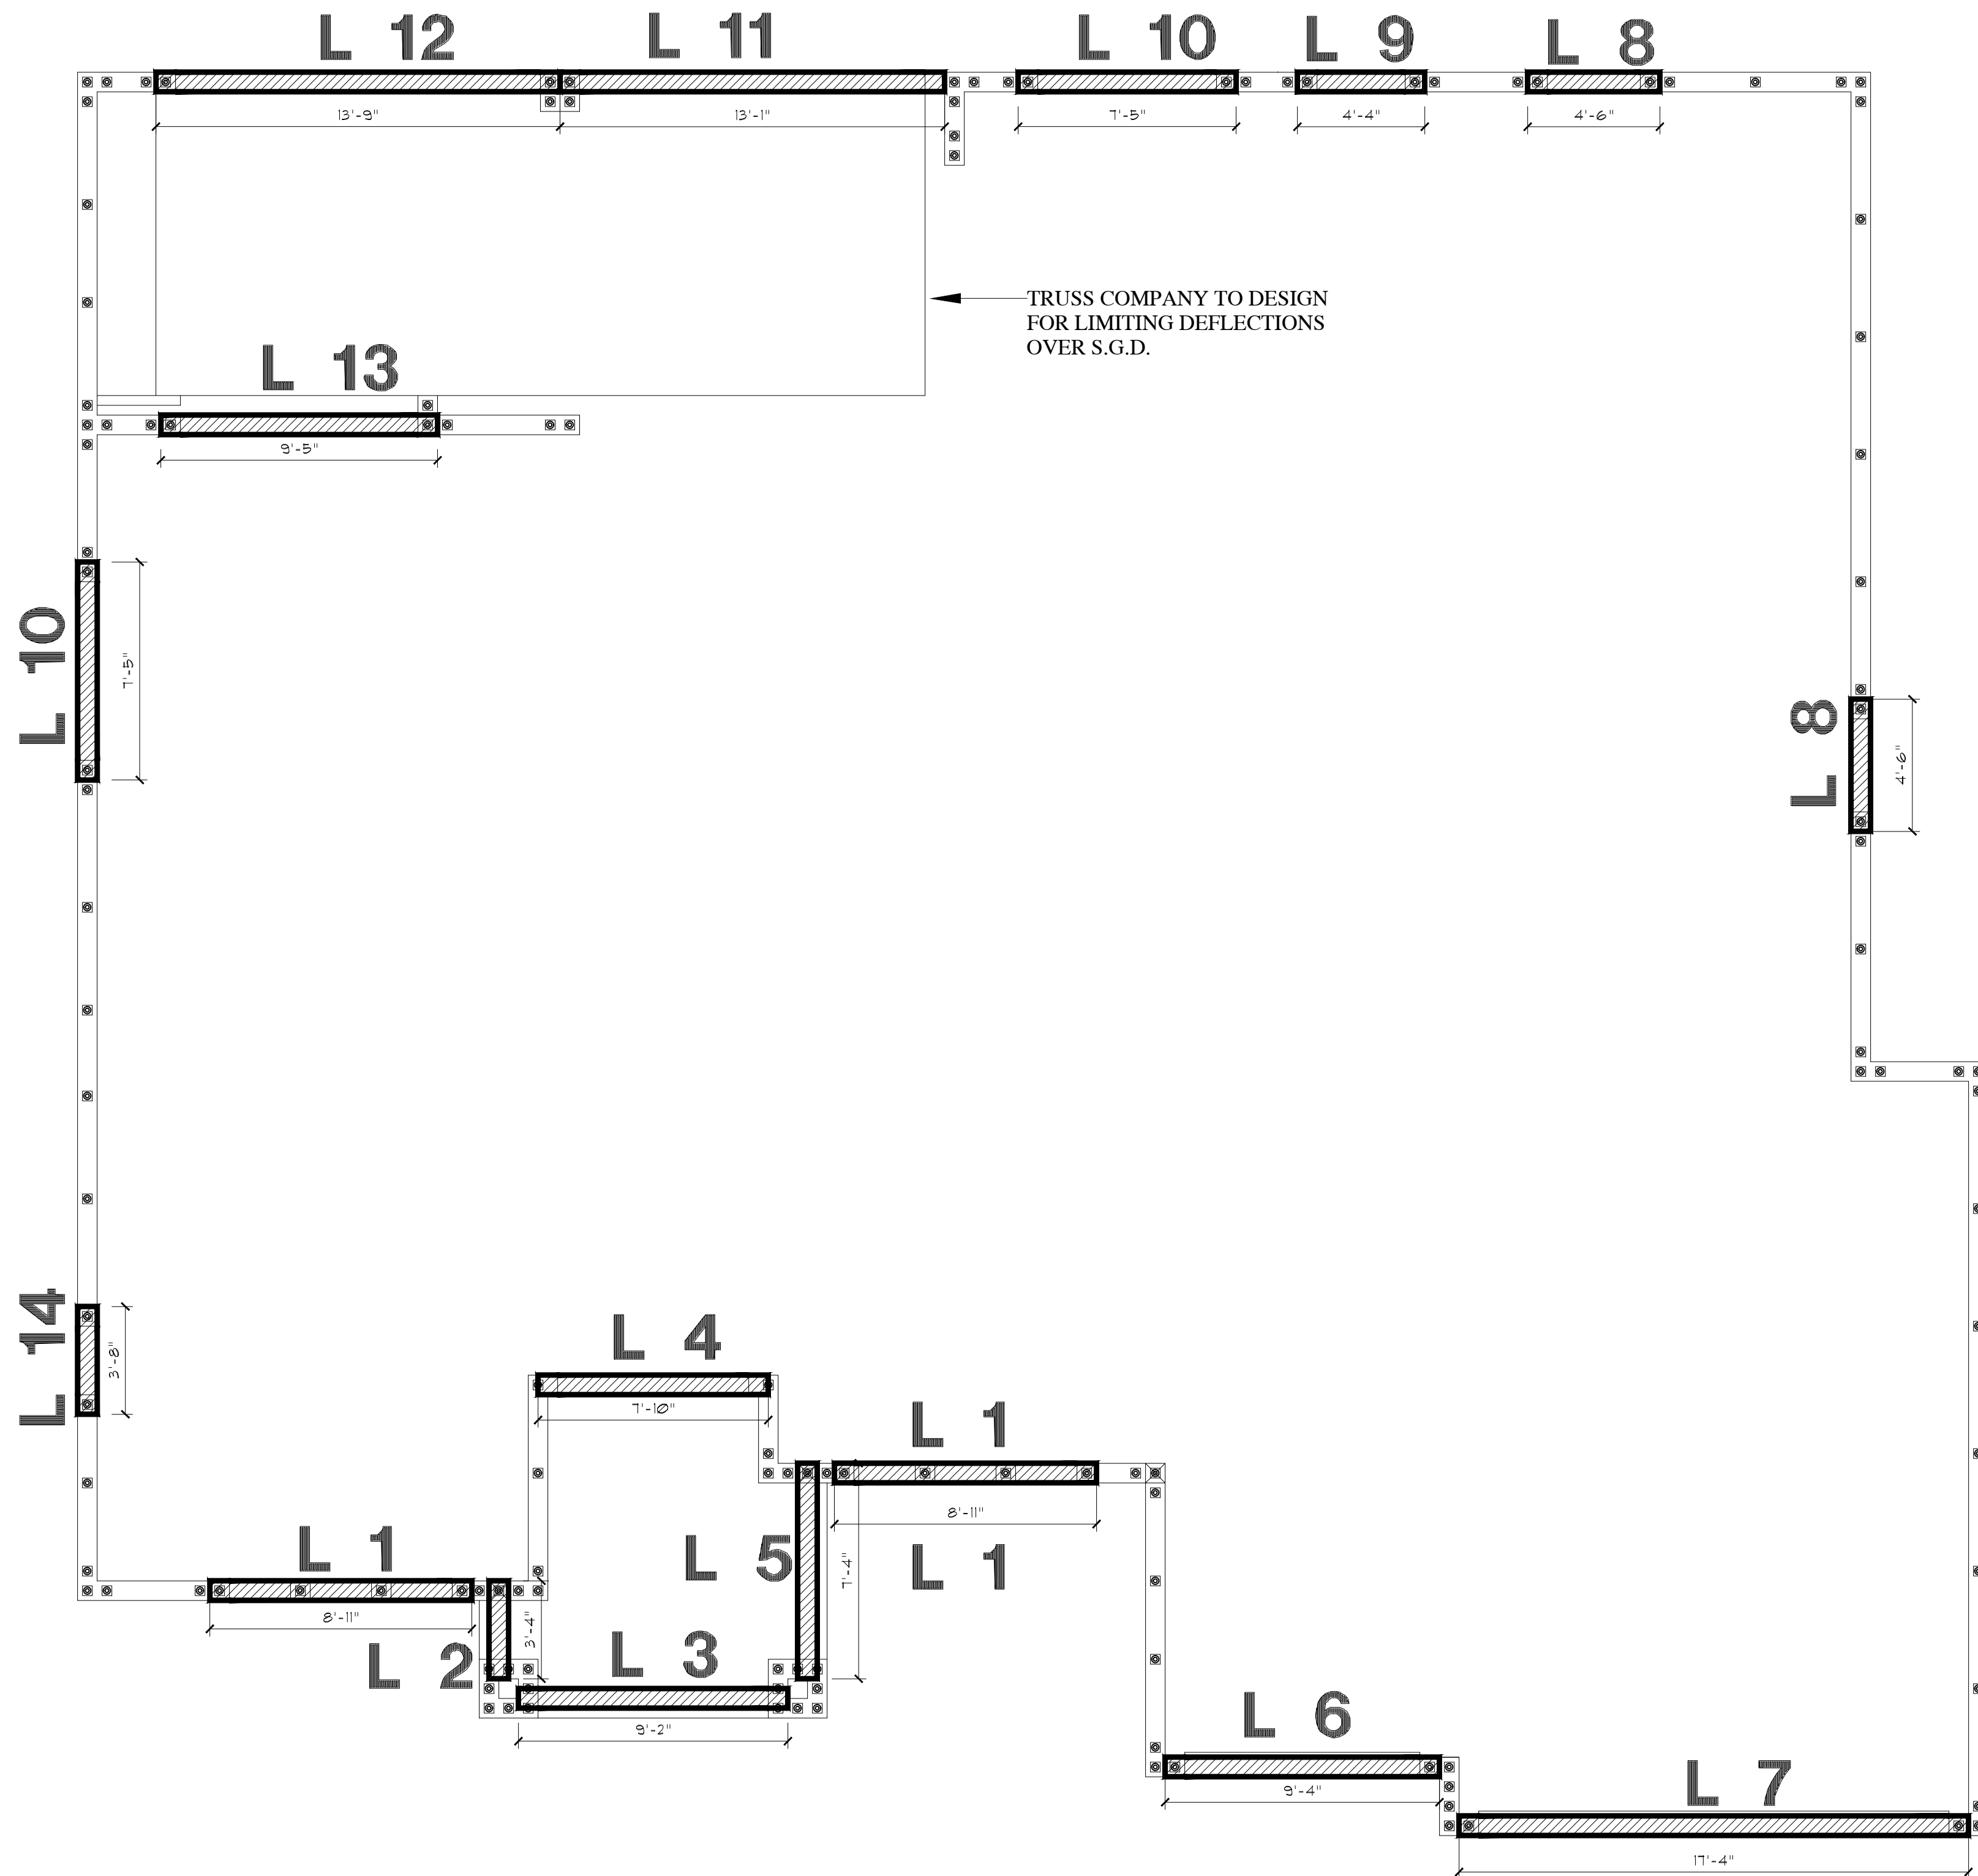

This item has been digitally signed and sealed by
Matthew F. Giordano, P.E. on 05/29/2024.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.


PRECAST CONCRETE LINTEL:

PROVIDE 8" PRECAST CONCRETE LINTEL OR DROP BEAM,
AS NECESSARY ABOVE ALL OPENINGS, W/ (1) #5 REBAR,
AND FILLED SOLID W/ CONCRETE.

ALL WOOD FRAME BRG. WALLS ABV. "PARALLAM" BEAMS
TO BE 2"x6" NO. 2, STP, AT 16" O.C., W/ DOUBLE TOP PLATE
& SINGLE BOTTOM PLATE. ATTACH STUDS TO TOP PLATE
W/ "USP" TP6X. ATTACH STUDS TO "PARALLAM" BEAM W/
"USP" RT22F RAFTER TIES @ EACH STUD.


ATTACH ROOF TRUSSES TO TIE BEAMS W/ "SIMPSON"
HETA 20 CONNECTORS @ EACH TRUSS

ATTACH ROOF TRUSSES TO WOOD FRAMED DOUBLE TOP
PLATE W/ "SIMPSON" H10A CONNECTORS 1/17/24

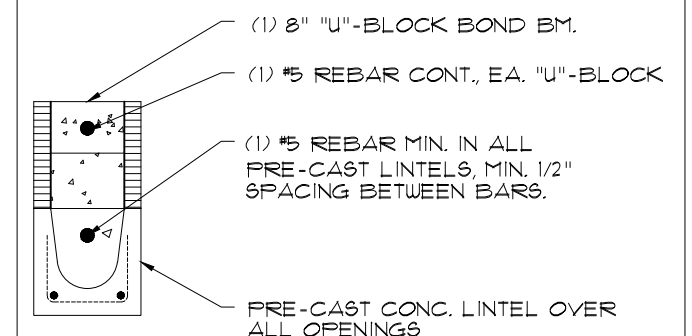


TYP. CONC. BOND BEAM DETAIL
SCALE: N.T.S.

NOTE:
VERIFY ELEVATION WITH TRUSS SHOP
DRAWING PRIOR TO WALL CONSTRUCTION.

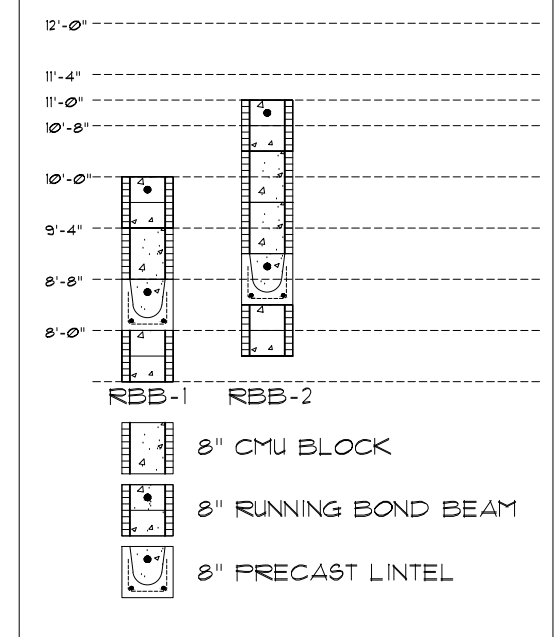


CAST-CRETE® LINTEL SCHEDULE

INTEL NO.	LENGTH	ØF16-I/B/IT TYPE	COMMENTS	
L 1	8'-11"	ØF16-I/B/IT		
L 2	3'-4"	ØF16-I/B/IT		
L 3	9'-2"	ØF16-I/B/IT		
L 4	7'-10"	ØF16-I/B/IT	DOOR	PRESTRESSED
L 5	7'-4"	ØF16-I/B/IT		
L 6	9'-4"	ØF24-I/B/IT	DOOR	PRESTRESSED
L 7	17'-4"	ØF24-I/B/IT	DOOR	PRESTRESSED
L 8	4'-6"	ØF16-I/B/IT		
L 9	4'-4"	ØF16-I/B/IT	DOOR	PRESTRESSED
L 10	7'-5"	ØF16-I/B/IT		
L 11	13'-1"	ØF24-I/B/IT		PRESTRESSED
L 12	13'-9"	ØF24-I/B/IT		PRESTRESSED
L 13	9'-5"	ØF20-I/B/IT	DOOR	PRESTRESSED
L 14	3'-8"	ØF16-I/B/IT		

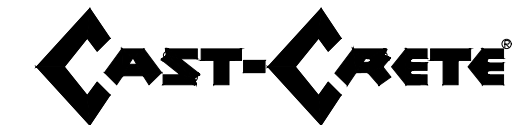


THIS RESIDENTIAL STRUCTURE IS DESIGNED TO WITHSTAND THE WINDLOADING IMPOSED IN ACCORDANCE WITH THE LOCATION OF SAID STRUCTURE, FIGURE R301.2(4), THE PROVISIONS OF CHAPTER 3 AND ALSO COMPLIES WITH ALL OTHER PROVISIONS OF THE 2023 FLORIDA BUILDING CODE-RESIDENTIAL, AS AMENDED.

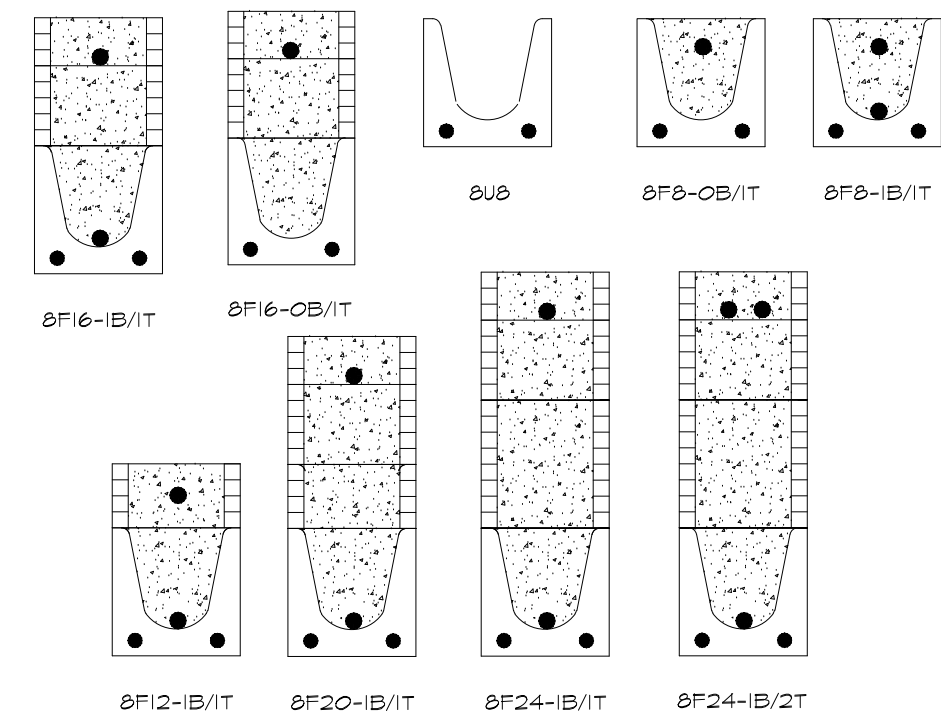TYPE DESIGNATION

F = FILLED WITH GROUT / U = UNFILLED
 QUANTITY OF #5 REBAR AT BOTTOM OF LINTEL CAVITY
 8F16-1B/1T
 NOMINAL WIDTH
 NOMINAL HEIGHT
 QUANTITY OF #5 REBAR AT TOP

NOTE:

8F XX INDICATES - HEIGHT VARIES
FROM 8F8 MIN. TO 8F48 MAX.



M.F. GIORDANO
ENGINEERING, PLLC

CONTACT: MATTHEW GIORDANO, P.E.
PHONE: (347) 264-5891
FL P.E. #87672; STATE REGISTRY # 34011
ADDRESS: 1222 SE 47TH ST.
CAPE CORAL, FL. 33904

CHECKED BY: H.L.C. DRAWN BY: H.C.

[illegible]

CRESPO
DESIGN & DRAFTING

11644 STONECREEK CIR.
FORT MYERS, FL. 33913
Cell: 239. 565. 9530
design.crespo@gmail.com
WWW.CRESPODESIGN.NET

The logo for Crespo Design features the word "Crespo" in a black, elegant script font, and the word "DESIGN" in a bold, blue, sans-serif font. The text is enclosed within a thin, light blue circular border.

"MODEL"	"RH"
RESIDENCE: SPEC HOME	
LEGAL: UNFT, BLK, LOT:	
ADDRESS: 23 Tournament Road	
SUBDIVISION: Rotonda WEST	
COUNTY: LEE	
STARF #	CDD #:2024-

SFH Development

SCALE: 1/4" = 1'-0"

BOND BEAM

6

GENERAL NOTES:

1. THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR ESTABLISHING, STRUCTURAL DESIGN, INSTALLATION, SEQUENCING, AND REMOVAL OF ALL TEMPORARY WORKS.
4. PRIOR TO FABRICATION AND ERECTION OF ALL NEW CONSTRUCTION, CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONSTRUCTION FOR DIMENSIONS AND ELEVATIONS.
5. THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
6. ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
7. FOUNDATIONS ARE DESIGNED FOR AN ALLOWABLE SOIL BEARING PRESSURE OF 2,000 PSF ON COMPACTED FILL OR NATIVE SOIL. BEFORE CONSTRUCTION COMMENCES, SOIL BEARING CAPACITY SHALL BE VERIFIED BY A SUBSURFACE INVESTIGATION, AS WELL AS FIELD AND LABORATORY TESTS PERFORMED BY A CERTIFIED TESTING LABORATORY, WHOSE REPORT SHALL INCLUDE ANALYSIS AND RECOMMENDATIONS FOR SITE PREPARATION IN ORDER TO BEAR THE FOUNDATION LOADS. ABOVE REPORT SHALL BE SUBMITTED TO THE STRUCTURAL ENGINEER FOR REVIEW BEFORE FOUNDATION CONSTRUCTION BEGINS.
8. THIS BUILDING/STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH THE 2023 EDITION OF THE FLORIDA BUILDING CODES, AND SECTION 1609 FOR DESIGN PRESSURES GENERATED BY A THREE SECOND GUST DESIGN WIND VELOCITY OF 160 MPH. STRUCTURAL CALCULATIONS, INCLUDING GRAVITY LOADS, AS NECESSARY TO CONFIRM COMPLIANCE WITH THE 2023 EDITION OF THE FLORIDA BUILDING CODE, HAVE BEEN PERFORMED.
9. THE OWNER, HIS AGENT, OR GENERAL CONTRACTOR IS RESPONSIBLE FOR FIELD SUPERVISION, CONSTRUCTION ADMINISTRATION, REVIEW AND APPROVAL OF ALL SHOP DRAWINGS, VERIFICATION ON-SITE OF ALL DIMENSIONS AND ELEVATIONS, AND STRICT COMPLIANCE WITH THE APPROVED CONSTRUCTION DOCUMENTS.
10. EXTERIOR GLAZING SHALL BE IMPACT RESISTANT OR PROTECTED WITH AN IMPACT RESISTANT COVERING MEETING THE REQUIREMENTS OF SST2 12, ASTM E 1886 AND ASTM E 1996, OR MIAMI-DADE PA 201, 202, AND 203, MEETING THE REQUIREMENTS OF THE LARGE MISSILE TEST.
11. ALL WINDOWS, DOORS, AND OTHER SUCH SYSTEMS, COMPONENTS AND CLADDING SHALL BE DESIGNED IN ACCORDANCE WITH SECTION 1609 OF THE 2023 EDITION OF THE FLORIDA BUILDING CODE FOR DESIGN PRESSURES GENERATED BY A THREE SECOND GUST DESIGN WIND VELOCITY OF 170 MPH, SEE "DESIGN PARAMETERS" FOR SPECIFIC PRESSURES.
12. CONTRACTOR SHALL NOTIFY THE OWNER IN WRITING PRIOR TO CONSTRUCTION OF ANY DISCREPANCY BETWEEN PLANS AND ON-SITE DIMENSIONS AND ELEVATIONS.
13. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCE TO INSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE ADDITION OF NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS OR TIEDOWNS.

GENERAL MASONRY NOTES:

1. CONCRETE MASONRY UNITS SHALL BE HOLLOW OR SOLID UNIT MASONRY IN ACCORDANCE WITH ASTM C 90 OR C 145 AND SHALL HAVE MINIMUM NET AREA COMPRESSIVE STRENGTH OF 1900 PSI.
2. THE MINIMUM THICKNESS OF EXTERIOR MASONRY WALLS SHALL BE 7/8 INCHES.
3. MORTAR SHALL BE EITHER TYPE M OR S IN ACCORDANCE WITH ASTM C 270.
4. GROUT SHALL HAVE A MAXIMUM COARSE AGGREGATE SIZE OF 3/8 INCH PLACED AT A 8 TO 11 INCH SLUMP AND HAVE MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS WHEN TESTED IN ACCORDANCE WITH ASTM C 1019, OR SHALL BE IN ACCORDANCE WITH ASTM C 476.
5. MASONRY GROUTING REQUIREMENTS:
6. FIELD-MIXED GROUT SHALL BE PLACED WITHIN 1-1/2 HOURS FROM INTRODUCING WATER INTO THE MIXTURE AND BEFORE INITIAL SET.
7. GROUT SLUMP REQUIREMENTS:
- 7.1. FOR GROUT SLUMP BETWEEN 8 AND 10 INCHES, THE MAXIMUM GROUT LIFT HEIGHT IS 5 FEET.
- 7.2. FOR GROUT SLUMP BETWEEN 10 AND 11 INCHES, THE MAXIMUM GROUT LIFT HEIGHT IS 12.67 FEET.
- 7.3. FOR SELF-CONSOLIDATING GROUT, THE GROUT LIFT HEIGHT SHALL NOT EXCEED THE GROUT POUR HEIGHT (24 FEET MAX.).
8. GROUT LIFT HEIGHTS EXCEEDING 5 FEET SHALL MEET THE FOLLOWING REQUIREMENTS:
- 8.1. MASONRY MORTAR HAS CURED FOR AT LEAST 4 HOURS.
- 8.2. GROUT SLUMP IS BETWEEN 10 AND 11 INCHES.
- 8.3. NO INTERMEDIATE BOND BEAMS ARE PLACED BETWEEN THE TOP AND BOTTOM OF THE GROUT LIFT HEIGHT.
9. EACH GROUT LIFT SHALL BE CONSOLIDATED BY MECHANICAL VIBRATION AT THE TIME OF PLACEMENT. CONSOLIDATION IS NOT REQUIRED FOR SELF-CONSOLIDATING GROUT.
10. EACH GROUT LIFT SHALL BE RECONSOLIDATED BY MECHANICAL VIBRATION AFTER INITIAL WATER LOSS AND SETTLEMENT HAS OCCURRED, AND BEFORE ADDING THE SUBSEQUENT GROUT LIFT. RECONSOLIDATION IS NOT REQUIRED FOR SELF-CONSOLIDATING GROUT.
11. THE TIME BETWEEN PLACING GROUT LIFTS SHALL NOT EXCEED 1 HOUR.
12. THE MAXIMUM POUR HEIGHT IS 24 FEET.
13. A GROUT KEY SHALL BE PROVIDED AT THE TOP OF EACH GROUT LIFT AND GROUT POUR. GROUT KEYS SHOULD BE FORMED BY TERMINATING THE GROUT 1-1/2 INCHES BELOW A MORTAR JOINT.
14. ALL MORTAR JOINTS FOR HOLLOW UNIT MASONRY SHALL EXTEND THE FULL WIDTH OF FACE SHELLS.
15. MORTAR JOINTS FOR SOLID MASONRY SHALL BE FULL HEAD AND BED JOINTS. BED JOINTS SHALL BE 3/8 INCH (1/8 INCH) THICK. HEAD JOINTS SHALL BE 3/8 INCH (+3/8 INCH OR -1/4 INCH) THICK.
16. THE BED JOINT OF THE STARTING COURSE PLACED OVER FOOTINGS SHALL BE PERMITTED TO VARY IN THICKNESS FROM A MINIMUM OF 1/4 INCH TO A MAXIMUM OF 3/4 INCH.
17. MASONRY WALLS SHALL BE RUNNING BOND OR STACK BOND CONSTRUCTION.
18. WHEN MASONRY UNITS ARE LAID IN STACK BOND OR RUNNING BOND, 9 GAGE (MINIMUM) HORIZONTAL JOINT REINFORCEMENT, IN ADDITION TO REQUIRED VERTICAL REINFORCEMENT, SHALL BE PLACED IN BED JOINTS AT NOT MORE THAN 16 INCHES ON CENTER.
19. LONGITUDINAL WIRES OF JOINT REINFORCEMENT SHALL BE FULLY EMBEDDED IN MORTAR OR GROUT WITH MINIMUM COVER OF 5/8 INCH WHEN EXPOSED TO EARTH OR WEATHER AND 1/2 INCH WHEN NOT EXPOSED TO EARTH OR WEATHER.
20. REINFORCING STEEL SHALL BE NO. 5 BARS, U.O.N.
21. FOR VERTICAL REINFORCEMENT, ONE NO. 5 BAR IN A GROUTED CELL SHALL BE PROVIDED IN EACH CORNER, INCLUDING INTERIOR CORNERS AND CORNERS CREATED BY CHANGES IN WALL DIRECTION BY OFFSETTING OF WALLS SUCH AS AT PROJECTED BAYS AND INSET PORCHES.
22. FOR VERTICAL REINFORCEMENT ONE NO. 5 BAR SHALL BE PROVIDED ON EACH SIDE OF OPENINGS.
23. IN ADDITION TO VERTICAL REINFORCEMENT REQUIRED AT CORNERS, AT OPENINGS, AND AT HIP GIRDER BEARING POINTS, VERTICAL REINFORCEMENT CONSISTING OF ONE NO. 5 BAR SHALL BE PROVIDED EVERY 4 FEET ON CENTER MAXIMUM. [U.O.N.]
24. SPLICES SHALL BE LAP SPLICES AS PER ACI 308.
25. IN NO CASE SHALL THE LENGTH OF THE LAPPED SPLICE BE LESS THAN 40 BAR DIAMETERS.
26. SPLICE LENGTHS SHALL BE MINIMUM OF 25 INCHES FOR NO. 5 BARS.
27. NON-CONTACT LAP SPLICES MAY BE USED PROVIDED REINFORCING BARS ARE NOT SPACED LESS THAN 2 INCHES OR GREATER THAN 5 INCHES.
28. REINFORCEMENT MAY BE BENT IN THE SHOP OR IN THE FIELD PROVIDED:
- 28.1. ALL REINFORCEMENT SHALL BE BENT COLD
- 28.2. DIAMETER OF THE BEND, MEASURED ON THE INSIDE OF THE BAR, IS NOT LESS THAN SIX BAR DIAMETERS
- 28.3. REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT, EXCEPT WHERE BENDING IS NECESSARY TO ALIGN DOWEL BARS WITH A VERTICAL CELL
- 28.4. BARS PARTIALLY EMBEDDED IN CONCRETE SHALL BE PERMITTED TO BE BENT AT SLOPE OF NOT MORE THAN 1 INCH OF HORIZONTAL DISPLACEMENT TO 6 INCHES OF VERTICAL BAR LENGTH.
29. REINFORCEMENT BARS EMBEDDED IN GROUTED MASONRY CELLS SHALL HAVE A MINIMUM CLEAR DISTANCE OF 1/2 INCH BETWEEN REINFORCING BARS AND ANY FACE OF A CELL.
30. REINFORCING BARS USED IN MASONRY WALLS SHALL HAVE A MASONRY COVER (INCLUDING GROUT) OR NOT LESS THAN 2 INCHES.
31. CLEAN-OUT OPENINGS SHALL BE PROVIDED FOR CELLS CONTAINING SPICED REINFORCEMENT WHEN THE GROUT POUR EXCEEDS 5 FEET IN HEIGHT.
32. WHERE CLEAN-OUT OPENINGS ARE REQUIRED, AN OPENING SHALL BE PROVIDED IN THE BOTTOM COURSE OF THE MASONRY CELL TO BE FILLED.
33. CLEAN-OUT OPENINGS SHALL HAVE MINIMUM AREA OF 12 SQUARE INCHES AND A MINIMUM OPENING DIMENSION OF 3 INCHES.
34. MASONRY PROTRUSIONS EXTENDING 1/2 INCH OR MORE INTO CORNERS OR CAVITIES TO BE GROUTED SHALL BE REMOVED FOR GROUT POURS OVER 5 FT.
35. SPACES TO BE GROUTED SHALL BE FREE OF MORTAR DRUMPLINGS, DEBRIS, LOOSE AGGREGATES, AND ANY MATERIAL DELETERIOUS TO MASONRY GROUT.
36. MASONRY OPENINGS LESS THAN 6 FEET SHALL BE SPANNED WITH AN 8" SPAN RATED PRECAST/PRESTRESSED CONCRETE LINTEL. ALL PRECAST LINTELS SHALL BEAR A MINIMUM OF 8" AT EACH END ON A GROUT FILLED CELL.
37. MASONRY OPENINGS 6 FEET OR GREATER SHALL BE SPANNED WITH AN 8" SPAN RATED PRECAST/PRESTRESSED CONCRETE LINTEL WITH 1#5 BAR CONTINUOUS. PRECAST LINTEL AND ALL CELLS ABOVE, TO THE BOTTOM OF THE TIE BEAM OR BOND BEAM, SHALL BE GROUTED SOLID. ALL PRECAST LINTELS SHALL BEAR A MINIMUM OF 8" AT EACH END ON A GROUT FILLED CELL.

CONCRETE / MASONRY BEAMS:

1. A REINFORCED CONCRETE / MASONRY BEAM SHALL BE PROVIDED AT THE TOP OF EACH EXTERIOR WALL.
2. BOND BEAMS SHALL CONTAIN 8"x8" "U" BLOCKS.
3. CONCRETE / MASONRY BEAM REINFORCEMENT SHALL BE TWO NO. 5 BARS (TOP & BOTTOM) EXCEPT WHERE NOTED.
4. REINFORCEMENT SHALL BE LOCATED IN THE TOP AND BOTTOM OF 16 INCH CONCRETE / MASONRY BEAMS.
5. REINFORCEMENT SHALL BE CONTINUOUS AROUND CORNERS. SEE STRUCTURAL DETAILS.
6. CONTINUITY OF THE #5 REINFORCING IN STRAIGHT RUNS SHALL BE PROVIDED BY LAPPING SPLICES NOT LESS THAN 30 INCHES. CONTINUITY SHALL BE PROVIDED AT CORNERS BY BENDING TWO BARS FROM EACH DIRECTION AROUND THE CORNER 30 INCHES OR BY ADDING TWO #5 BENT BARS WHICH EXTEND 30 INCHES EACH WAY FROM THE CORNER. CONTINUITY AT COLUMNS SHALL BE PROVIDED BY CONTINUING HORIZONTAL REINFORCING THROUGH COLUMNS OR BY BENDING HORIZONTAL REINFORCING IN THE COLUMNS A MIN. DISTANCE OF 18 INCHES.
7. WHERE MORE THAN ONE BAR IS REQUIRED, ONLY ONE OF THE BARS MUST BE CONTINUOUS AROUND CORNERS.
8. ALL VERTICAL WALL REINFORCEMENT SHALL BE TERMINATED IN CONCRETE / MASONRY BEAM (TIE-BEAM) AT THE ROOF LEVEL WITH A STANDARD HOOK. THE HOOK MAY BE BENT IN ACCORDANCE WITH THE REQUIREMENTS OF ASTM C1107, OR BY LAP SPLICING TO A STANDARD HOOK. THE HOOK SHALL EXTEND TO THE UPPER MOST HORIZONTAL REINFORCEMENT OF THE BOND BEAM AND SHALL BE EMBEDDED A MINIMUM OF 6 INCHES INTO THE BOND BEAM, SEE STANDARD DETAILS.
9. BOND BEAMS OVER ALL OPENINGS SHALL CONSIST OF (2) 8" "U" BLOCK WITH (1) #5 CONTINUOUS REBAR IN EACH "U" BLOCK; ABOVE AN 8" PRE-CAST LINTEL WITH (1) #5 ADDITIONAL REBAR; UNLESS NOTED OTHERWISE, DUE TO LARGE TRUSS GIRDER BEARING AND / OR UPLIFT LOADS.
10. CONCRETE / MASONRY BEAMS SHALL HAVE TOP AND BOTTOM REINFORCEMENT CONTINUOUS OVER OPENINGS.
11. CONCRETE / MASONRY BEAMS WHICH SHALL EXTEND PAST THE OPENING A MINIMUM OF 8".
12. FOR CAST-IN-PLACE BEAMS THE MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE 1 1/2 INCHES. ALSO SEE CONCRETE NOTES.

CONCRETE / MASONRY COLUMNS:

1. COLUMNS SHALL BE CONSTRUCTED OF STANDARD MASONRY UNITS, U.O.N.
2. MAXIMUM MASONRY COLUMN HEIGHT TO THE TOP OF BEAM SHALL NOT EXCEED 10 FT.
3. COLUMNS SHALL CONTAIN A MINIMUM OF FOUR VERTICAL BARS, ONE IN EACH CORNER.
4. VERTICAL COLUMN REINFORCEMENT SHALL BE FOUR NO. 3 BARS FOR 8X8 INCH COLUMNS AND FOUR NO. 5 BARS FOR ALL OTHER COLUMN SIZES, U.O.N.
5. CONNECTIONS OF COLUMNS TO THE FOUNDATION BELOW AND TO THE BOND BEAM AT THE TOP SHALL BE AS FOLLOWS:
- 5.1. 8X8 INCH COLUMN: ONE NO. 5 STANDARD 90 DEGREE HOOK INTO THE SUPPORT AT THE BOTTOM AND INTO THE BOND BEAM AT THE TOP.
- 5.2. 8X16 INCH COLUMN: TWO NO. 5 STANDARD 90 DEGREE HOOKS (ONE IN EACH CELL) BOTH AT THE BOTTOM AND AT THE TOP.

- 5.3. 12X12 INCH COLUMN AND 16X16 INCH COLUMN: BOTTOM: FOUR NO. 5 STANDARD 90 DEGREE HOOKS (ONE AT EACH VERTICAL BAR) EXTENDING FROM THE FOUNDATION AND SPICED WITH THE VERTICAL COLUMN REINFORCEMENT; TOP: FOR CORNER COLUMNS, THREE NO. 5 STANDARD 90 DEGREE HOOKS INTO THE BOND BEAM, MINIMUM, EACH SPICED TO A VERTICAL COLUMN BAR. FOR COLUMN LOCATED OTHER THAN AT A CORNER, TWO NO. 5 STANDARD 90 DEGREE HOOK INTO THE BOND BEAM SHALL BE SPICED TO SEPARATE VERTICAL COLUMN BARS.
6. LATERAL TIES OF A MINIMUM 1/4 INCH DIAMETER SHALL BE USED TO ENCLOSE VERTICAL COLUMN REINFORCEMENT AS FOLLOWS:
- 6.1. MAXIMUM VERTICAL SPACING OF LATERAL TIES SHALL BE 12".
- 6.2. LATERAL TIES MAY BE PLACED IN MORTAR JOINTS (PROVIDED THEY ARE NO LARGER THAN 1/4 INCH DIAMETER).
- 6.3. THE BOTTOM LATERAL TIES SHALL BE LOCATED VERTICAL NOT MORE THAN 1/2 A LATERAL TIE SPACING ABOVE THE TOP OF THE FOOTING.
- 6.4. THE TOP LATERAL TIE SHALL NOT BE MORE THAN 1/2 A LATERAL TIE SPACING BELOW THE LOWEST HORIZONTAL REINFORCEMENT IN THE BEAM ABOVE.
7. CONCRETE TIE COLUMNS SHALL BE PLACED AFTER THE MASONRY CMU WALLS. THE CONCRETE BLOCK FACING THE TIE COLUMN SHALL BE REMOVED SO THAT WHEN THE CONCRETE TIE COLUMN IS PLACED, THE CONCRETE WILL FLOW INTO THE BLOCK CELL INTERLOCKING THE TIE COLUMN WITH THE BLOCK. THIS SHALL OCCUR AT THE TOP AND BOTTOM OF THE WALL AND AT 24" ON CENTER FOR THE FULL HEIGHT OF THE INTERFACE BETWEEN THE BLOCK AND THE TIE COLUMN.

REINFORCED CONCRETE NOTES:

GENERAL:

1. ALL EXISTING CONDITIONS SHOWN IN THE DRAWINGS SHALL BE VERIFIED BY THE CONTRACTOR INCLUDING FRAMING LAYOUTS, MEMBER SIZES, AND SLAB OR WALL OPENINGS. THE STRUCTURAL ENGINEER SHALL BE NOTIFIED OF ANY DEVIATIONS PRIOR TO THE COMMENCEMENT OF CONSTRUCTION WORK.
2. CONTRACTOR SHALL VERIFY THE RESULTS OF THE GEOMETRIC SURVEYS AND STRUCTURE CONDITIONS SURVEYS PERFORMED.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR ESTABLISHING, STRUCTURAL DESIGN, INSTALLATION, SEQUENCING, AND REMOVAL OF ALL TEMPORARY WORKS.
4. LOCATE, SCAN AND MARK ALL EXISTING CONCRETE REINFORCEMENT PRIOR TO THE INSTALLATION OF NEW POST INSTALLED ANCHORS; AVOID ALL EXISTING REINFORCEMENT.

CONCRETE / REINFORCEMENT PROPERTIES:

5. NO CALCIUM CHLORIDE SHALL BE USED IN ANY CONCRETE.
6. AN APPROVED MIX DESIGN PROPORTIONED TO ACHIEVE A STRENGTH AT 28 DAYS AS LISTED BELOW WITH A PLASTIC AND WORKABLE MIX:
- 6.1. 3000 PSI FOR FOUNDATIONS AND SLABS ON GRADE.
- 6.2. 4000 PSI FOR ALL OTHER STRUCTURAL CONCRETE.
7. CONCRETE SHALL HAVE (3/4") MAXIMUM DIAMETER AGGREGATE)
8. REINFORCING STEEL SHALL BE MINIMUM GRADE 60 OR 40 AND IDENTIFIED IN ACCORDANCE WITH ASTM A 615, A 616, A 617, OR A 706.
9. ALL WELDED WIRE FABRIC (WWF) SHALL CONFORM TO THE STANDARDS OF ASTM A185.
10. JOINT REINFORCEMENT, ANCHORS, TIES, AND WIRE FABRIC SHALL CONFORM TO THE FOLLOWING STANDARDS:
- 10.1. ASTM A 82 FOR JOINT REINFORCEMENT AND WIRE ANCHORS AND TIES.
- 10.2. ASTM A 36 FOR PLATE, HEADED AND BENT BAR ANCHORS.
- 10.3. ASTM A 366 FOR SHEET METAL ANCHORS AND TIES.
11. ALL BAR SUPPORTS SHALL BE GALVANIZED OR EPOXY COATED. BAR SUPPORTS IN CONTACT WITH EXPOSED SURFACES SHALL ALSO BE PLASTIC TIPPED.
12. WHERE REQUIRED, DOWELS SHALL MATCH THE SIZE AND NUMBER OF MAIN REINFORCING, UNLESS NOTED OTHERWISE.

CONCRETE / REINFORCEMENT PLACEMENT:

13. ALL CONCRETE REINFORCEMENT SHALL BE DETAILED, FABRICATED, LABELED, SUPPORTED, SPACED IN FORMS, AND SECURED IN PLACE IN ACCORDANCE WITH THE PROCEDURES AND REQUIREMENTS OUTLINED IN THE LATEST EDITIONS OF THE "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE," ACI 318-08 AS MODIFIED BY CHAPTER 19 OF 2023 FLORIDA BUILDING CODE, THE "MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES," ACI 315, IBC 2012, AND 2023 FLORIDA BUILDING CODE.
14. ALL REINFORCING SPLICES SHALL CONFORM TO THE REQUIREMENTS OF ACI 318, BUT IN NO CASE SHALL BE LESS THAN 40 BAR DIAMETERS, UNLESS NOTED OTHERWISE. ALL TENSION LAP SPLICES SHALL BE CLASS B, UNLESS NOTED OTHERWISE.
15. ALL WELDED WIRE FABRIC SPLICES SHALL BE LAPPED TWO (2) FULL MESH PANELS AND TIED SECURELY.
16. PROVIDE A MINIMUM OF ONE (1) LAYER OF 4X4 - W2.9XW2.9 GALVANIZED OR EPOXY COATED WWF FOR ALL SIDEWALKS, UNLESS OTHERWISE NOTED.
17. PROVIDE A MINIMUM OF ONE (1) LAYER OF 4X4 - W6.0XW6.0 GALVANIZED OR EPOXY COATED WWF FOR ALL AUTOMOBILE DRIVEWAY AREAS, UNLESS NOTED OTHERWISE.
18. THE FOLLOWING MINIMUM CONCRETE COVERS SHALL BE PROVIDED FOR REINFORCEMENT, UNLESS LARGER COVER IS NOTED ELSEWHERE.
19. CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH: 3"
20. CONCRETE EXPOSED TO EARTH OR WEATHER:
- 20.1. #5 BARS AND SMALLER: 1-1/2"
- 20.2. CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND, SLAB, WALLS, JOISTS:
- 20.2.1. #14 AND #18 BARS: 1-1/2"
- 20.2.2. #11 AND SMALLER: 3/4"
- 20.3. BEAMS, COLUMNS:
- 20.3.1. PRIMARY REINFORCEMENT, TIES, STIRRUPS: 1-1/2"
- 20.3.2. SEE ACI 318 FOR ADDITIONAL REQUIREMENTS AND MORE INFORMATION.
21. CONSTRUCTION JOINTS IN ALL WALLS, SLABS AND BEAMS SHALL BE PROVIDED.
22. ALL CONSTRUCTION JOINTS SHALL BE WIRE BRUSHED, CLEANED AND MOISTENED IMMEDIATELY PRIOR TO PLACING NEW CONCRETE.
23. PLACE ALL SLABS ON-GRADE IN STRIP POURS OF A MAXIMUM WIDTH OF 30 FEET WITH A MINIMUM OF 24 HOURS BETWEEN ADJACENT POURS. STRIP POURED SLABS SHALL HAVE SAWCUT CONTROL JOINTS AT 15'-0" CENTERS. SAWCUTTING SHALL OCCUR WITHIN (12) HOURS OF COMPLETING THE POUR.
24. ALLOW A MINIMUM OF THREE (3) HOURS BETWEEN PLACEMENT OF CONCRETE FOR COLUMNS, WALLS OR PIERS AND PLACEMENT OF CONCRETE ON THE ADJACENT FLOOR.

SPECIAL REQUIREMENTS:

25. ALL CONCRETE IS TO BE MIXED, TRANSPORTED, AND PLACED IN ACCORDANCE WITH THE LATEST ACI SPECIFICATIONS AND RECOMMENDATIONS.
26. ALL CONCRETE SHALL BE SPECIFICALLY DESIGNED FOR THE HORIZONTAL AND VERTICAL PUMPING DISTANCES AS REQUIRED BY THE CONSTRUCTION SEQUENCING.
27. IF APPLICABLE, ALL CONCRETE MIXES SHALL CONTAIN APPROVED WATER REDUCING PLASTICIZING ADMIXTURES IN THE APPROPRIATE RANGES FOR PLACEMENT.
28. PROVIDE APPROVED CURING COMPOUND AND SEALER FOR THE TOP SURFACE OF ALL SLAB WORK, UNLESS NOTED OTHERWISE.
29. MAXIMUM CONDUIT DIAMETER IS 1/6 THE SLAB DEPTH.
- 29.1. CONDUIT SHALL BE LOCATED IN THE CENTER 1/3 OF THE SLAB AND AS SHOWN IN THE REINFORCED CONCRETE SLAB DETAILS.
- 29.2. CLEAR DISTANCE BETWEEN CONDUITS SHALL BE 3 TIMES THE CONDUIT DIAMETER.
- 29.3. CONDUIT SHALL BE SECURELY TIED TO REINFORCING TO PREVENT DISPLACEMENT DURING CONCRETE PLACEMENT.
- 29.4. CONDUIT SHALL BE PLACED ONLY IN ACCORDANCE WITH SHOP DRAWINGS APPROVED BY THE EOR.
30. THE MAXIMUM TIME ALLOWED FROM THE TIME THE MIXING WATER IS ADDED UNTIL IT IS DEPOSITED IN ITS FINAL POSITION SHALL NOT EXCEED ONE AND ONE HALF (1 1/2) HOURS. IF FOR ANY REASON THERE IS A LONGER DELAY THAN THAT STATED ABOVE, THE CONCRETE SHALL BE DISCARDED. IT SHALL BE THE RESPONSIBILITY OF THE TESTING LAB TO NOTIFY THE OWNER'S REPRESENTATIVE AND THE CONTRACTOR OF ANY NONCOMPLIANCE WITH THE ABOVE. ALL SLABS SHALL BE CURED USING A DISSIPATING CURING COMPOUND MEETING ASTM STANDARD C309 TYPE 1-D AND SHALL HAVE A FURTHER DYE. THE COMPOUND SHALL BE PLACED AS SOON AS THE FINISHING IS COMPLETED OR AS SOON AS THE WATER HAS LEFT THE UNFINISHED CONCRETE. ALL SLOPED OR BROWN AREAS IN THE CURING MEMBRANE SHALL BE RECOATED DAILY. CALCIUM CHLORIDES SHALL NOT BE UTILIZED; OTHER ADMIXTURES MAY BE USED ONLY WITH THE APPROVAL OF THE ENGINEER.
31. NO STRUCTURAL CONCRETE SHALL BE STRIPPED UNTIL IT HAS REACHED AT LEAST TWO THIRDS OF THE 28 DAY DESIGN STRENGTH. DESIGN, ERECTION AND REMOVAL OF ALL FORMWORK, SHORES AND RESHORES SHALL MEET THE REQUIREMENTS SET FORTH IN ACI STANDARDS 347 AND 301.
32. CONDUIT AND PIPE SHALL NOT BE PLACED IN STRUCTURAL SLABS WITHOUT THE APPROVAL OF THE STRUCTURAL ENGINEER. THE CONTRACTOR SHALL SUBMIT CONDUIT PLACEMENT DRAWINGS INDICATING LOCATIONS OF CAST-IN-CONDUITS AND PIPES. ALL CONDUITS SHALL BE PLACED IN THE MIDDLE THIRD OF THE SLAB THICKNESS AND SHALL BE SPACED NO CLOSER THAN 3 DIAMETERS OR WIDTHS ON CENTER. NO CONDUIT GREATER THAN 2 INCHES MAY BE PLACED IN THE STRUCTURAL SLABS.
33. BEFORE HOT WEATHER (HOT-SET CONDITIONS THAT ACCELERATE THE RATE OF MOISTURE LOSS OR RATE OF CEMENT HYDRATION OF FRESHLY MIXED CONCRETE, INCLUDING AN AMBIENT TEMPERATURE OF 80° F OR HIGHER, AND AN EVAPORATION RATE THAT EXCEEDS 0.2 LB/FT²/H CONCRETING AND THE PRE-CASTING METHOD, CONTRACTOR SHALL SUBMIT TO ENGINEER FOR REVIEW AND COMMENT DETAILED PRECASTING PROCEDURES, INCLUDING PRODUCTION, PLACEMENT, FINISHING, CURING AND PROTECTION OF CONCRETE DURING HOT WEATHER CONCRETING. COMPLY WITH ACI 305R "HOT WEATHER CONCRETING".
34. BEFORE COLD WEATHER (A PERIOD WHEN FOR MORE THAN THREE SUCCESSIVE DAYS THE AVERAGE DAILY OUTDOOR TEMPERATURE DROPS BELOW 40° F, THE AVERAGE DAILY TEMPERATURE IS THE AVERAGE OF THE HIGHEST AND LOWEST TEMPERATURE DURING THE PERIOD FROM MIDNIGHT TO MIDNIGHT. WHEN TEMPERATURES ABOVE 50° F OCCUR DURING MORE THAN HALF OF ANY 24 HR DURATION, THE PERIOD SHALL NO LONGER BE REGARDED AS COLD WEATHER.) CONCRETING AND THE PRE-PLACEMENT CONFERENCE, CONTRACTOR SHALL SUBMIT TO ENGINEER FOR REVIEW AND COMMENT DETAILED PROCEDURES, INCLUDING PRODUCTION, PLACEMENT, FINISHING, CURING AND PROTECTION OF CONCRETE DURING COLD WEATHER CONCRETING. COMPLY WITH ACI 306.1 R "STANDARD SPECIFICATION FOR COLD WEATHER CONCRETING".
35. CONCRETE TESTING: AN INDEPENDENT TESTING LABORATORY SHALL PERFORM THE FOLLOWING TESTS ON CAST IN PLACE CONCRETE:
- 35.1. ASTM C493 "STANDARD TEST METHOD FOR SLUMP OF PORTLAND CEMENT CONCRETE." MAXIMUM SLUMP SHALL BE 4-6 INCHES, PRIOR TO ADDING A SUPER PLASTICIZER.
- 35.2. ASTM C39 "STANDARD TEST METHOD FOR COMPRESSIVE STRENGTH OF CYLINDRICAL CONCRETE SPECIMENS." A SEPARATE TEST SHALL BE CONDUCTED FOR EACH CLASS, FOR EVERY 50 CUBIC YARDS (OR FRACTION THEREOF), PLACED PER DAY. REQUIRED CYLINDER(S) QUANTITIES AND TEST AGE AS FOLLOWS: 1 AT 3 DAYS; 1 AT 7 DAYS; 2 AT 28 DAYS
36. ALL CONCRETE MIX DESIGNS SHALL INCLUDE A PLACEMENT INDICATING WHERE EACH PARTICULAR MIX IS TO BE PLACED WITHIN THE STRUCTURE.
37. ALL CONCRETE DESIGN MIX SUBMITTALS SHALL INCLUDE TESTED, STATISTICAL BACK-UP DATA AS PER CHAPTER 5 OF ACI 318-08.
38. ONE ADDITIONAL RESERVE CYLINDER TO BE TESTED UNDER THE DIRECTION OF THE ENGINEER, IF REQUIRED. IF 28 DAY STRENGTH IS ACHIEVED, THE ADDITIONAL CYLINDER(S) MAY BE DISCARDED.
39. NON-SHRINK GROUT SHALL BE A HIGH-STRENGTH MORTAR OR GROUT WITH A MINIMUM COMPRESSIVE STRENGTH OF 5000 PSI AT 28 DAYS. THE GROUT IS TO BE NON-METALLIC, NON-CORROSIVE, CEMENT BASED AND SHALL CONFORM TO THE REQUIREMENTS OF ASTM C1107. IT SHALL BE PERMANENTLY TO A CLEAN METAL BASE-PLATE AND CONCRETE SUBSTRATE AND WILL NOT SHRINK IN ITS PLASTIC STATE, AS TESTED IN ACCORDANCE WITH ASTM C827.
40. CHEMICAL ANCHORS SHALL BE AN EQUAL TWO PART EPOXY POLYMER INJECTION SYSTEM, SUCH AS SIMPSON SET-XP "STRUCTURAL ANCHORING ADHESIVE", HILTI HIT-HY 150 MAX-SO OR ENGINEER APPROVED SUBSTITUTION, INSTALLED IN ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS. INSTALLERS SHALL BE TRAINED BY THE MANUFACTURER'S REPRESENTATIVE. BRUSH AND BLOW OUT ALL HOLES.

FOOTING & FOUNDATION:

1. FOUNDATIONS HAVE BEEN DESIGNED FOR AN ALLOWABLE SOIL BEARING PRESSURE OF 2,000 PSF AND THE EXISTING SOIL BEING A GRANULAR MATERIAL.
2. SHOULD POOR SOIL CONDITIONS BE FOUND IT IS THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY THE ENGINEER PRIOR TO COMMENCING.
3. PROVIDE GRANULAR FILL, CLAY MATERIALS ARE UNACCEPTABLE.
4. FOOTINGS SHALL BEAR UPON UNDISTURBED TREATED SOIL OR UPON SOIL COMPACTED TO AT LEAST 95% OF STANDARD PROCTOR MAXIMUM DRY DENSITY (ASTM D1557) FOR A DEPTH OF AT LEAST THREE (3) FEET BELOW THE BOTTOM OF THE FOOTING.
5. FILL SHALL BE TERMITE TREATED AND A "CERTIFICATE FOR TERMITE TREATMENT" IS REQUIRED ON THE PERMIT BOARD PURSUANT TO FBC SEC. 105.10 AND FBC R320.1.

6. FILL SHALL BE PLACED AND COMPACTED IN 4" LIFTS.
7. ALL FOOTINGS SHALL BE A MINIMUM OF 12" BELOW FINISHED GRADE.
8. THE TOP OF SLAB SHALL BE A MINIMUM OF 6" ABOVE FINISHED GRADE FOR WOOD FRAME CONSTRUCTION.
9. THE TOP OF SLAB SHALL BE A MINIMUM OF 4" ABOVE FINISHED GRADE FOR MASONRY VENEER AND A MINIMUM OF 6" ELSEWHERE.
10. FOOTINGS FOR STEM-WALL FOUNDATIONS SHALL BE A MINIMUM OF 10" THICK BY 16" WIDE, WITH TWO (2) #5 REINFORCING BARS.
11. FOUNDATION STEM WALLS SHALL BE 8 INCHES THICK MIN. AND SHALL HAVE SAME VERTICAL REINFORCING AS THE WALL ABOVE.
12. STEM-WALL FOUNDATION HEIGHT SHALL NOT EXCEED 3'-0" FROM FINISHED GRADE TO TOP OF MASONRY.
13. A STEM-WALL FLOATING SLAB FOUNDATION SHALL NOT BE PERMITTED UNDER THE UNENCLOSED WALLS OF A BUILDING.
14. FOOTING FOR MONOLITHIC SLAB ON GRADE FOUNDATIONS SHALL BE A MINIMUM OF 20" THICK BY 16" WIDE, WITH TWO (2) #5 REINFORCING BARS.
15. IN NARROW FOOTING WHERE INSUFFICIENT WIDTH IS AVAILABLE TO ACCOMMODATE A STANDARD 90 DEGREE HOOK AND PROVIDE THE REQUIRED CONCRETE COVER, THE HOOK SHALL BE ROTATED IN THE HORIZONTAL DIRECTION UNTIL THE REQUIRED CONCRETE COVER IS ACHIEVED.
16. THE TOP AND BOTTOM OF ALL FOOTINGS SHALL BE LEVEL. THE BOTTOM OF ALL FOOTINGS, EXCEPT MONOLITHIC SLAB-ON-GRADE INTERIOR FOOTINGS, SHALL BE A MINIMUM OF 12" BELOW FINISHED GROUND LINE.
17. FOR FOUNDATIONS MINIMUM CONCRETE COVER OVER REINFORCING BARS SHALL BE 3 INCHES.
18. THE OUTER BAR OF FOUNDATION STEEL SHALL BE CONTINUOUS AROUND CORNERS USING CORNER BARS OR BY BENDING THE BAR IN ACCORDANCE WITH NOTES HEREIN. IN BOTH CASES, THE MINIMUM BAR LAP SHALL BE 25 INCHES.
19. FOOTING DOWELS BARS SHALL BE PROVIDED FOR ALL REQUIRED VERTICAL WALL REINFORCEMENT IN THE FOLLOWING LOCATION:
- 19.1. AT ALL CORNERS
- 19.2. AT EACH SIDE OF EACH OPENING
- 19.3. AT ALL OTHER REQUIRED VERTICAL WALL REINFORCEMENT
- 19.4. AT ALL HIP GIRDER BEARING POINTS
20. FOOTING DOWEL BARS AT EACH LOCATION SHALL BE SAME SIZE AND QUANTITY AS THE VERTICAL WALL REINFORCEMENT ABOVE.
21. ALL FOOTING DOWEL BARS SHALL HAVE A STANDARD 90 DEGREE HOOK AND SHALL BE EMBEDDED A MIN. OF 6" INTO FOOTINGS.
22. CONCRETE SLAB-ON-GRADE SHALL BE CAST IN PLACE AND SHALL BE 3 1/2 INCHES THICK MINIMUM. CONCRETE SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF NOT LESS THAN 3,000 PSI AT 28 DAYS.
23. A SOIL OR WASTE PIPE OF A BUILDING DRAIN PASSING UNDER A FOOTING OR THROUGH A FOUNDATION WALL SHALL BE PROVIDED WITH A RELIEVING ARCH, OR THERE SHALL BE BUILT INTO THE MASONRY WALL AN IRON PIPE SLEEVE TWO PIPE SIZES GREATER THAN THE PIPE PASSING THROUGH.
24. A CONCRETE SLAB-ON-GRADE USED IN CONJUNCTION WITH EXTERIOR STEM-WALL FOUNDATIONS SHALL HAVE 6X6 NO. 10 WELDED WIRE FABRIC AT MID-HEIGHT OR, SYNTHETIC FIBER REINFORCEMENT, IN THE SLAB AND THE SLAB SHALL BE KEYS INTO OR TIED TO THE FOUNDATION.
25. WELDED WIRE FABRIC SHALL CONFIRM TO ASTM A-185 AND FREE OF OIL AND RUST. IT SHALL BE INSTALLED IN LENGTHS AS LONG AS POSSIBLE AND LAPPED A MINIMUM OF SIX INCHES.
26. PROVIDE (1) #5 ELECTRICAL GROUND TO FOUNDATION STEEL.
27. A 6 MIL MINIMUM POLYETHYLENE DAMPPROOFING VAPOR BARRIER SHALL BE PROVIDED, PER FBC R320.1.4. AND RS06.2.3.

WOOD CONSTRUCTION:


1. ALL WOOD CONSTRUCTION SHALL COMPLY WITH THE LATEST NDS (NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION), AND FBC.
2. LUMBER STANDARD SHALL BE AMERICAN SOFTWOOD LUMBER STANDARD PS 20-70, S4S, 19% MOISTURE OR AS REQUIRED BY STRUCTURAL DESIGN.
3. STRUCTURAL LUMBER (ROOF BEAMS, HEADERS, COLUMNS, STUDS, ECT.), TO BE SOUTHERN PINE SELECT STRUCTURAL WITH A FB-2,350 PSI, E=1,800,000 PSI, AND FV=175 PSI.
4. GLUE LAMINATED TIMBER SHALL CONFIRM WITH ASTM D-3737 AND AITC 117.
5. PLYWOOD FOR SHEATHING SHALL BE APA RATED SHEATHING AS PER PLANS AND SHALL BEAR THE APA MARK.
6. WOOD IN CONTACT WITH CONCRETE, MASONRY, AND/OR EXPOSED TO WEATHER SHALL BE PROTECTED OR PRESSURE TREATED IN ACCORDANCE WITH AITC-109.
7. STUDS SHALL BE DOUBLED AT EACH END OF EACH WALL SEGMENT.
8. THE MINIMUM NO. OF HEADER STUDS SUPPORTING EACH END OF A HEADER BEAM SHALL BE 2.
9. THE MINIMUM NO. OF FULL-LENGTH WALL STUDS AT EACH END OF A HEADER BEAM SHALL BE 2 FOR OPENINGS OF 6 FEET OR LESS AND 3 FOR ALL OTHER OPENINGS.
10. STUDS SHALL BE PLACED WITH THE WIDE FACE PERPENDICULAR TO THE WALL.
11. UPLIFT CONNECTORS SHALL BE PROVIDED AT THE TOP AND BOTTOM OF CRIPPLE STUDS, OF HEADER STUDS, AND AT LEAST ONE WALL STUD AT EACH SIDE OF OPENING.
12. JOINTS SHALL BE LAP-SPLICED WITHIN THE CENTER THIRD OF A WALL LENGTH. THE MINIMUM LAP SHALL BE 4 FEET. LAP SPLICES SHALL BE CONNECTED WITH (14) 16d COMMON NAILS.
13. ALL WOOD BEARING HEADERS SHALL, AT A MINIMUM, BE (2) 2"x12" WITH A 1/2" FLITCH PLATE, U.O.N.
14. COLUMNS SHALL BE FASTENED TO GIRDERS ABOVE AND BELOW IN ACCORDANCE WITH SECTION RS07 AND CHAPTER 23 OF THE 2023 EDITION OF THE FLORIDA BUILDING CODE.
15. UPLIFT CONNECTORS MUST BE PROVIDED TO RESIST THE UPLIFT LOADS. SEE WIND-LOAD CONNECTOR SCHEDULE.
16. APPROVED CONNECTORS, ANCHORS AND OTHER FASTENING DEVICES NOT INCLUDED IN THE FLORIDA BUILDING CODE SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
17. WHERE FASTENERS ARE NOT OTHERWISE SPECIFIED FASTENERS SHALL BE PROVIDED IN ACCORDANCE WITH TABLE 2304.9.1 OF THE FLORIDA BUILDING CODE.
18. UNLESS OTHERWISE STATED, SIZES GIVEN FOR NAILS ARE COMMON WIRE NAILS. FOR EXAMPLE, 8D = 2-1/2 INCHES LONG X 0.131-INCH DIAMETER. SEE TABLE 12.38, COLUMNS 2, 3, AND 4, IN THE NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION. METAL PLATES, CONNECTORS, SCREWS, BOLTS AND NAILS EXPOSED DIRECTLY TO THE WEATHER OR SUBJECT TO SALT CORROSION IN COASTAL AREAS, AS DETERMINED BY THE BUILDING OFFICIAL, SHALL BE STAINLESS STEEL, OR HOT DIPPED GALVANIZED AFTER THE FASTENER OR CONNECTOR IS FABRICATED TO FORM A ZINC COATING NOT LESS THAN 1 OZ PER SQ FT, OR HOT DIPPED GALVANIZED WITH A MINIMUM COATING OF 1.8 OZ PER SQ FT OF STEEL MEETING THE REQUIREMENTS OF ASTM A 90 TRIPLE SPOT TEST.

ROOF SYSTEMS:

1. ENGINEERED WOOD TRUSS SYSTEMS SHALL BE DESIGNED BY SUPPLIER'S SPECIALTY ENGINEER TO CONFIGURATION AND LOAD. CARRYING CAPACITY SHOWN ON DRAWINGS AND SPECIFICATIONS. ALL INDIVIDUAL TRUSS MEMBERS, TRUSS PLATE CONNECTIONS, TRUSS TO TRUSS CONNECTIONS, COMMON TRUSSES AND GIRDER TRUSSES SHALL BE DESIGNED FOR COMPONENT AND CLADDING WIND LOADING, EXCEPT THOSE TRUSSES EXCEEDING 700 SQUARE FEET IN TRIIBUTARY AREA. ALTERNATE TRUSS LAYOUTS ARE ACCEPTABLE ONLY AS A CHANGE ORDER WHICH WILL INCLUDE ENGINEERING CHARGES FOR REDESIGN OF THE STRUCTURE BY THE ENGINEER OF RECORD. SUBMIT SHOP DRAWINGS FOR REVIEW PRIOR TO FABRICATION. SHOP DRAWINGS SHALL SHOW AND SPECIFY ALL CONNECTOR TYPES UTILIZED WITHIN TRUSSES, AS WELL AS CONNECTORS UTILIZED IN ALL OTHER CONNECTIONS AND ATTACHMENTS BETWEEN TRUSSES OR COMPONENTS SUPPLIED AS PART OF THE ENGINEERED TRUSS SYSTEM. AN ERECTION DRAWING SHALL BE INCLUDED, IDENTIFYING ALL TRUSS SYSTEM COMPONENTS, AS WELL AS ALL PERMANENT BRACING REQUIRED FOR TRUSS DESIGN.
2. ENGINEERED SHOP DRAWINGS SHALL BEAR THE SIGNATURE AND IMPRESSED SEAL OF A FLORIDA REGISTERED PROFESSIONAL ENGINEER AS THE SPECIALTY ENGINEER.
3. PARALLEL CHORD WOOD TRUSSES SHALL BE IN ACCORDANCE WITH THE TPI DESIGN SPECIFICATIONS METAL PLATE CONNECTED WOOD TRUSSES.
4. METAL PLATE CONNECTED WOOD TRUSSES SHALL BE SPACED NO MORE THAN 24" ON CENTER AND DESIGNS FOR LIVE LOADS AND WIND LOADS FOR AN ENCLOSED BUILDING BASED ON SECTION 1609 OF THE 2023 FLORIDA BUILDING CODE.
5. GIRDER TRUSSES SHALL BE DESIGNED TO FUNCTION ALSO AS DRAG STRUTS. TRUSS DESIGN SUBMITTALS AND ERECTION INSTRUCTIONS SHALL SHOW BOTH UPLIFT AND LATERAL CONNECTION LOAD REQUIREMENTS AT ENDS OF GIRDER TRUSS.
6. TOP CHORDS OF TRUSSES SHALL BE OF GROUP II SPECIES LUMBER.
7. ROOF SHEATHING SHALL BE 19/32" EXPOSURE I C-D SHEATHING GRADE PLYWOOD (WOOD STRUCTURAL PANELS), OR EQUIVALENT.
8. THE SHEATHING SHALL BE INSTALLED IN ACCORDANCE WITH THE STRUCTURAL DETAILS. LONG DIMENSION SHALL BE PERPENDICULAR TO FRAMING AND END JOINTS SHALL BE STAGGERED.
9. THE SHEATHING SHALL BE FASTENED TO ROOF FRAMING WITH ASTM F1667 RSR5-03 (21/2" x 0.131") NAILS OR ASTM F1667 RSR5-04 (3" x 0.120") NAILS AT 6" ON CENTER AT EDGES AND 6" ON CENTER AT INTERMEDIATE FRAMING. (PURSUANT TO THE FLORIDA BUILDING CODE). RING-SHANK NAILS SHALL HAVE THE FOLLOWING MINIMUM DIMENSIONS:
- 9.1. 0.131" NOMINAL SHANK DIAMETER
- 9.2. RING DIAMETER OF 0.012 OVER SHANK DIAMETER
- 9.3. 16-20 RINGS PER SHANK
- 9.4. 0.281" FULL ROUND HEAD DIAMETER
- 9.5. 2-1/2" NAIL LENGTH
10. ANCHOR EACH TRUSS / RAFTER AT EACH END WITH RATED CONNECTORS CAPABLE OF RESISTING THE UPLIFT AND HORIZONTAL LOADS SPECIFIED. REFER TO STRUCTURAL DETAILS AND WIND-LOAD CONNECTOR SCHEDULE.
11. THE CONNECTOR SHALL BE EMBEDDED IN OR ATTACHED TO THE BOND BEAM / TIE-BEAM IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.
12. THE CONNECTOR SHALL BE FASTENED TO THE TRUSS IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. SEE WIND-LOAD CONNECTORS SCHEDULE.
13. THE WOOD TRUSS SHALL BE SEPARATED FROM CAST-IN-PLACE TIE-BEAMS WITH AN APPROVED MOISTURE BARRIER.


EXTERIOR COVERINGS:

1. EXTERIOR WALL VENEERS SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 1405 OF THE 2023 EDITION OF THE FLORIDA BUILDING CODE.
2. APPLICATION OF STUCCO (PORTLAND CEMENT PLASTER) SHALL BE IN ACCORDANCE WITH ASTM C 296, APPLICATION OF PORTLAND CEMENT BASED PLASTER.
3. METAL ACCESSORIES FOR USE IN EXTERIOR WALL CONSTRUCTION AND NOT DIRECTLY EXPOSED TO THE WEATHER SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A 153, CLASS B-2. METAL ACCESSORIES FOR USE IN INTERIOR WALL CONSTRUCTION SHALL BE MILL GALVANIZED IN ACCORDANCE WITH ASTM A 641, CLASS 1.
4. ALL EXPOSED CEILINGS IN ENTRY'S, PORCHES AND LANAIS SHALL BE OF ONE OF THE FOLLOWING TYPES: SUBSTITUTION CEILING TYPE IS ALLOWED.
- 4.1. 1/2" PLYWOOD OR OSB SHEATHING FASTENED DIRECTLY TO TRUSSES OR FRAMING.
- 4.2. 1/2" DRYWALL FASTENED TO MIN. 1X3 FIRING STRIPS AT 16" O.C. RUNNING PERPENDICULAR TO TRUSSES OR FRAMING.
- 4.3. 1/2" DRYWALL FASTENED TO MIN. 2X4 BRIDGE BLOCKING AT 48" O.C. RUNNING PERPENDICULAR TO TRUSSES OR FRAMING & SUPPORTING ALL DRYWALL EDGES.

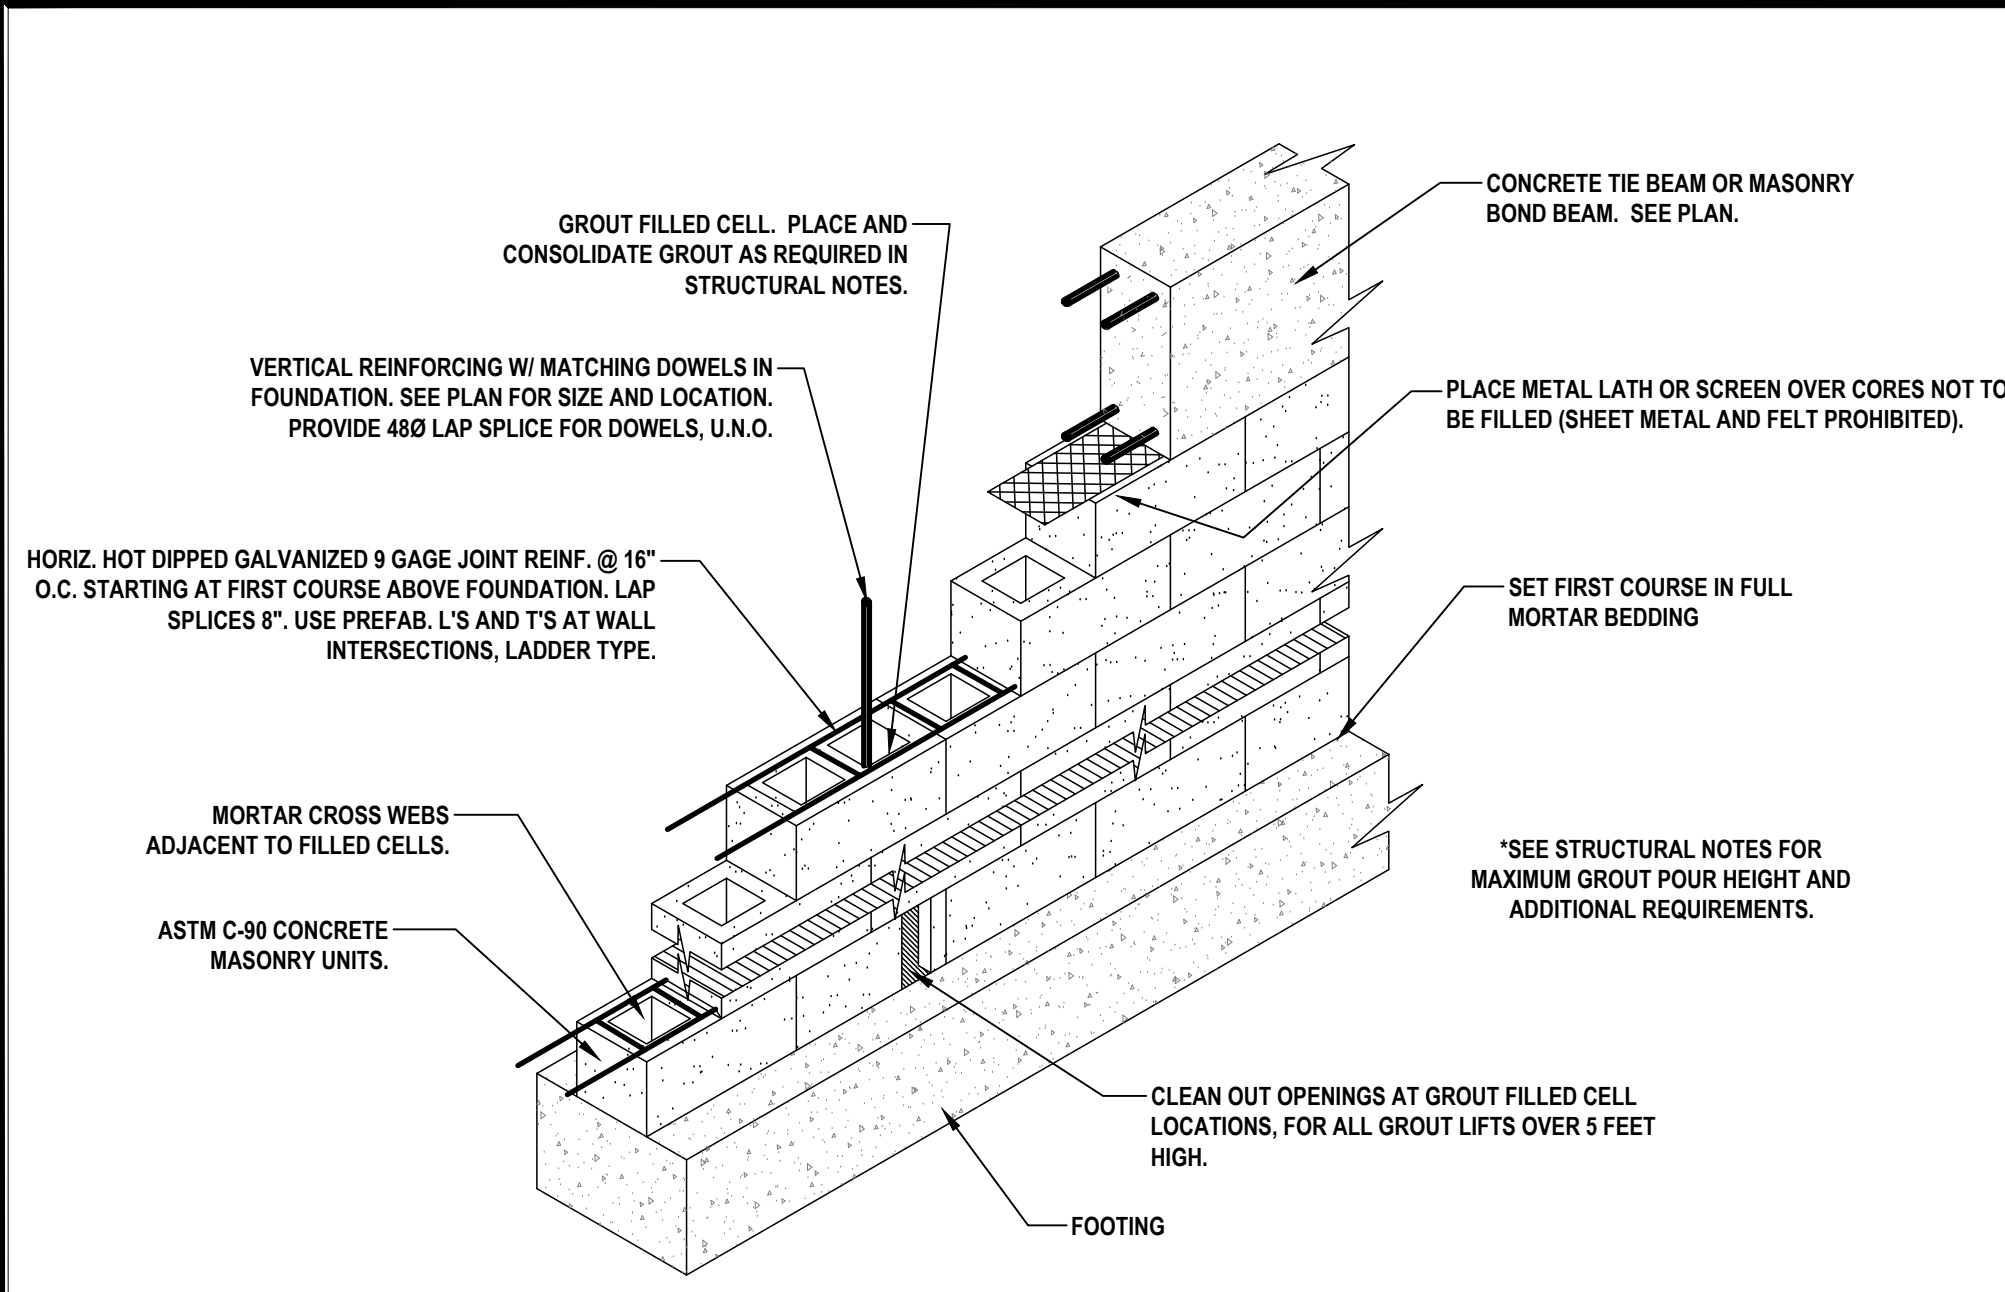


TYPICAL MASONRY WALL CONSTRUCTION

SCALE: N.T.S.

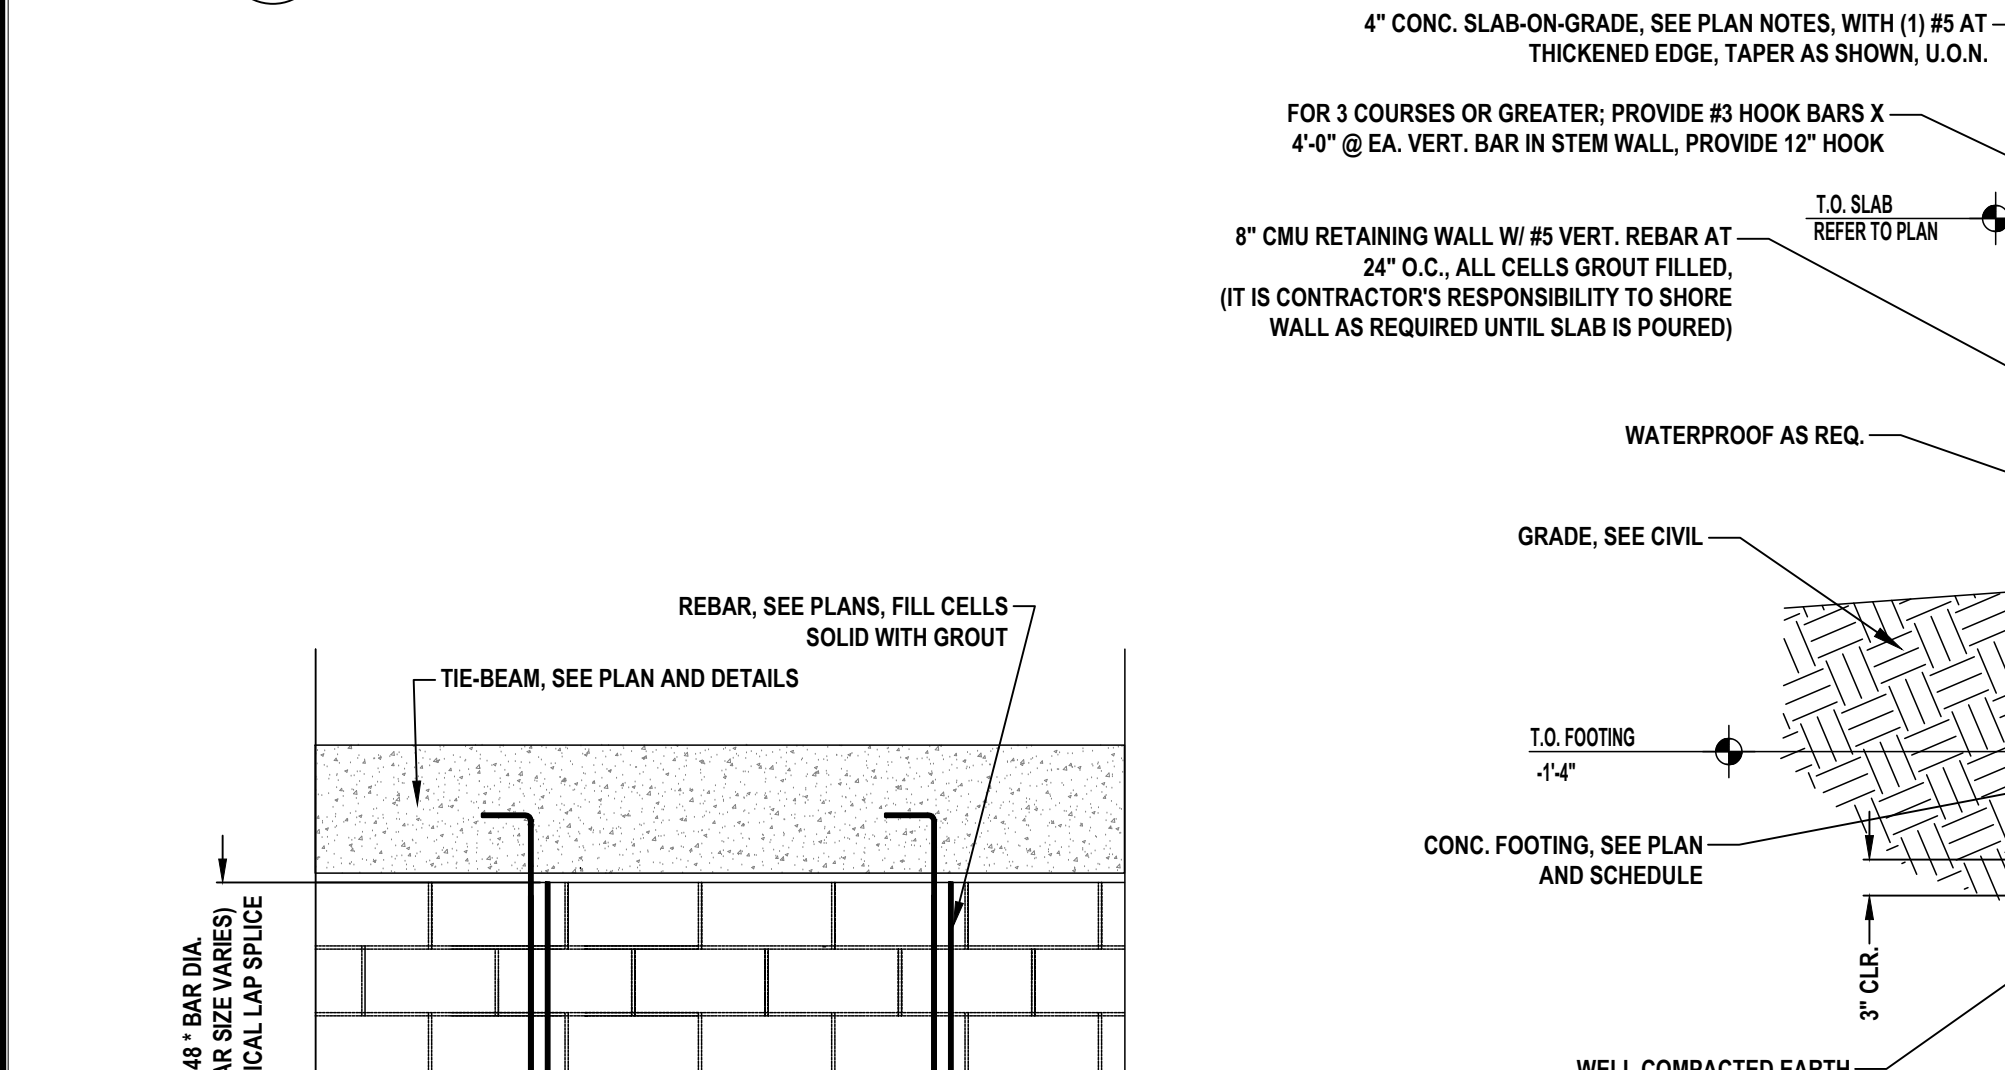


TYPICAL 2-COURSE STEM-WALL OVER CONT. SPREAD FOOTING

SCALE: 3/4"=1'-0"

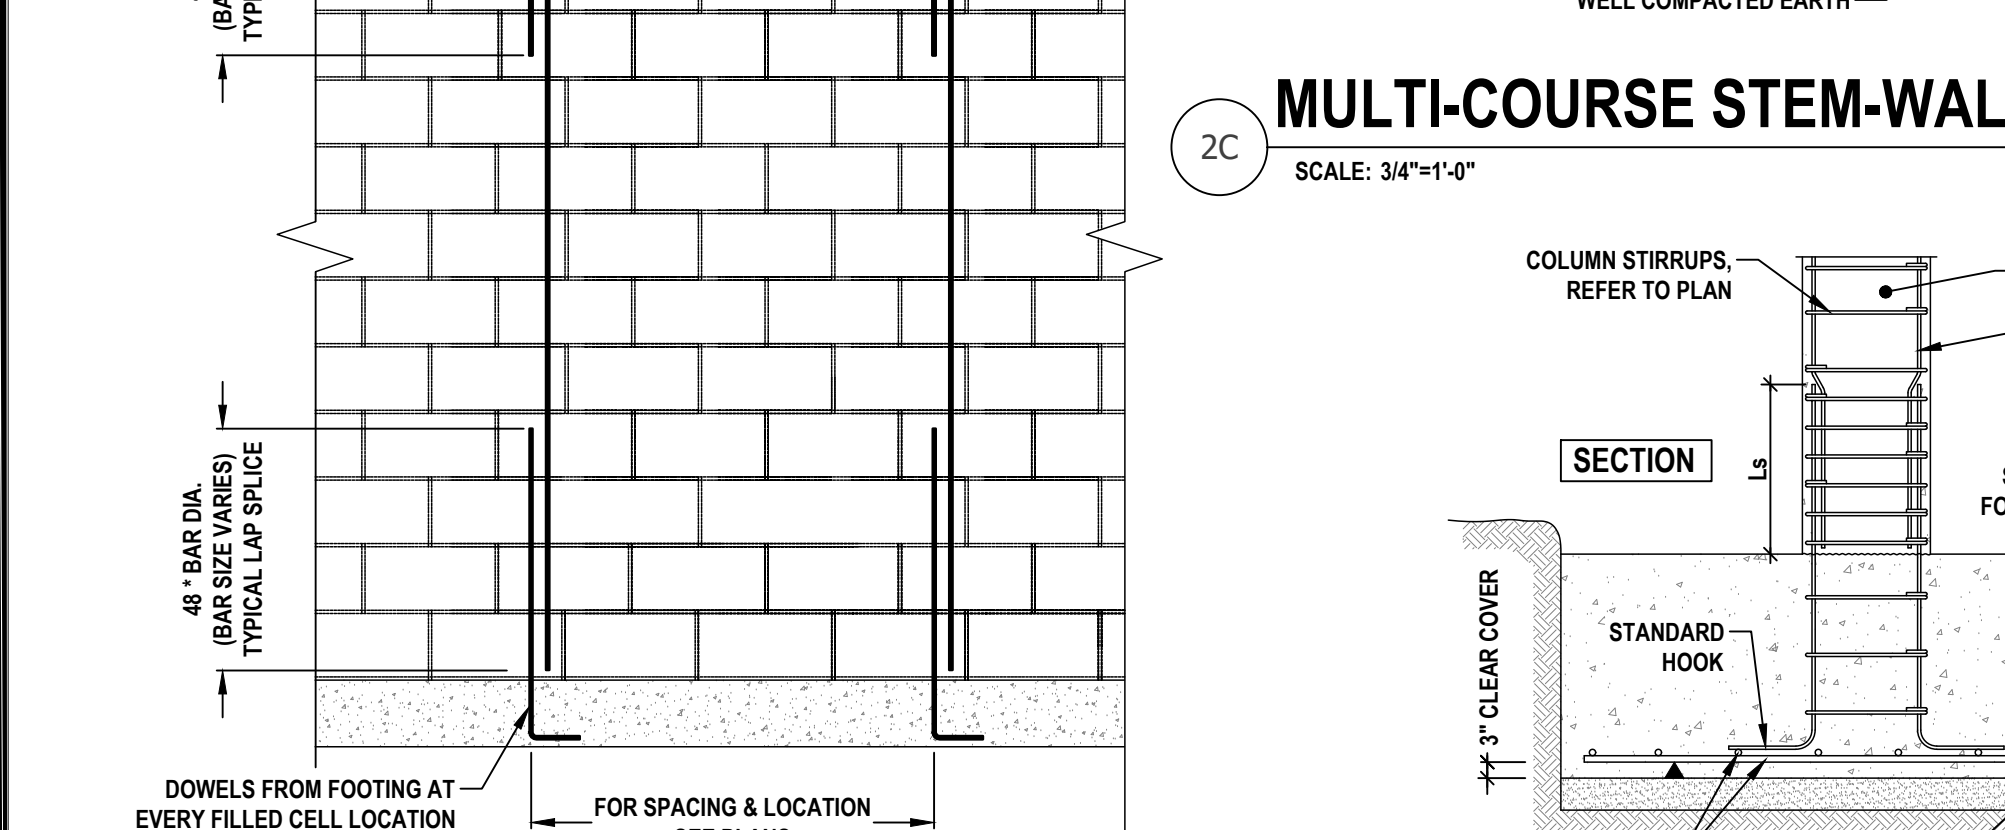

MULTI-COURSE STEM-WALL OVER CONT. SPREAD FOOTING

SCALE: 3/4"=1'-0"

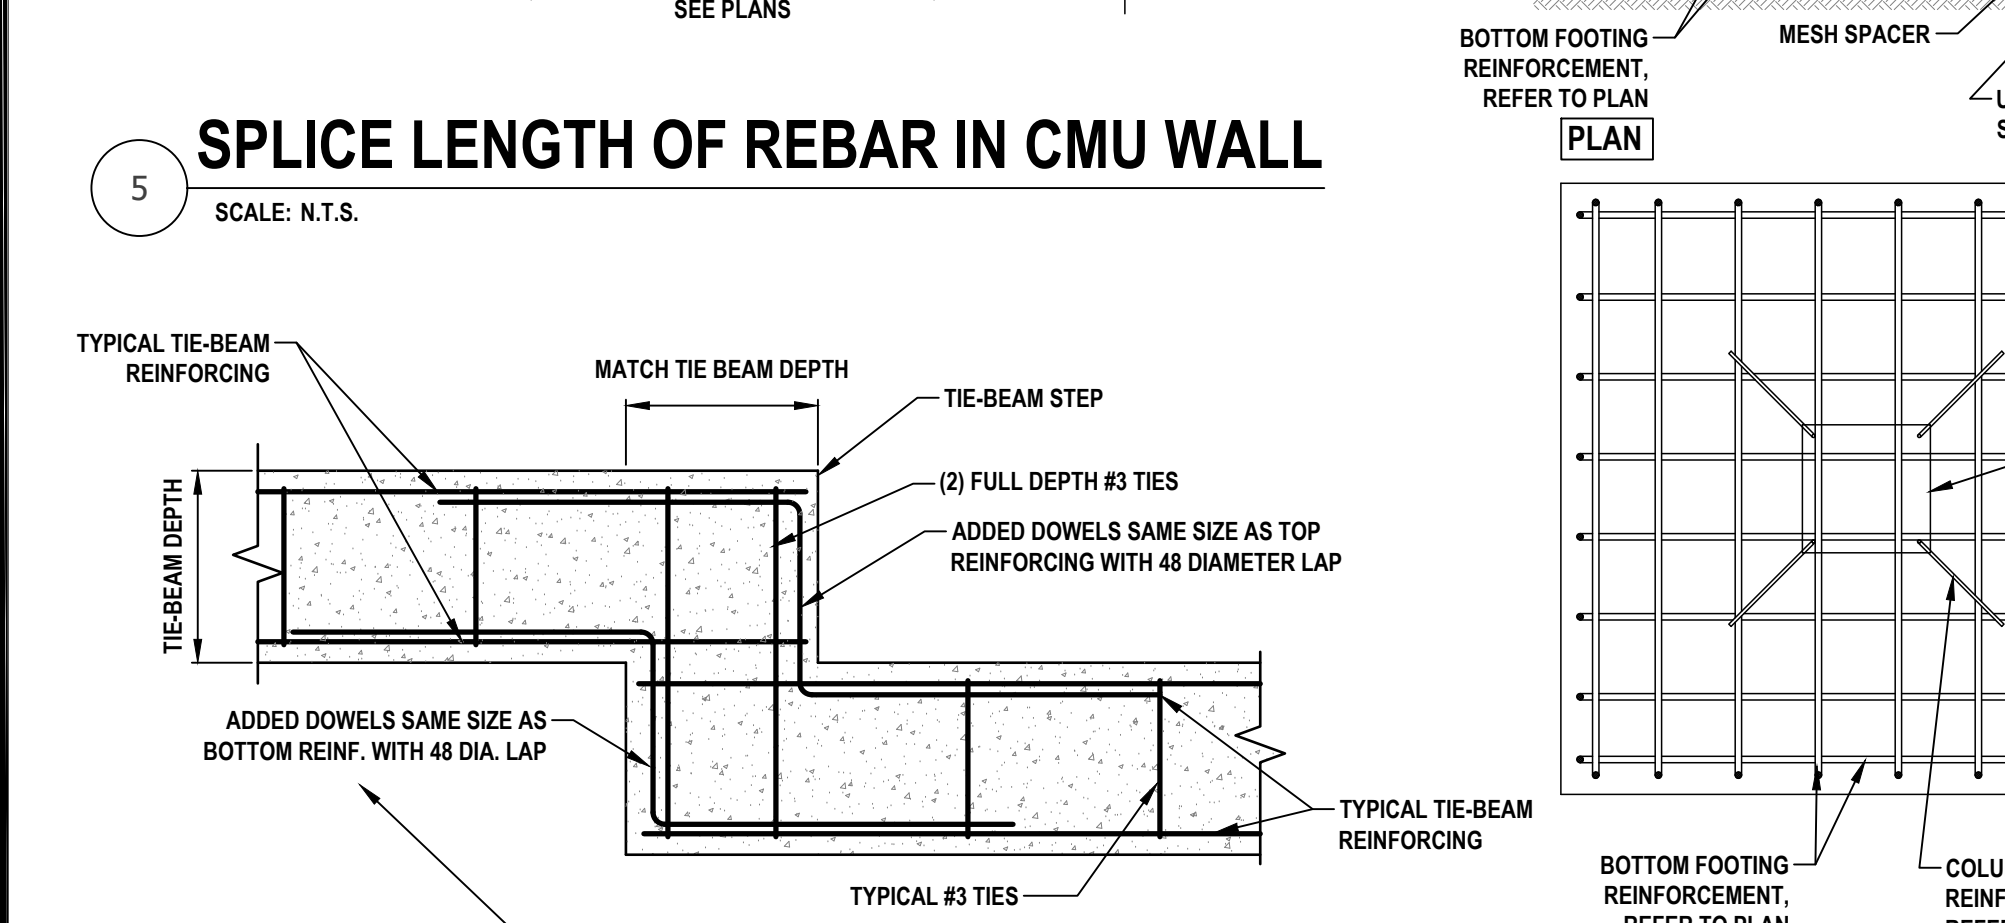


SPLICE LENGTH OF REBAR IN CMU WALL

SCALE: N.T.S.




TYPICAL STEPPED BEAM DETAIL

SCALE: N.T.S.

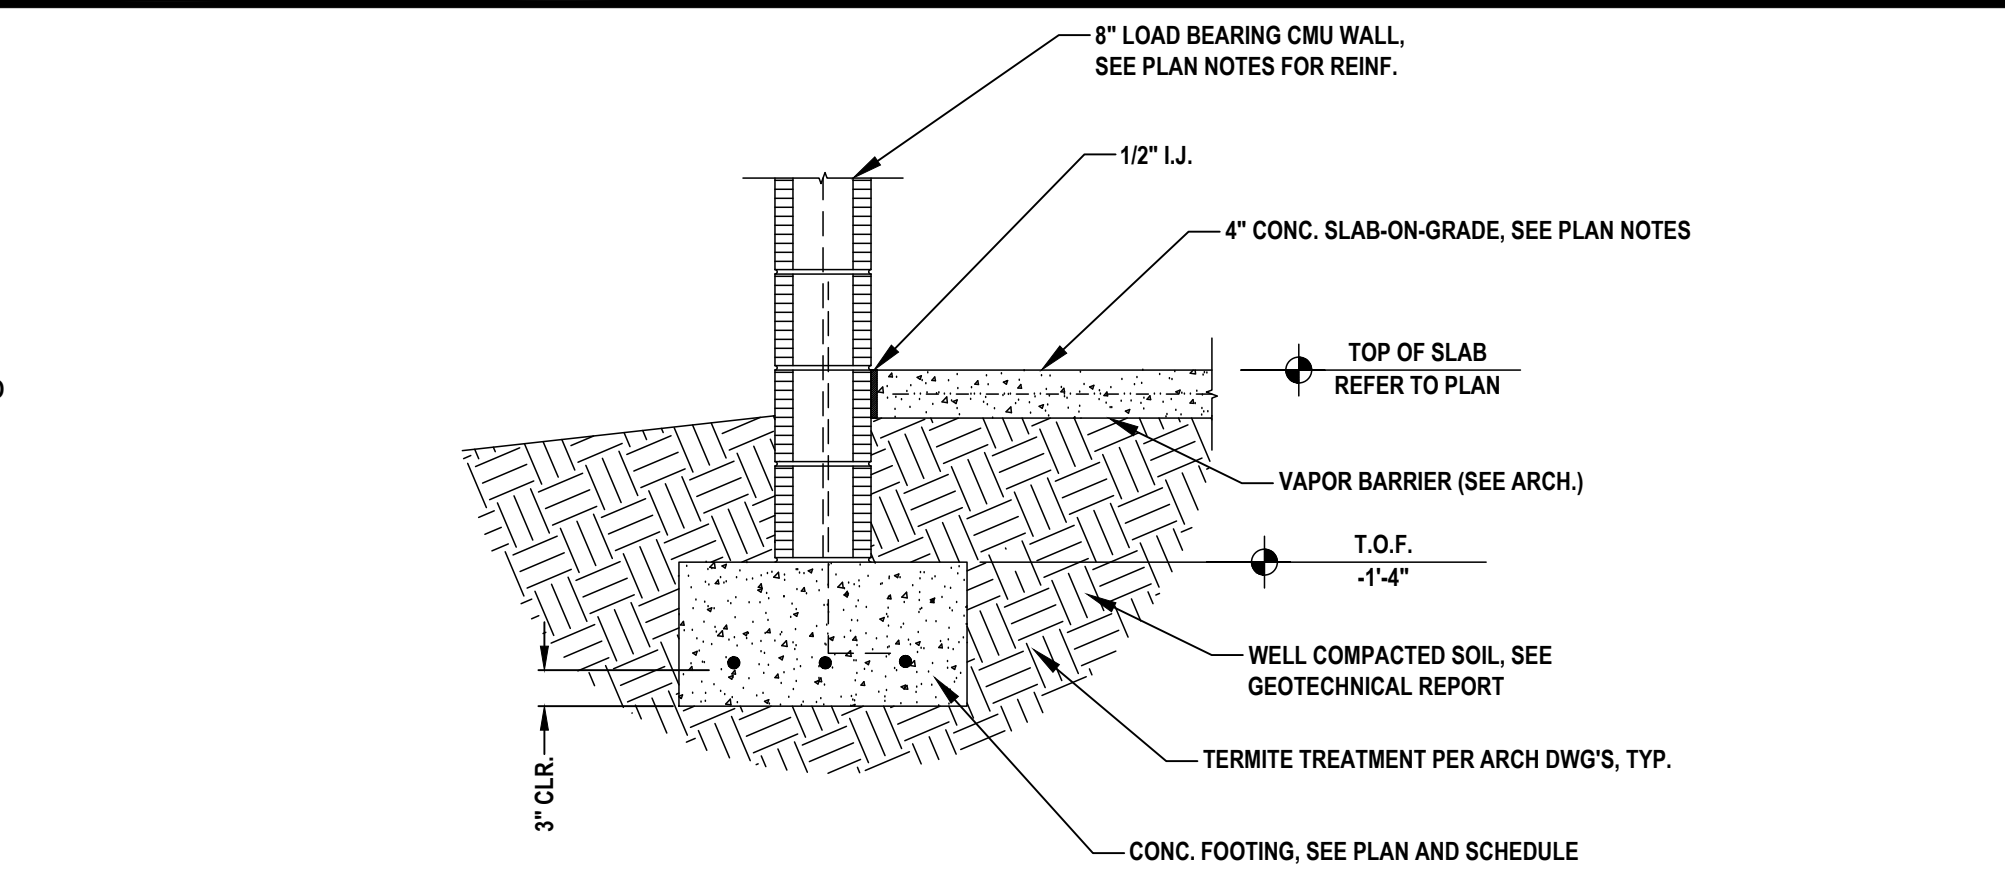


TYPICAL REINFORCEMENT DIAGRAM FOR CONTINUOUS BEAM

SCALE: N.T.S.

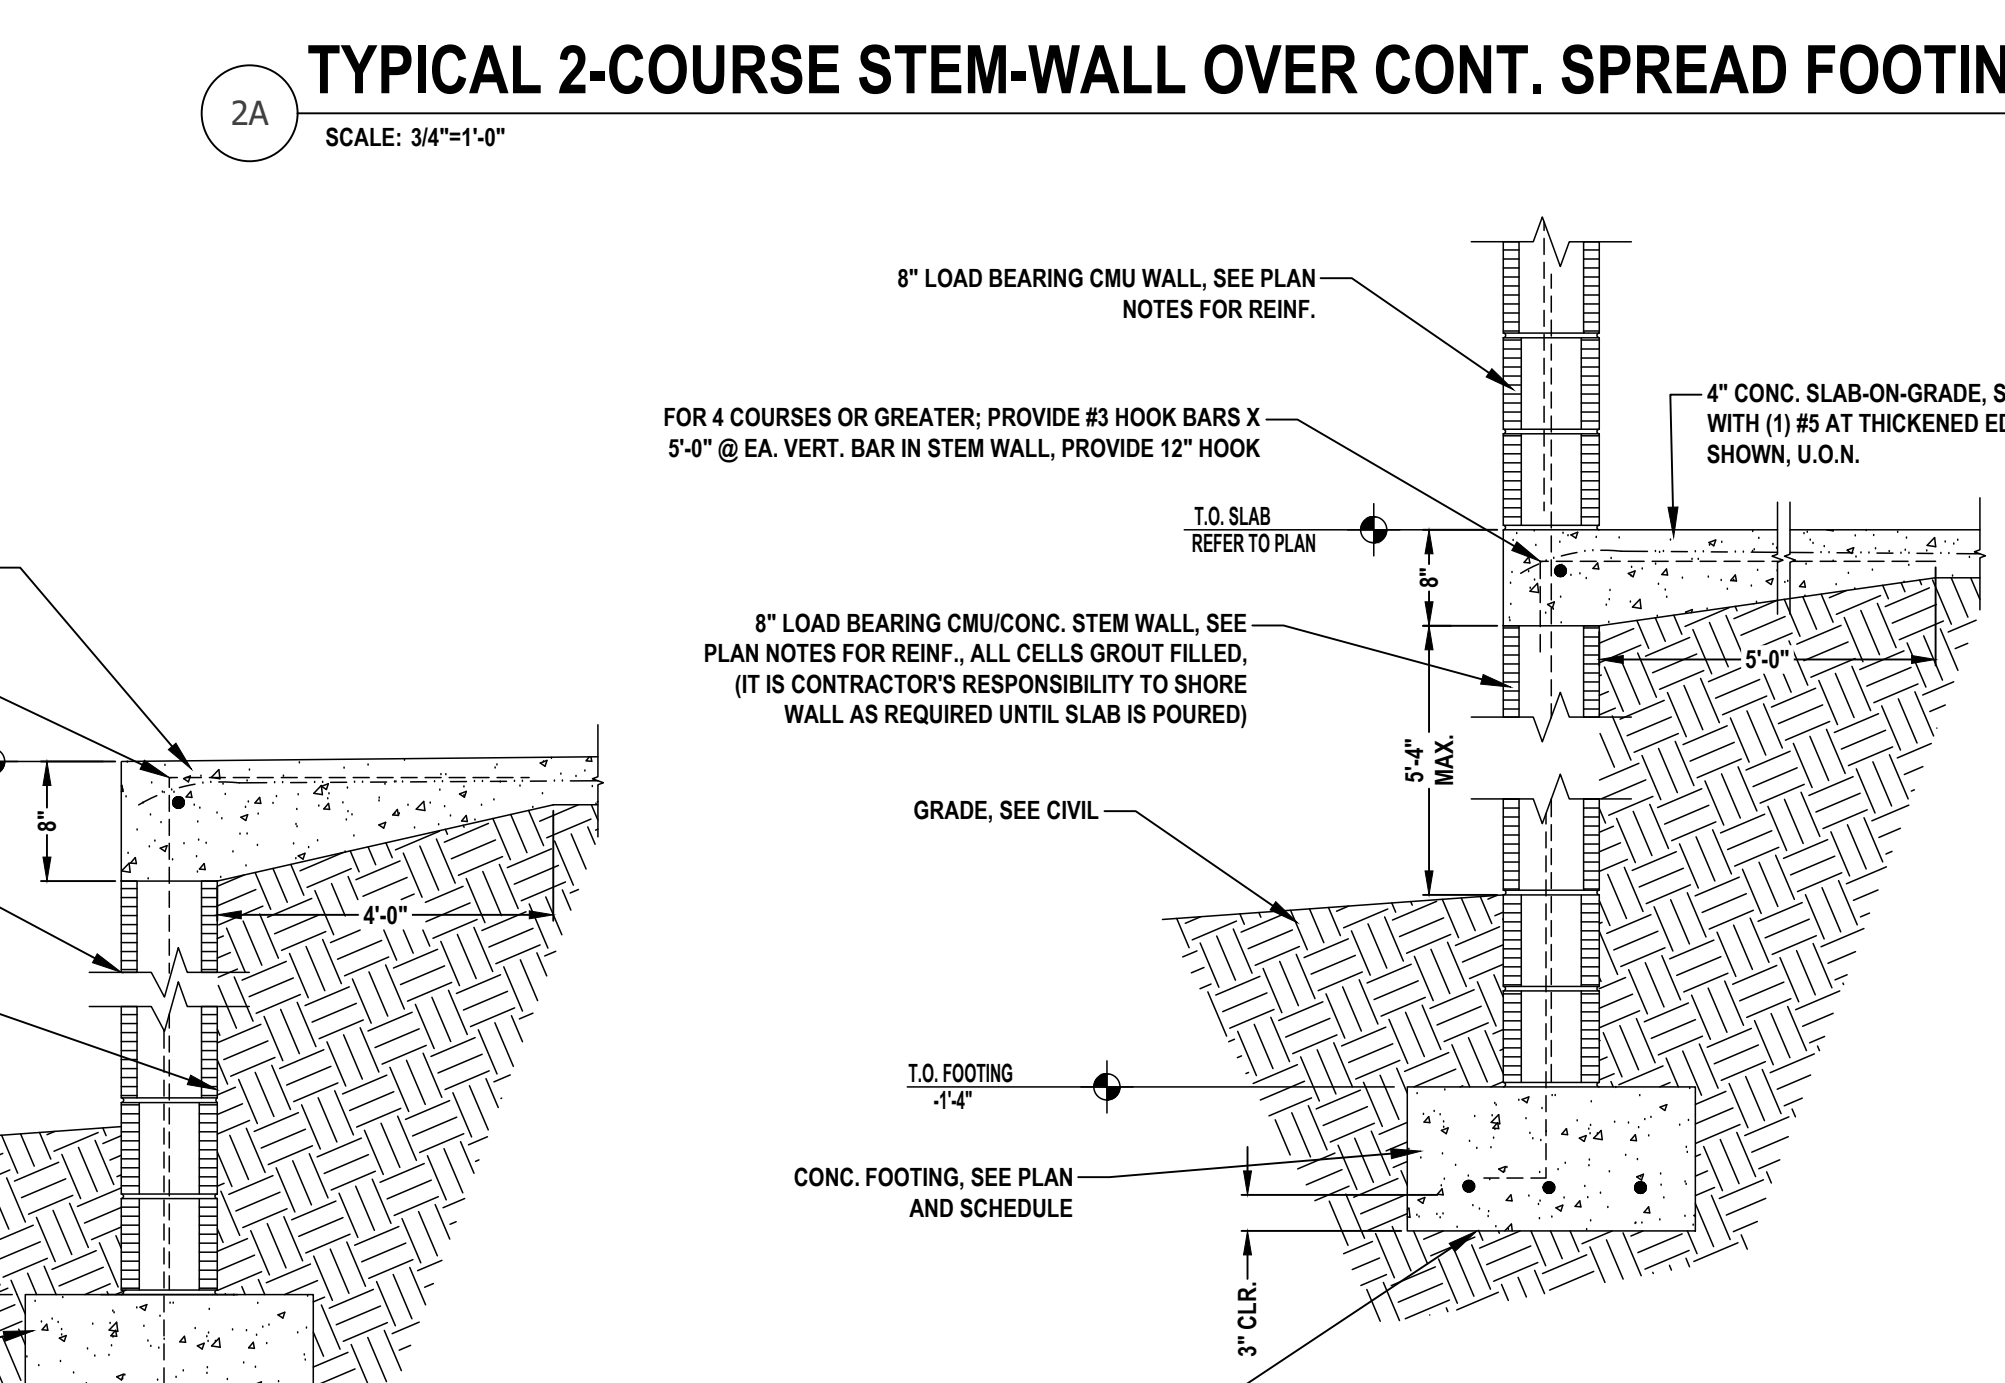


MULTI-COURSE STEM-WALL OVER CONT. SPREAD FOOTING

SCALE: 3/4"=1'-0"

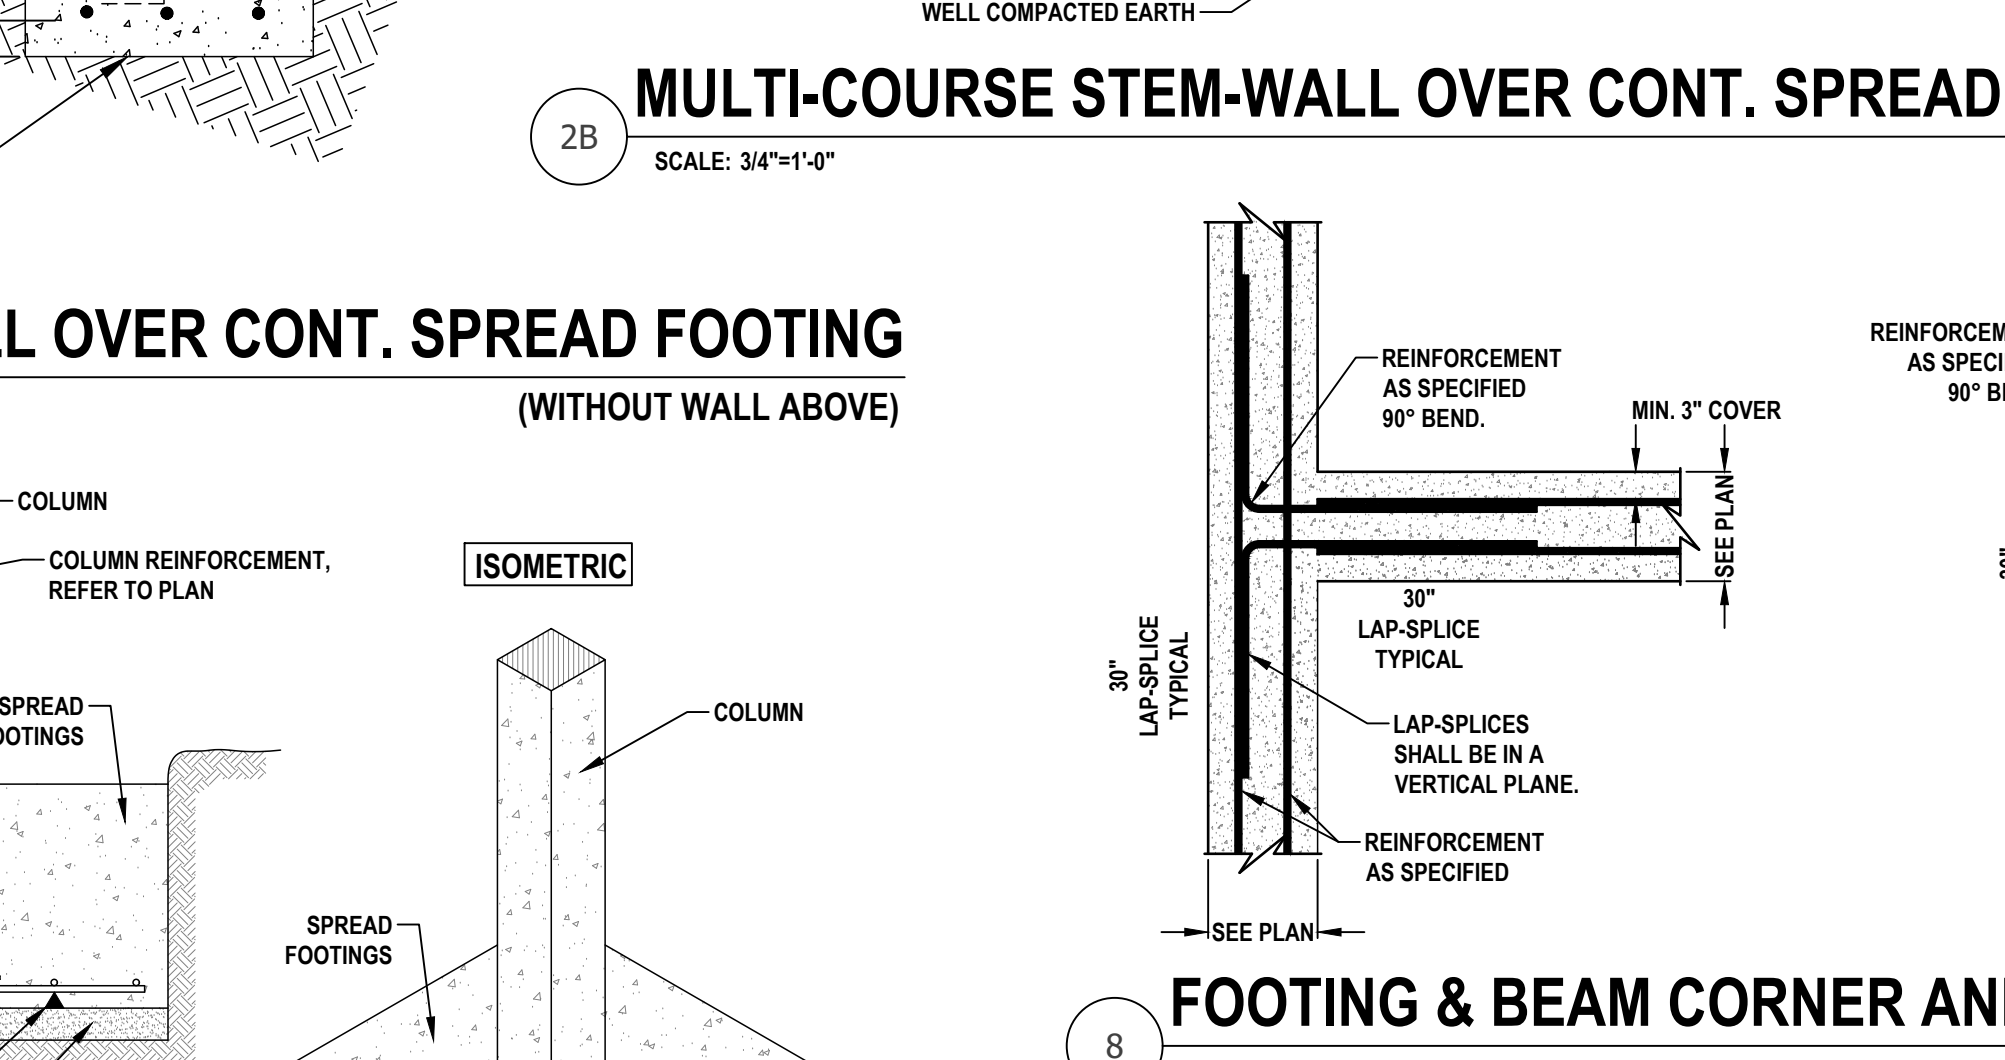

FOOTING & BEAM CORNER AND INTERSECTION DETAIL

SCALE: N.T.S.

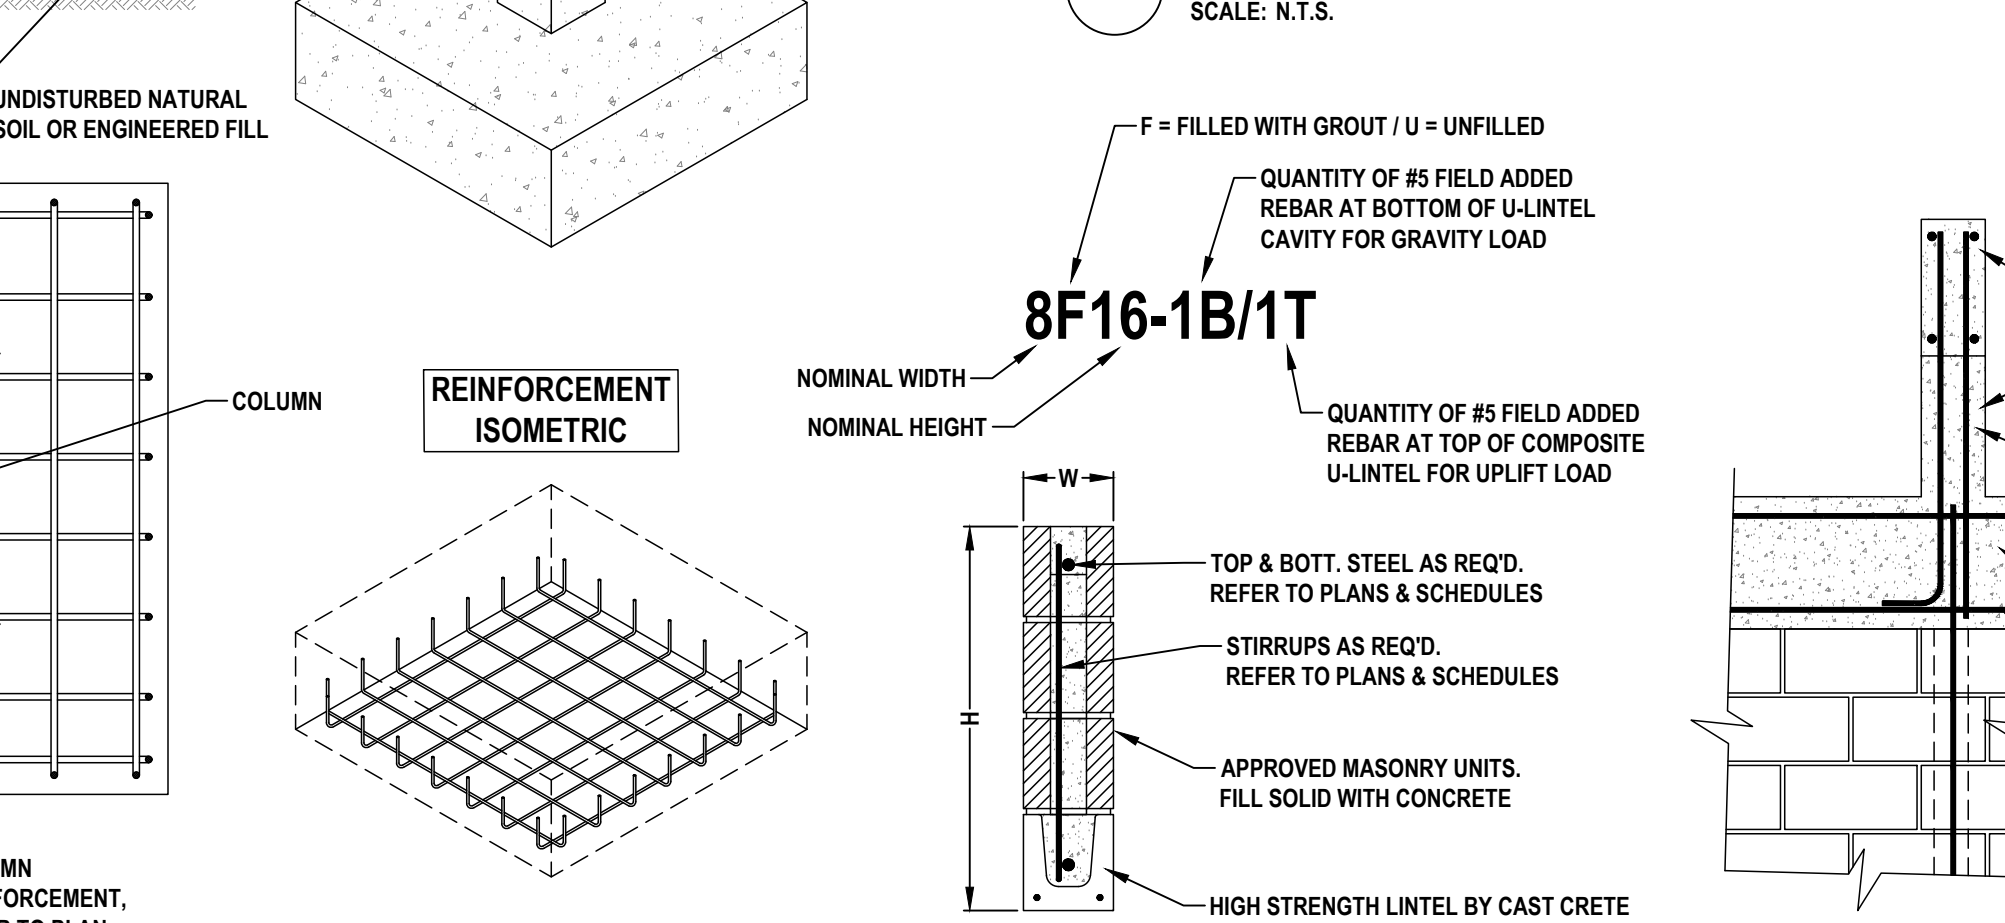


TYPICAL SPREAD FOOTING DETAIL

SCALE: N.T.S.




TYPICAL BOND BEAM DETAIL

SCALE: N.T.S.

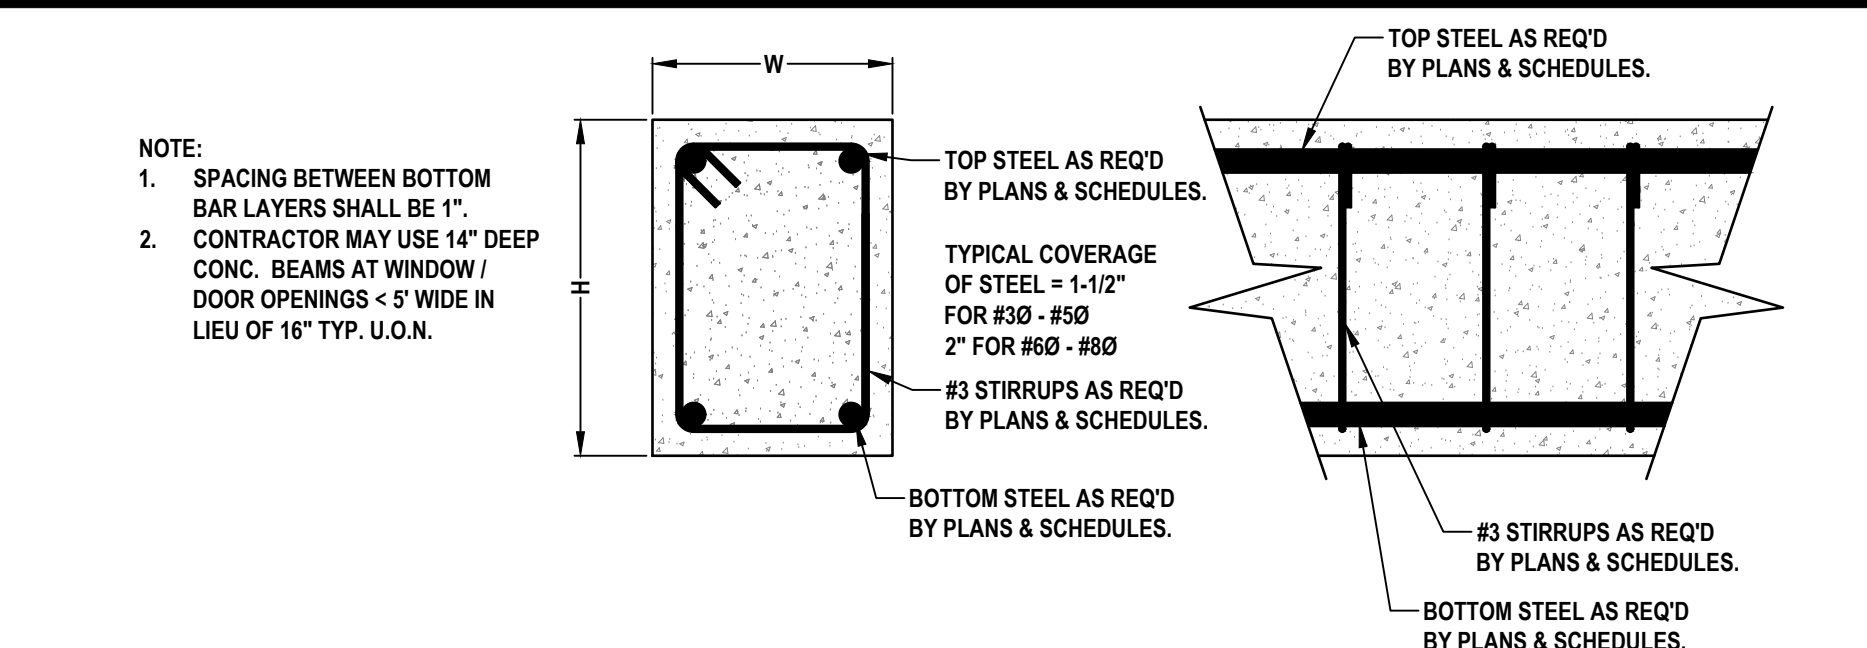


TYPICAL CONCRETE BEAM DETAIL

SCALE: N.T.S.

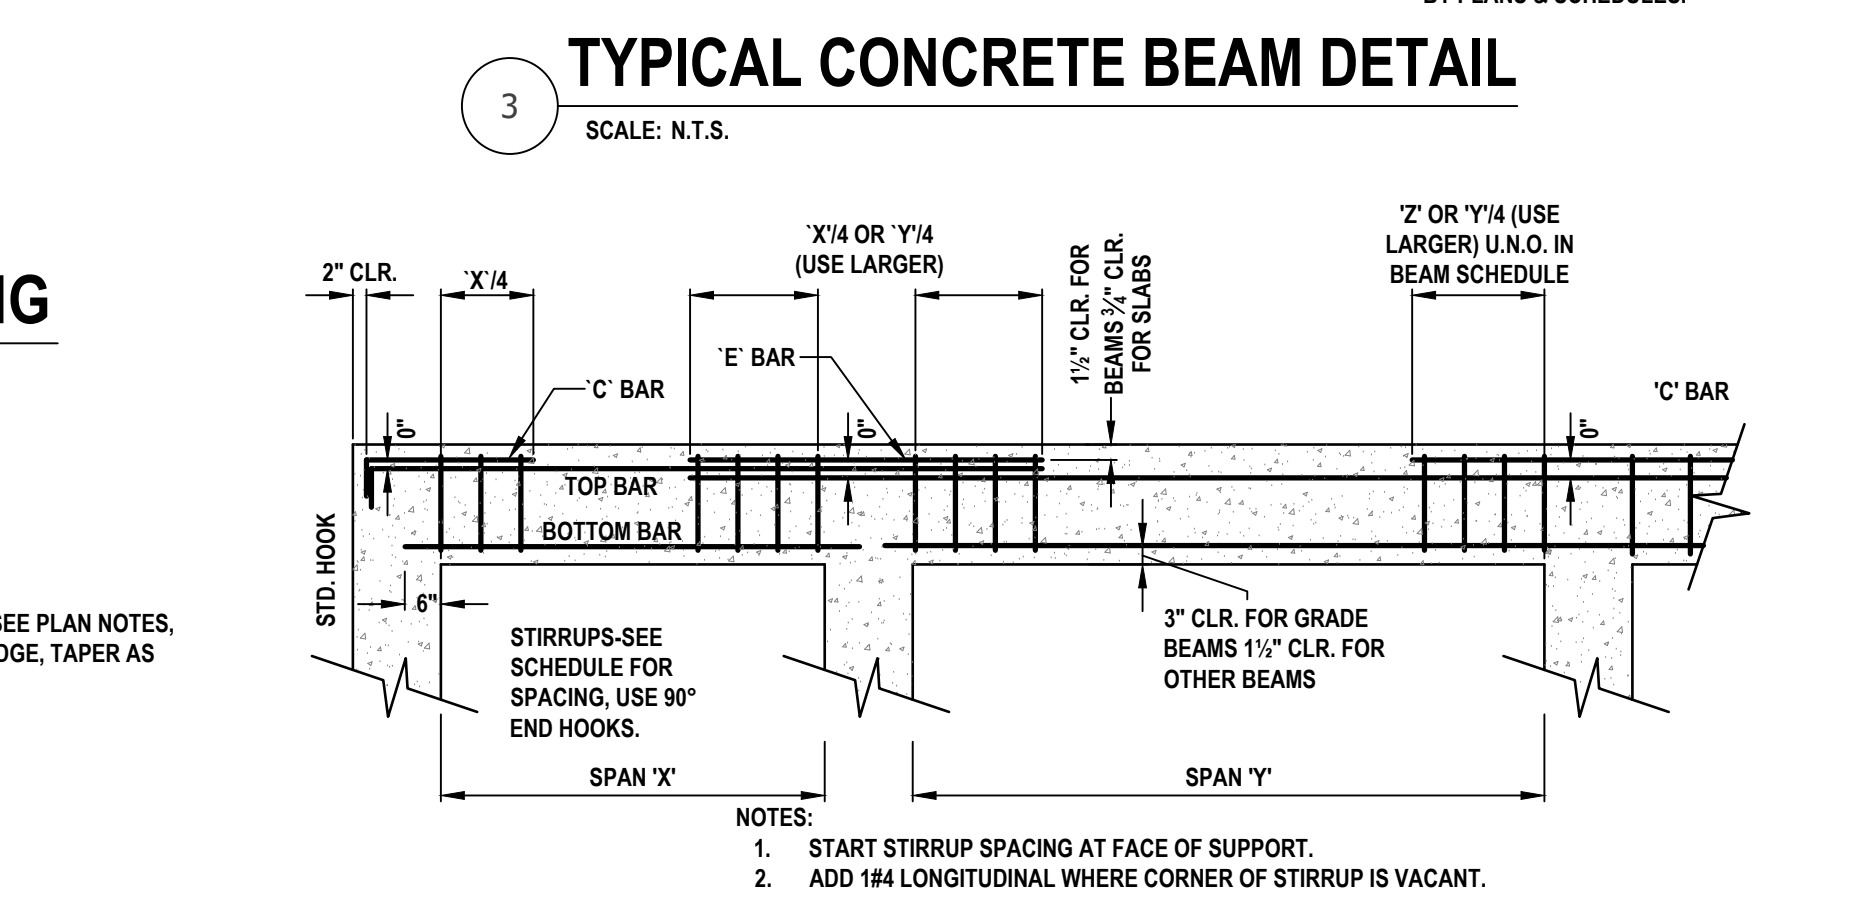


TYPICAL REINFORCEMENT DIAGRAM FOR CONTINUOUS BEAM


SCALE: N.T.S.

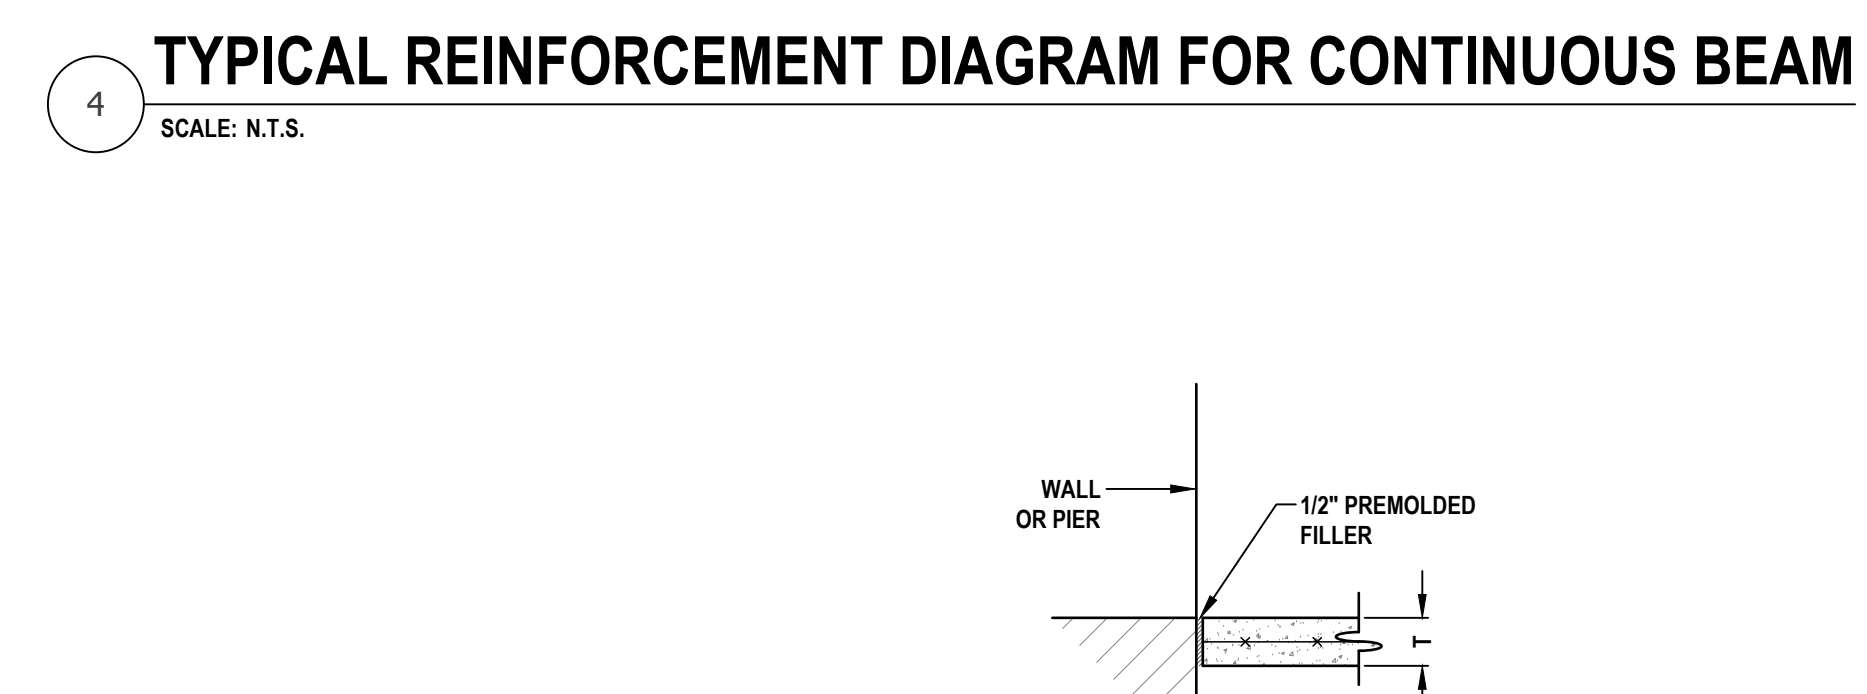


ISOLATION JOINT (IJ)

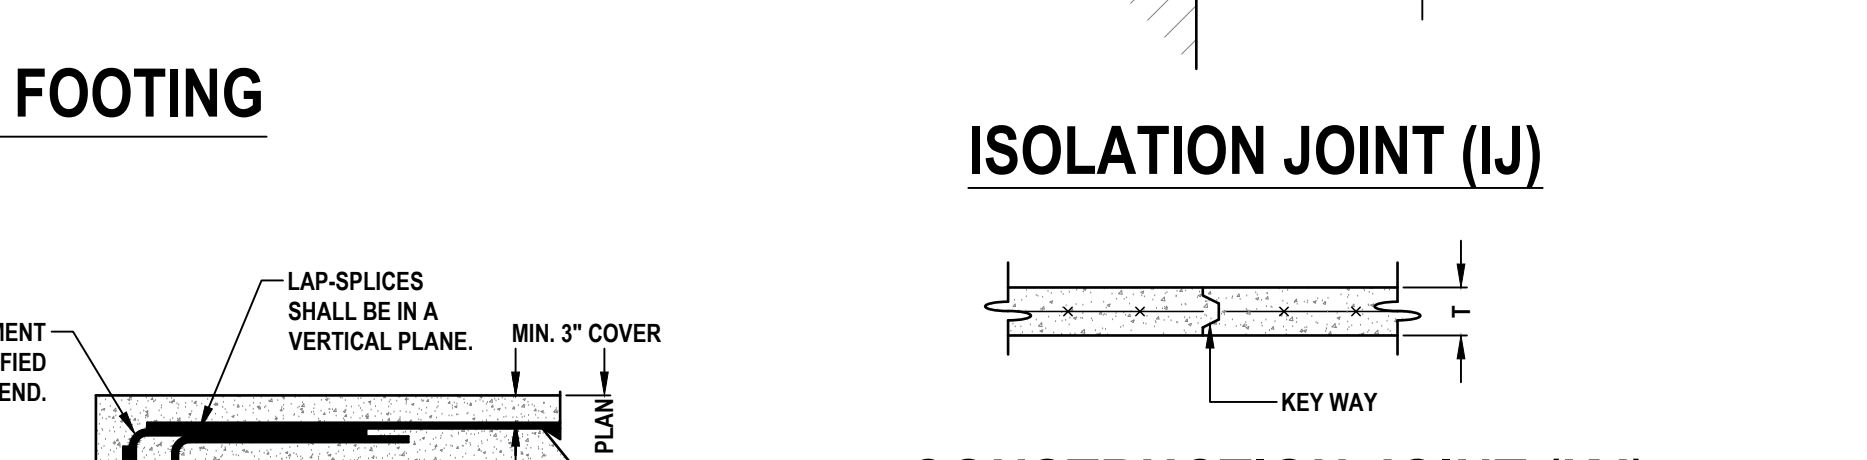

CONSTRUCTION JOINT (KJ)

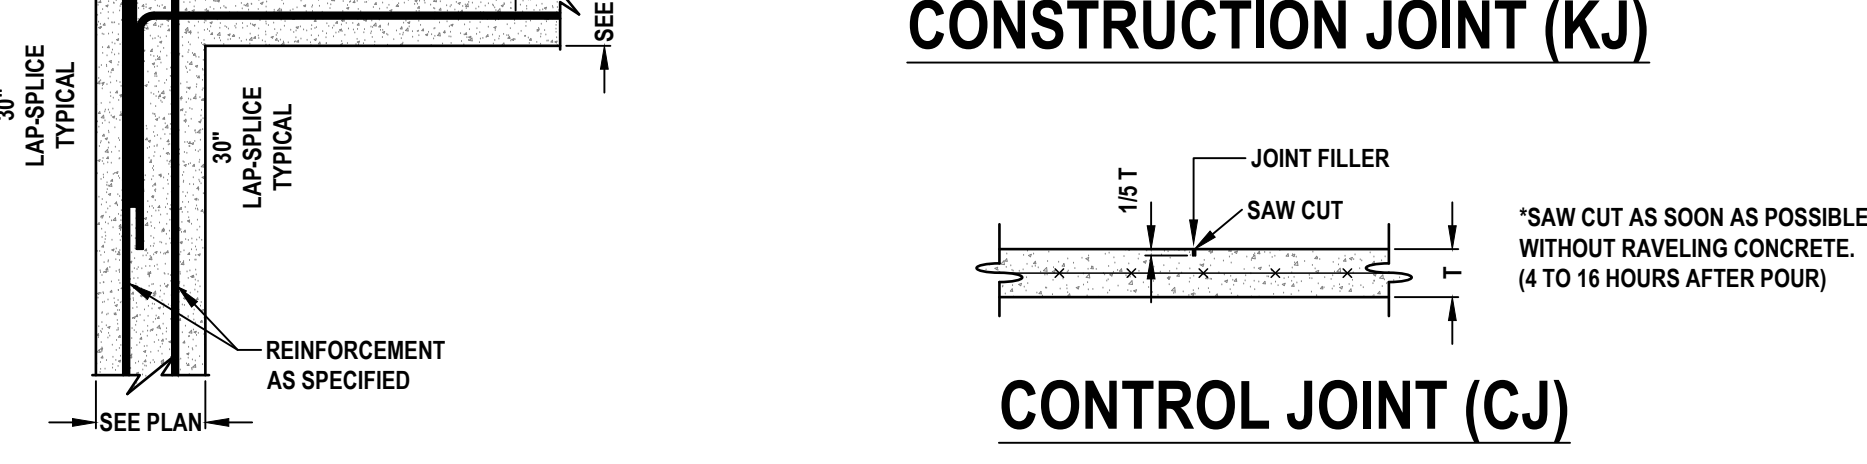

CONTROL JOINT (CJ)

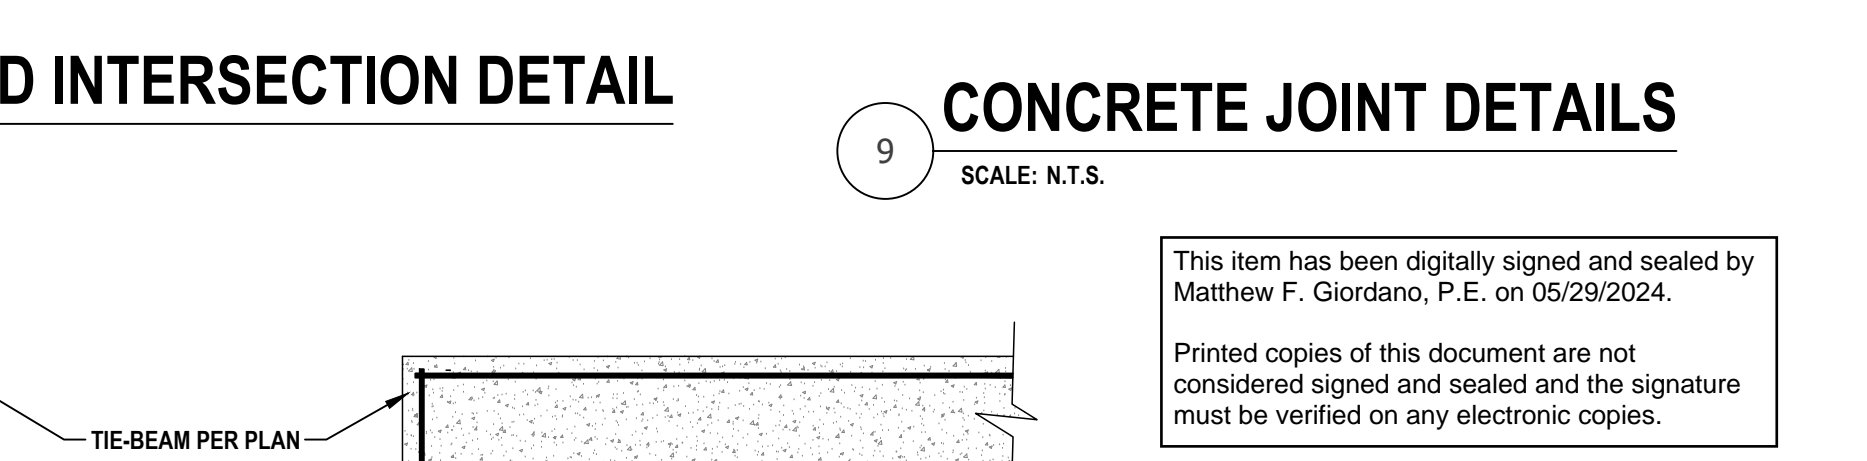

CONCRETE JOINT DETAILS

SCALE: N.T.S.

STAMPED FOR STRUCTURAL ONLY

THIS BUILDING/STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH SECTION 1609 OF THE 2023 FLORIDA BUILDING CODES 8TH EDITION FOR GRAVITY AND DESIGN PRESSURES GENERATED BY A WIND VELOCITY OF 160 M.P.H., 3 SECOND GUST. TRUSS PLAN & ENGINEERING BY OTHERS.

IF ANY ERRORS OR OMISSIONS EXIST IN THESE DRAWINGS OR SPECIFICATIONS, THE CONTRACTOR AND / OR OWNER SHALL, WITHIN 10 DAYS AFTER RECEIPT OF THESE DRAWING, AND PRIOR TO CONSTRUCTION, NOTIFY IN WRITING, OF SAID ERRORS OR OMISSIONS, OR BE HELD WHOLLY RESPONSIBLY FOR THE RESULTS AND COSTS OF RECTIFYING THE SAME.

NOR DO WE ASSUME ANY RESPONSIBILITY FOR SUPERVISION OF CONSTRUCTION OR REVIEW OF SHOP DRAWINGS.

THE MAXIMUM LIABILITY TO M.F. GIORDANO ENGINEERING, PLLC SHALL NOT EXCEED THE FEE PAID TO M.F. GIORDANO ENGINEERING, PLLC

DESIGNER: **M.F. GIORDANO ENGINEERING, PLLC**

CONTACT: MATTHEW GIORDANO, P.E.
PHONE: (347) 264-5891
FL P.E. #87672; STATE REGISTRY #34011
ADDRESS: 1222 SE 48TH STREET
CAPE CORAL, FL 33904

OWNER: REFER TO APPLICATION

CONTRACTOR: _____

KEY PLAN: _____

REVISIONS:

#	DATE	DESCRIPTION OF REVISION:

PROJECT DESCRIPTION: SEE PLANS

ADDRESS: SEE PLANS

OF STORIES: 1 COUNTY: _____

STRAP: -

SHEET TITLE: **MASONRY AND CONCRETE DETAILS**

PLAN NAME: **RESIDENTIAL HOME PLAN**

SEAL & SIGNATURE:

FILE DATE: -

PLAN DATE: -


DRAWN BY: MFG

CHECKED BY: MFG


PROJECT #: -

SHEET #: 08 OF 09


S-201.00

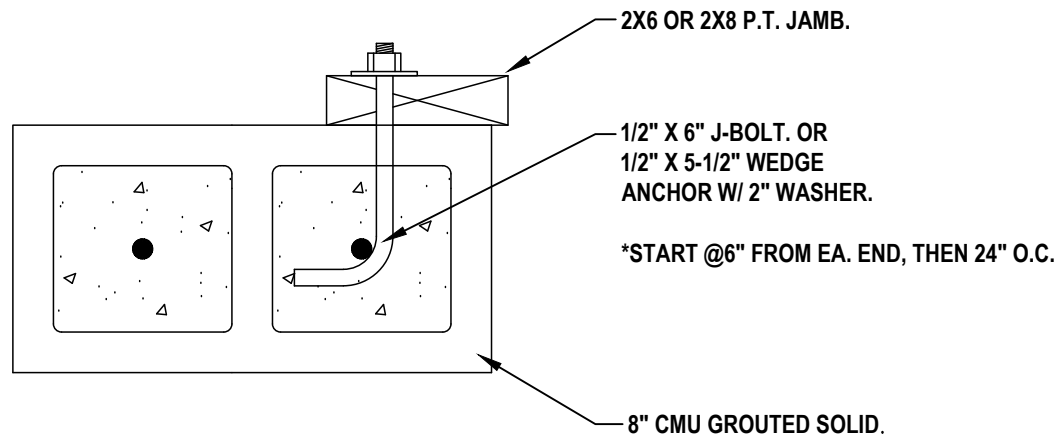


TYPICAL GARAGE DOOR JAMB DETAIL

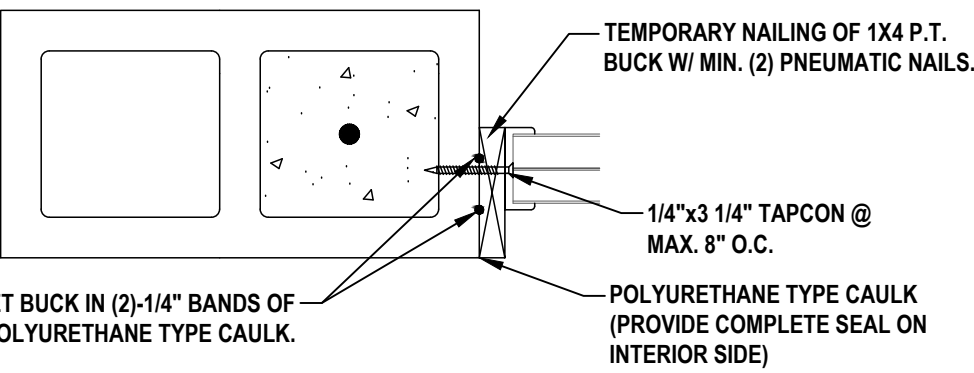

TYPICAL WINDOW BUCK DETAIL

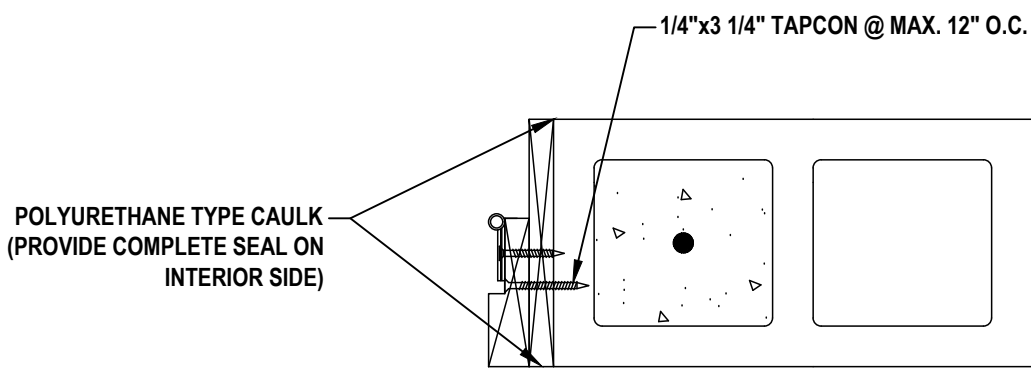

TYPICAL ENTRY DOOR BUCK DETAIL

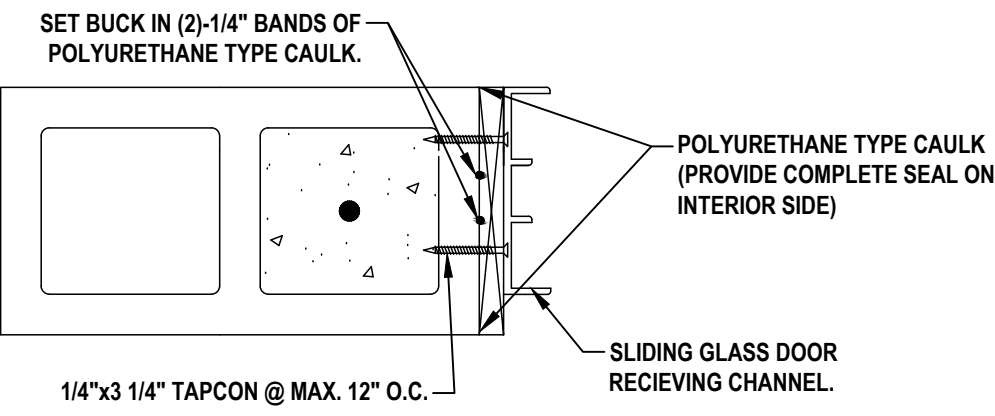


TYPICAL S.G.D. BUCK DETAIL

NOTES:

- INITIAL ATTACHMENT OF PT WOOD BUCKS TO MASONRY OPENINGS IS AT THE INSTALLERS DISCRETION AND MAY BE BUT NOT LIMITED TO ADHESIVES OR CASE HARDENED NAILS MANUALLY OR PNEUMATICALLY DRIVEN AS LONG AS THE BUCK IS NOT SPLIT. PERMANENT ATTACHMENT OF THE WINDOW/DOOR FRAME AND PT BUCK IS AS SHOWN ABOVE.
- REFER TO MFG. CUT SHEETS FOR ADDITIONAL REQUIREMENTS FOR THE SPECIFIC WINDOW OR DOOR. THE SIZE AND SPACING OF ATTACHMENTS SUPERCEDE DETAILS ABOVE.


1 TYPICAL WINDOW / DOOR ATTACHMENT DETAILS

SCALE: N.T.S.

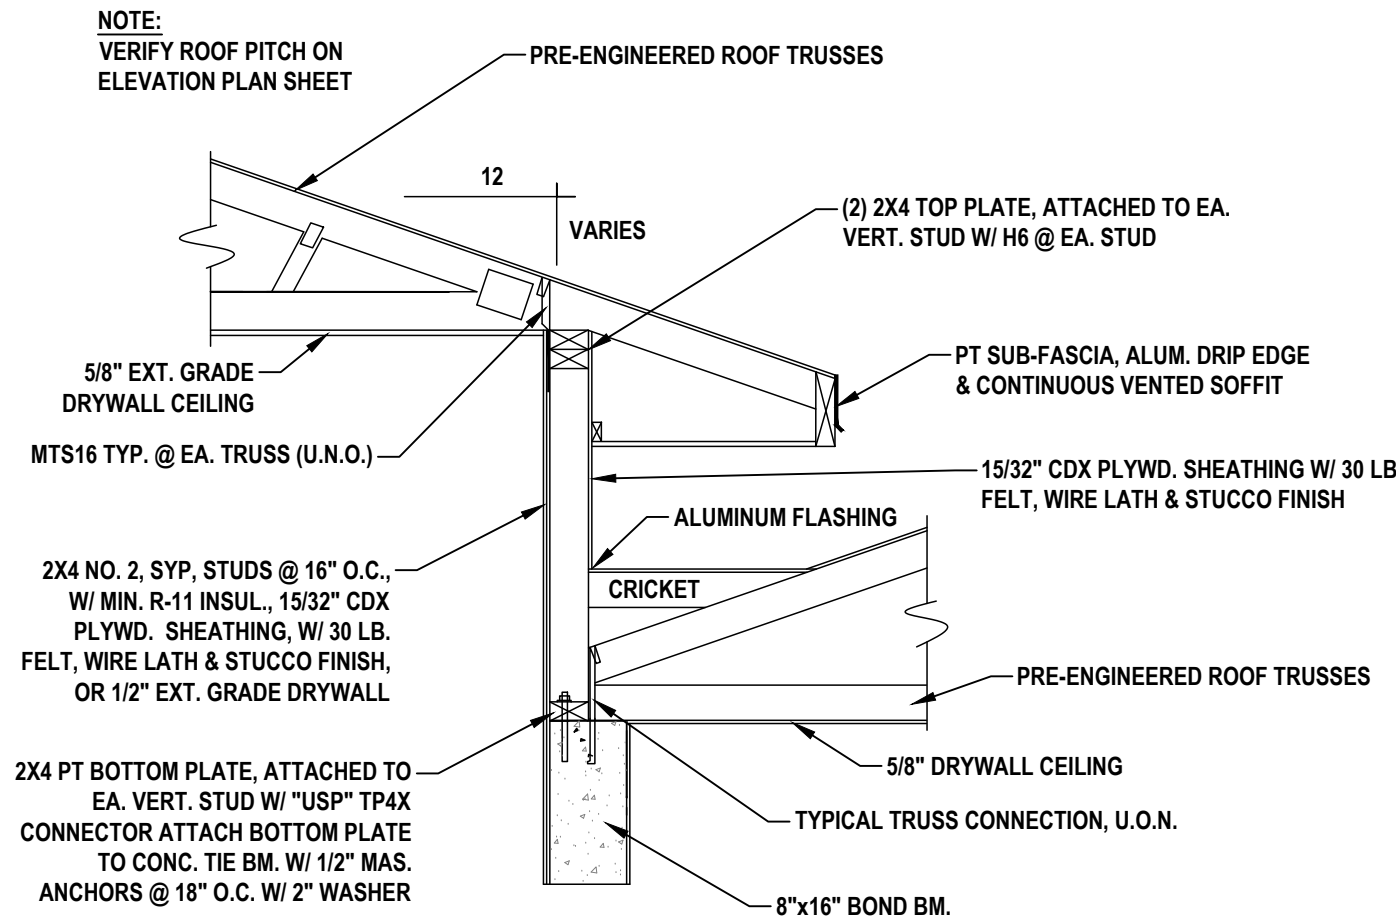


2 TYPICAL KNEEWALL @ RAISED ENTRY

SCALE: N.T.S.

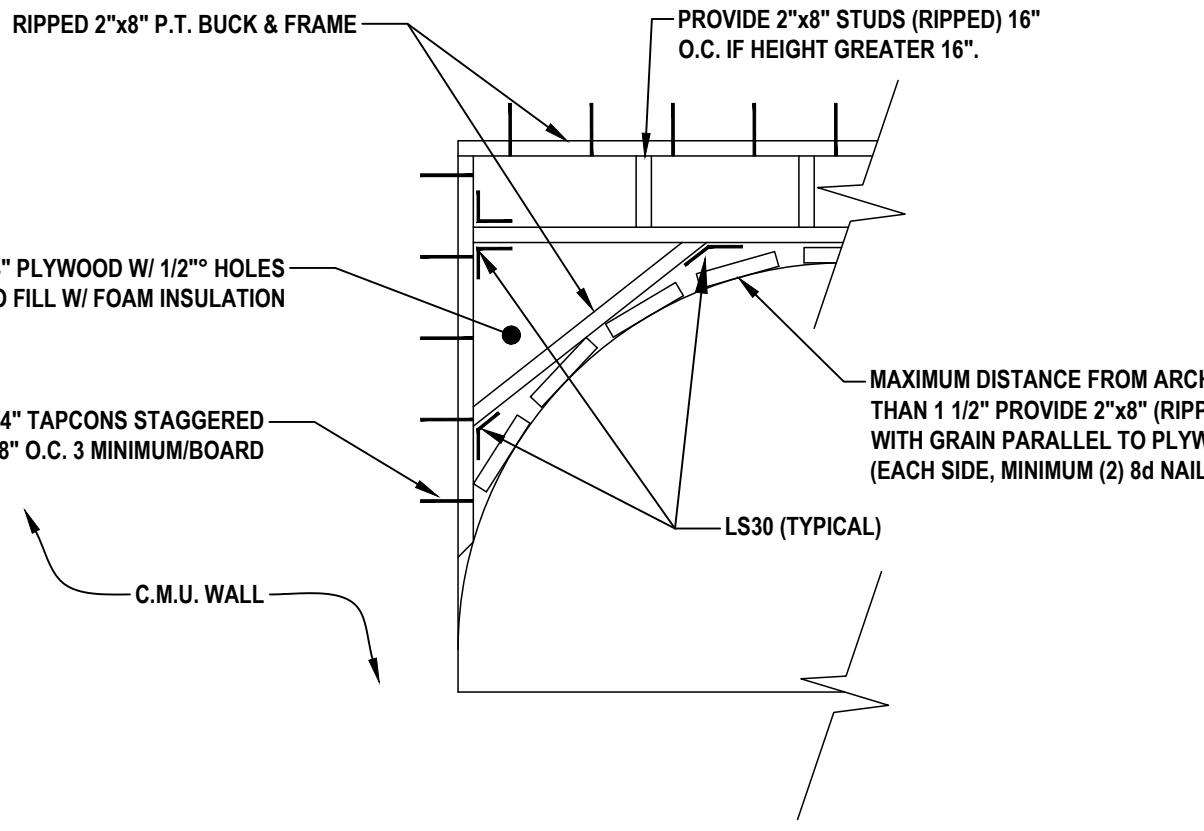


3 ARCH OPENING AND HEADER DETAIL

SCALE: N.T.S.

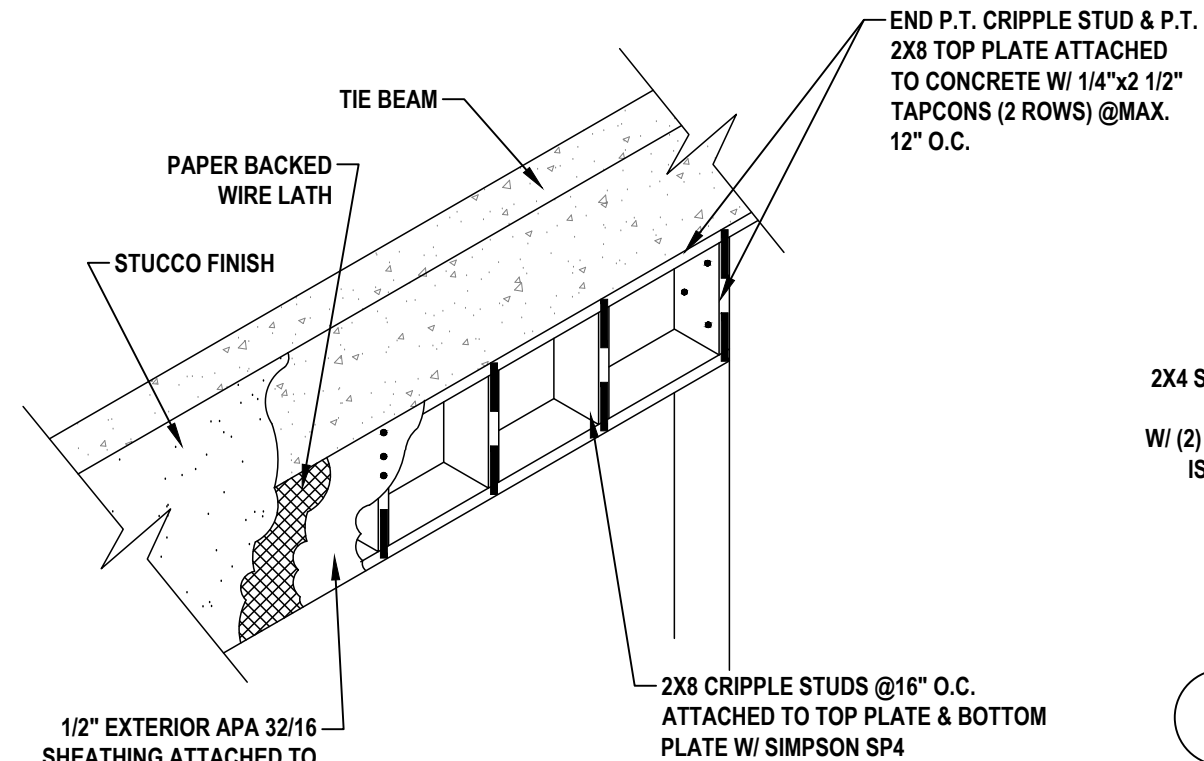


4 TIE-BEAM FRAME DOWN DETAIL

SCALE: N.T.S.

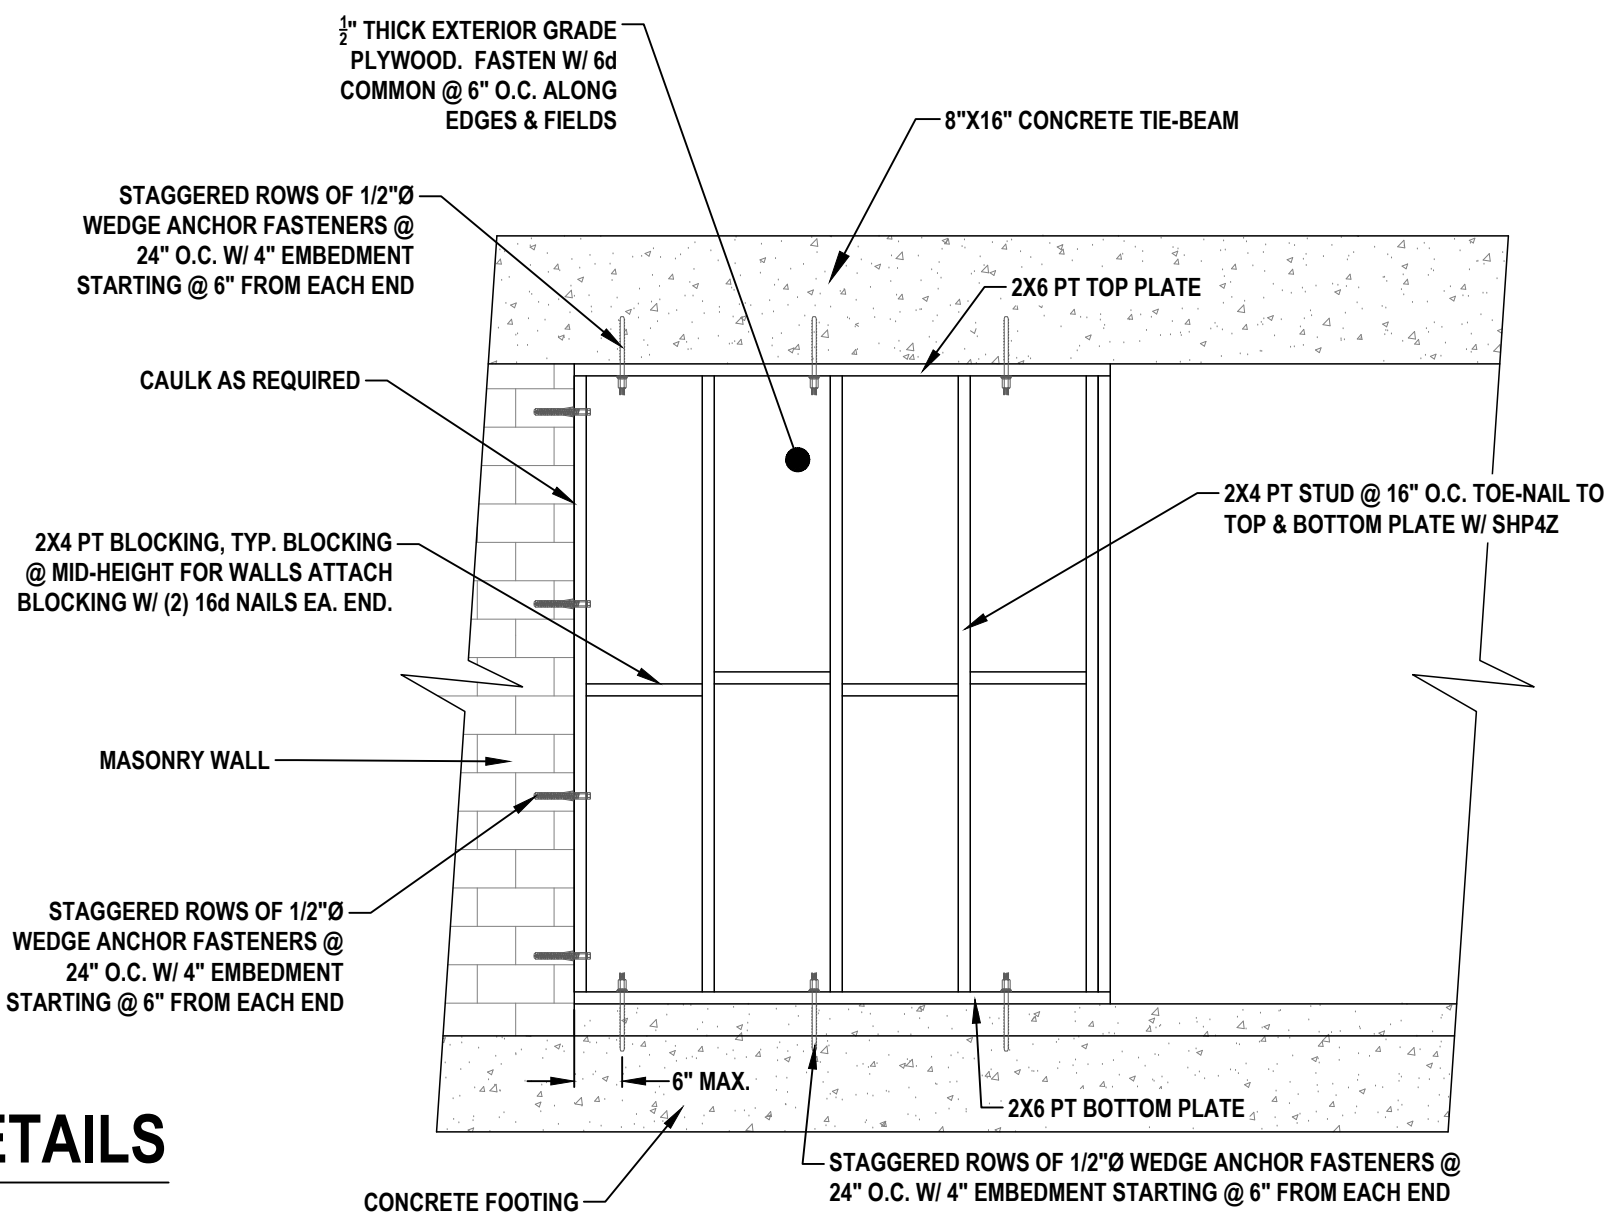


5 S.G.D. PKT. FRAME DETAIL

SCALE: N.T.S.

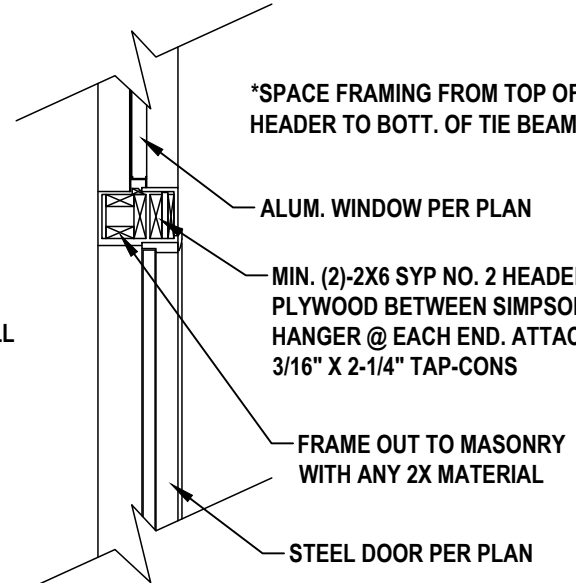


7 TYPICAL ENTRY HEADER DETAIL

SCALE: N.T.S.

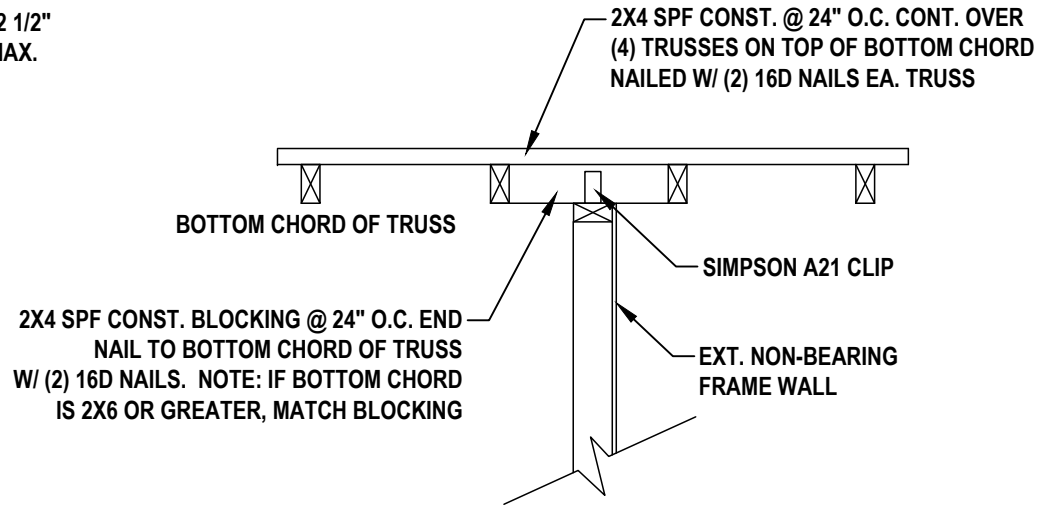


8 WALL FRAMED PARALLEL TO TRUSS

SCALE: N.T.S.

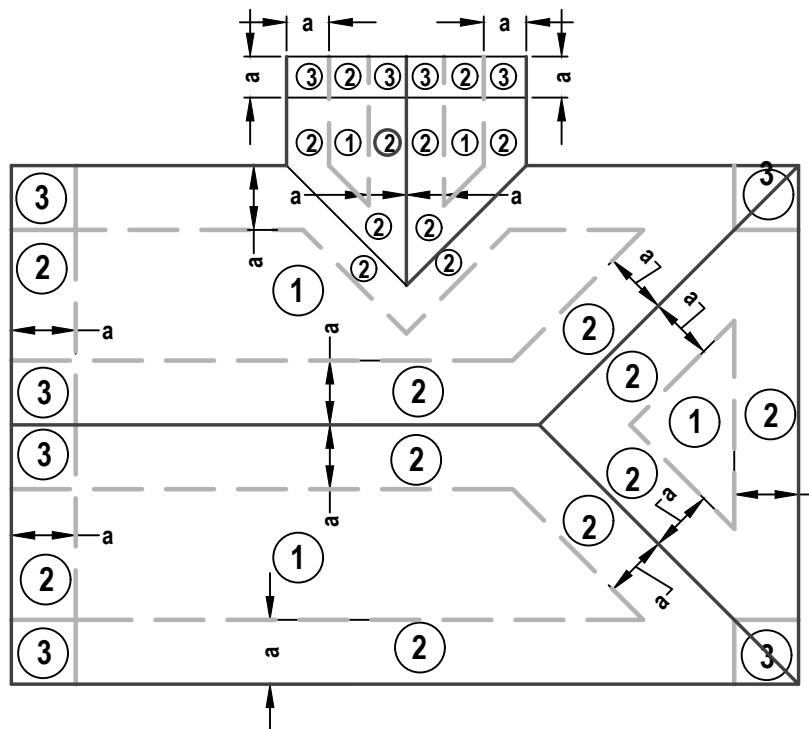

10 ROOF SHEATHING NAILING SPECIFICATION

SCALE: N.T.S.

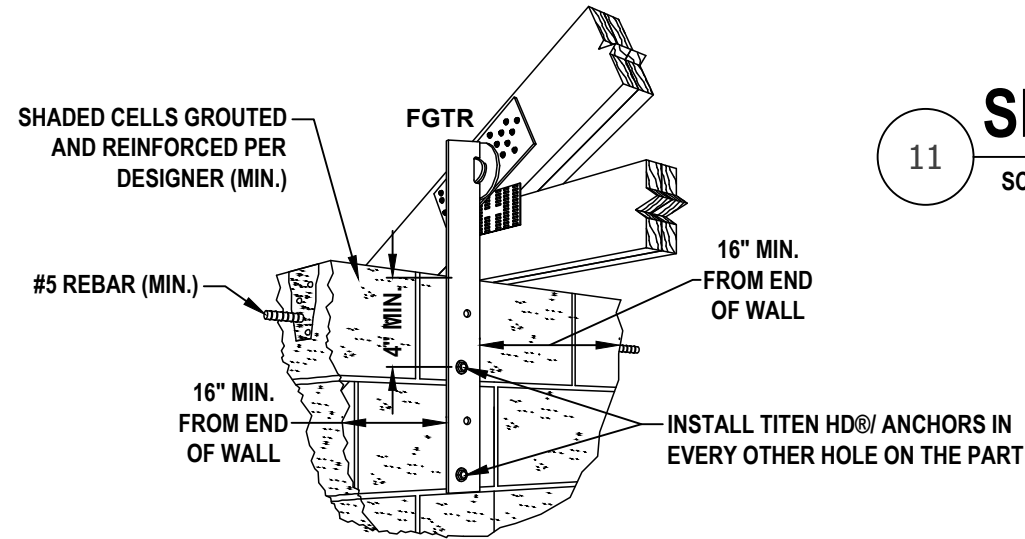

11 SP4Z - STUD TO SILL PLATE DETAIL

SCALE: N.T.S.

This item has been digitally signed and sealed by Matthew F. Giordano, P.E. on 05/29/2024.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

NOTES:


- SP UPLIFT - ONE-PLY TRUSS: 5,000 #
- SP UPLIFT - TWO OR THREE-PLY TRUSS: 5,000 #
- FASTENERS: (2) 3/4" X 5" TITEN HD
- TO ACHIEVE THE PUBLISHED LOADS, THE FGTR MUST BE ATTACHED TO A GROUTED AND REINFORCED BLOCK WALL OR REINFORCED CONCRETE WALL TO TRANSFER THE UPLIFT LOADS TO THE FOUNDATION.
- FGTR INSTALLED BETWEEN 4" AND 16" FROM THE END OF A WALL WILL HAVE AN ALLOWABLE LOAD OF 4,685 LB.
- FGTR IS PACKAGED WITH SIMPSON STRONG-TIE STRONG-DRIVE SDS HEAVY-DUTY CONNECTOR SCREWS AND TITEN HD® ANCHORS.
- FGTR CAN BE INSTALLED ON ROOF PITCHES UP TO 8:12 OR ON A BOTTOM CHORD DESIGNED TO TRANSFER THE LOADS.
- NOTE: ALL CAPACITIES SHOWN HEREIN ARE PER SIMPSON STRONG-TIE, HIGH WIND-RESISTANT CONSTRUCTION APPLICATION GUIDE, 2016; VERIFY ALL DATA AND INSTALLATION REQUIREMENTS WITH SIMPSON STRONG-TIE PRIOR TO INSTALLATION.

13 FGTR - TRUSS TO CMU WALL DETAIL

SCALE: N.T.S.

*STRAPS MAY BE INSTALLED STRAIGHT OR WRAPPED OVER TRUSS

*BLOCKING NOT SHOWN FOR CLARITY

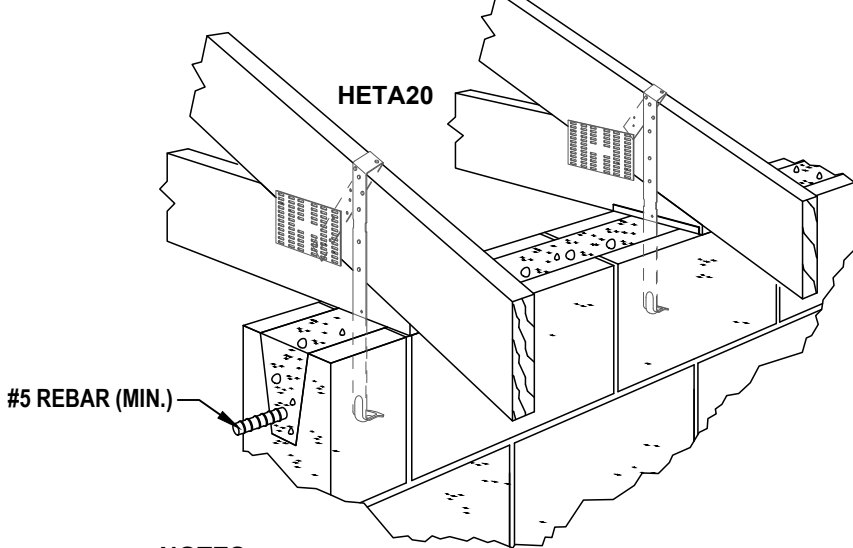

NOTES:

- SP UPLIFT - ONE-PLY TRUSS: 1,810 #
- SP UPLIFT - TWO OR THREE-PLY TRUSS: 1,810 #
- SP LATERAL LOAD (PARALLEL / PERPENDICULAR TO PLATE): 340 # / 795 #
- FASTENERS: (9) 10d X 1-1/2"
- NOTE: ALL CAPACITIES SHOWN HEREIN ARE PER SIMPSON STRONG-TIE, HIGH WIND-RESISTANT CONSTRUCTION APPLICATION GUIDE, 2016; VERIFY ALL DATA AND INSTALLATION REQUIREMENTS WITH SIMPSON STRONG-TIE PRIOR TO INSTALLATION.

12 HETA20 - TRUSS TO CMU WALL DETAIL

SCALE: N.T.S.

* THIS DESIGN MAY BE INCORPORATED FOR INTERIOR BEARING WALLS

NOTE: AT MASONRY (WHERE APPLICABLE) 2X- P.T. ATTACH FRAME WALLS TO MASONRY W/ 3/16" X 3" TAPCONS, @ 24" O.C. MIN. END & SPLICE DISTANCE = 6"


2X# P.T. SOLE PLATE. NAIL TO STUDS W/ 2-16D FOR 2X4 FRAMING & 3-16D FOR 2X6 & LARGER FRAMING

NOTE:

- BEARING WALL DESIGNED FOR A GRAVITY LOAD OF 1500# / TRUSS AND AN UPLIFT LOAD OF 1000# / TRUSS.
- REFER TO FLOOR PLAN FOR FRAMING MATERIAL, SIZE & SPACING.
- FASTEN 2X# BEAMS & STUDS W/ 16d AT 16" O.C.
- SPACE FRAMING FROM HEADER TO TOP OF WINDOW / DOOR OPENING IF NECESSARY.
- EQUIVALENT FASTENERS OF OTHER MANUFACTURES MAY BE SUBSTITUTED FOR THE LISTED FASTENERS.

9 WOOD BEARING WALL DETAIL

SCALE: N.T.S.

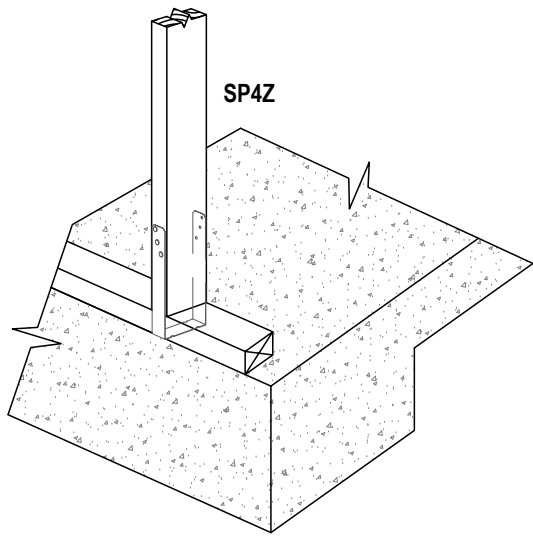

NOTES:

- DF/SP ALLOWABLE UPLIFT: 885 #
- SPF ALLOWABLE UPLIFT: 760 #
- FASTENERS: (6) 10d X 1-1/2"
- NOTE: ALL CAPACITIES SHOWN HEREIN ARE PER SIMPSON STRONG-TIE, HIGH WIND-RESISTANT CONSTRUCTION APPLICATION GUIDE, 2016; VERIFY ALL DATA AND INSTALLATION REQUIREMENTS WITH SIMPSON STRONG-TIE PRIOR TO INSTALLATION.

STAMPED FOR STRUCTURAL ONLY

THIS BUILDING/STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH SECTION 1609 OF THE 2023 FLORIDA BUILDING CODES 8TH EDITION FOR GRAVITY AND DESIGN PRESSURES GENERATED BY A WIND VELOCITY OF 160 M.P.H., 3 SECOND GUST. TRUSS PLAN & ENGINEERING BY OTHERS.

IF ANY ERRORS OR OMISSIONS EXIST IN THESE DRAWINGS OR SPECIFICATIONS, THE CONTRACTOR AND / OR OWNER SHALL, WITHIN 10 DAYS AFTER RECEIPT OF THESE DRAWING, AND PRIOR TO CONSTRUCTION, NOTIFY IN WRITING, OF SAID ERRORS OR OMISSIONS, OR BE HELD WHOLLY RESPONSIBLY FOR THE RESULTS AND COSTS OF RECTIFYING THE SAME.

NOR DO WE ASSUME ANY RESPONSIBILITY FOR SUPERVISION OF CONSTRUCTION OR REVIEW OF SHOP DRAWINGS.

THE MAXIMUM LIABILITY TO M.F. GIORDANO ENGINEERING, PLLC SHALL NOT EXCEED THE FEE PAID TO M.F. GIORDANO ENGINEERING, PLLC

DESIGNER:

M.F. GIORDANO
ENGINEERING, PLLC

CONTACT: MATTHEW GIORDANO, P.E.
PHONE: (347) 264-5891
FL P.E. #87672; STATE REGISTRY #34011
ADDRESS: 1222 SE 48TH STREET
CAPE CORAL, FL 33904

OWNER:

REFER TO APPLICATION

CONTRACTOR:

KEY PLAN:

REVISIONS:

#	DATE:	DESCRIPTION OF REVISION:

PROJECT DESCRIPTION:

DESCRIPTION:
SEE PLANS

ADDRESS:
SEE PLANS

OF STORIES: 1


COUNTY:

STRAP: -

WOOD FRAMING AND
CONNECTION DETAILS

RESIDENTIAL HOME PLAN

SEAL & SIGNATURE:

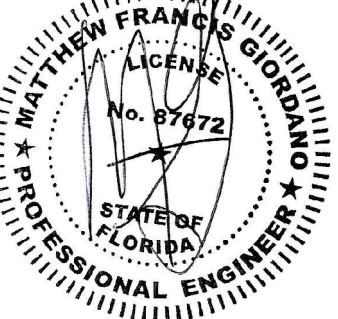

FILE DATE: -

PLAN DATE:


DRAWN BY: MFG

CHECKED BY: MFG

PROJECT #:


SHEET #: 09 OF 09

S-202.00

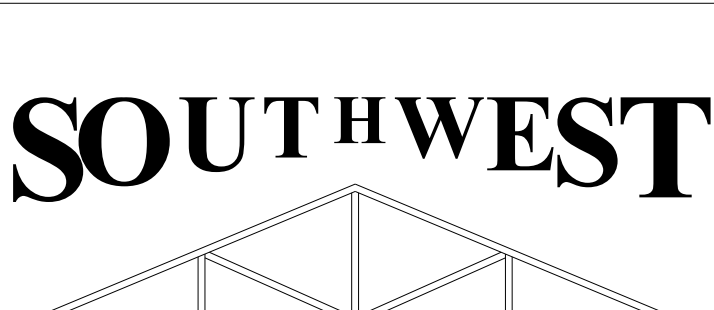GENERAL INFORMATION		
READ ALL NOTES. TRUSSES WILL NOT BE MANUFACTURED WITHOUT APPROVAL OF THIS DRAWING.		
WARNING AND INSTRUCTIONS: THOSE INSTALLING AND USING THESE COMPONENTS MUST READ AND FOLLOW THE WARNINGS AND INSTRUCTIONS INCLUDED IN THE DELIVERY AND ENGINEERING PACKAGE. DO NOT INSTALL OR USE THESE COMPONENTS UNTIL THE FULL DELIVERY PACKAGE IS RECEIVED AND ALL THE TRUSSES ARE VERIFIED FOR ACCURACY. REFER TO BCSI SUMMARY SHEET (TRUSS PLATE INSTITUTE RECOMMENDATIONS) AND INDIVIDUAL TRUSS DESIGNS FOR IMPORTANT INFORMATION REGARDING BRACING AND INSTALLATION GUIDELINES.		
THE ADVICE OF A PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT MUST BE SOUGHT ON MATTERS RELATING TO BEARING DESIGN, ANCHORAGE, BRACING, INSTALLATION AND USE OF COMPONENTS. DADE TRUSS COMPANY IS NOT RESPONSIBLE FOR THESE MATTERS. A PERMIT FROM THE BUILDING DEPARTMENT IS REQUIRED TO INSTALL THESE COMPONENTS. DO NOT INSTALL THESE COMPONENTS UNTIL ONE IS OBTAINED. CONTRACTOR MUST ADHERE TO ALL BUILDING CODE REQUIREMENTS REGARDING THE INSTALLATION AND USE OF TRUSSES.		
INSTALLATION AND USE: DO NOT CUT OR ALTER TRUSSES. DO NOT INSTALL OR USE DAMAGED TRUSSES AND REPORT ANY DAMAGED TRUSSES TO FABRICATOR. PROPER INSTALLATION AND USE OF THESE COMPONENTS IS THE SOLE RESPONSIBILITY OF THOSE PERSON INSTALLING AND USING THESE COMPONENTS. DADE TRUSS COMPANY, INC. IS NOT RESPONSIBLE FOR THE LIABILITIES THAT MAY RESULT FROM FIELD STORAGE, MISUSE, OR IMPROPER INSTALLATION OF THESE COMPONENTS WHICH MAY RESULT IN FAILURES, BODILY INJURY, LOSS OR PROPERTY, AND/OR LIFE. TRUSSES MUST BE INSTALLED BY CONTRACTORS WITH SUFFICIENT EXPERIENCE IN TRUSS INSTALLATION AND HANDLING.		
ERECTION SUPERVISION IS REQUIRED BY A PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT FOR TRUSSES OVER 40 FEET IN LENGTH. NO ALTERATION OF THE TRUSSES IS ALLOWED WITHOUT PREVIOUS APPROVAL OF TRUSSES MANUFACTURER. ANY UNAUTHORIZED ALTERATION, REPAIR, OR MODIFICATION OF THE TRUSSES WILL CAUSE DADE TRUSS COMPANY TO RELINQUISH RESPONSIBILITY FOR THE STRUCTURAL SAFETY OF THOSE TRUSSES AND TO NOTIFY BUILDING OFFICIALS. THIS IS A TRUSS PLACEMENT DRAWING ONLY. TRUSSES SHOWN ON THIS PLAN ARE A COMPONENT PART OF A STRUCTURE. THIS PLAN IDENTIFIES TRUSS LOCATION. INSTALLER MUST REFER TO INDIVIDUAL ENGINEERING DRAWINGS FOR PROPER IDENTIFICATION OF TRUSSES.		
BRACING: ERECTION AND PERMANENT BRACING WHICH IS ALWAYS REQUIRED ARE THE RESPONSIBILITY OF THE CONTRACTOR NOT THE TRUSS FABRICATOR. REFER TO INDIVIDUAL TRUSS DESIGNS AND ARCHITECTURAL OR ENGINEERING DRAWINGS FOR ADDITIONAL BRACING REQUIRED TO BE INSTALLED DURING ERECTION. REFER TO ARCHITECTURAL DRAWINGS FOR BRACING REQUIRED TO RESIST WIND AND OTHER SPECIFIC LOADING CONDITIONS. PERSONS ERECTING TRUSSES ARE CAUTIONED TO SEEK PROFESSIONAL ADVICE REGARDING ERECTION BRACING WHICH IS ALWAYS REQUIRED TO PREVENT TOPPLING AND COLLAPSING DURING INSTALLATION. TRUSSES SHALL BE ERECTED AND FASTENED IN A STRAIGHT AND PLUMB POSITION.		
BEARINGS: ALL BEARINGS, BEARING DESIGNS, BRACING, AND ANCHORAGE, ARE RESPONSIBILITY OF THE PROJECT DESIGNER. REFER TO INDIVIDUAL TRUSS DESIGNS FOR REACTIONS AND UPLIFTS. TRUSSES MAY NOT BEAR ON ANY INTERIOR WALL OR PARTITION UNLESS DESIGNED FOR THE SAME.		
GIRDERS: GIRDER PLYS SHOULD BE FIELD CONNECTED BY BUILDER AS SHOWN ON THE INDIVIDUAL ENGINEERING DESIGNS.		
SPACING: TRUSS SPACING 24" OC UNLESS OTHERWISE NOTED ON LAYOUT.		
HANGERS: TRUSS MANUFACTURER WILL ONLY SUPPLY STANDARD LIGHT GAUGE TRUSS TO TRUSS CONNECTORS AS SHOWN IN THE ENGINEERING PACKAGE AND ONLY FOR SPANS OVER 12'. ALL HANGERS REQUIRED FOR TRUSSES OF LESS THAN 12' IN SPAN AND WITH REACTIONS OF LESS THAN 600 LBS MUST BE SUPPLIED BY BUILDER. ALL CONNECTIONS REQUIRING SPECIALLY MANUFACTURED HANGERS ARE TO BE SUPPLIED BY BUILDER.		
ACCEPTANCE AND APPROVAL: ALL DIMENSIONS, QUANTITIES, LOADING, AND DETAILS ON THIS PLAN AND ON THE INDIVIDUAL TRUSS DESIGNS MUST BE REVIEWED AND APPROVED BY THE CUSTOMER, OWNER, PROJECT ARCHITECT, ENGINEER OR CONTRACTOR BEFORE FABRICATION OF THE TRUSSES. THE CUSTOMER AND CUSTOMER'S REPRESENTATIVE ACCEPTS ALL CONDITIONS DESCRIBED HEREIN AND EXPRESSLY AUTHORIZES THE FABRICATION OF THE TRUSSES AS DESCRIBED HEREIN.		
By: _____		
Date: _____		
TRUSS PLACEMENT PLAN AND INDIVIDUAL TRUSS DESIGNS ACCEPTED AND APPROVED.		
Client: OWNER BUILDER		
Job Name: NEW RESD		
Model:	Date: 03/01/24	
Lot #: Lot	Block:	
Job Addr: ROTONDA WEST-FL		
Architect:		
DES.		
		



NOT TO SCALE

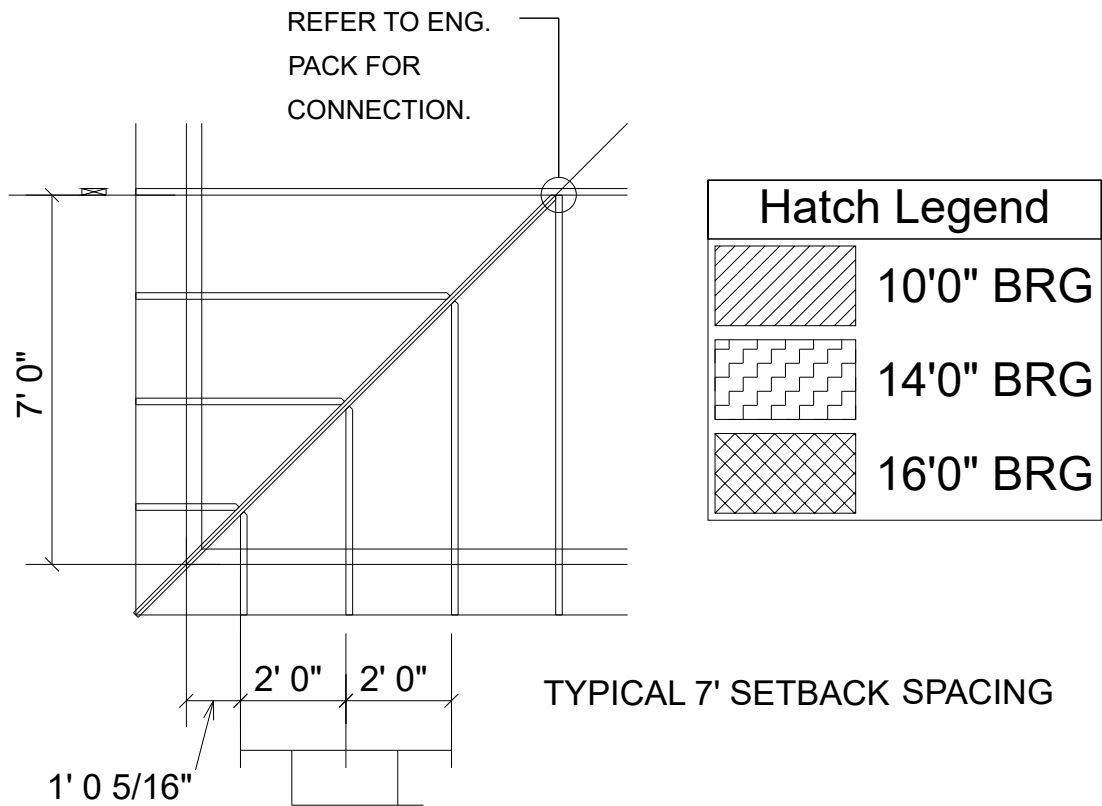

SHOP DRAWING / SUBMITTAL REVIEW	
<input checked="" type="checkbox"/> REVIEWED <input type="checkbox"/> REVISE AND RESUBMIT	<input type="checkbox"/> REVIEWED W/ COMMENTS <input type="checkbox"/> REJECTED
THIS DOCUMENT HAS BEEN REVIEWED FOR GENERAL CONFORMANCE WITH THE DESIGN CONCEPT ONLY. This review does not relieve the contractor or any subcontractor of responsibility for full compliance with contract requirements; for correctness of dimensions, clearances, and material quantities; for proper design of details; for proper fabrication and construction techniques; for proper coordination with other trades; and for providing all devices required for safe and satisfactory construction and operation.	
BY: <u>MATTHEW GIORDANO</u>	DATE: <u>05/29/2024</u>
M.F. GIORDANO ENGINEERING, PLLC	